




# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-100-199 WELL#=199-D5-13




LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

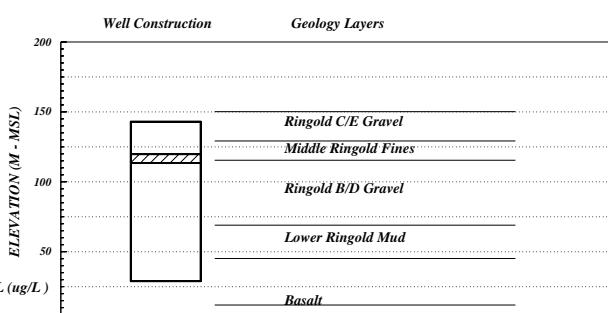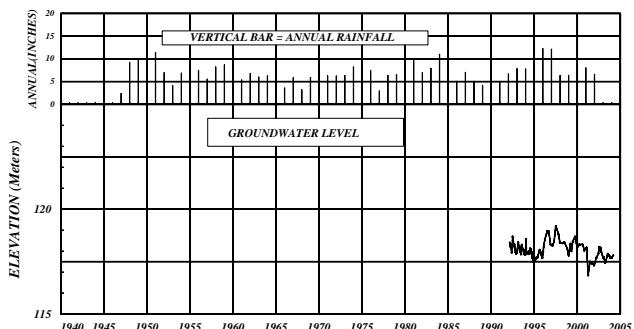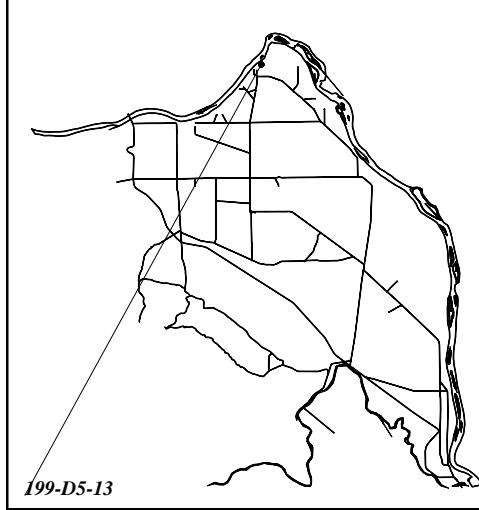

**WELLNAME=199-D5-13 WELLID=A4570**  
 Well Type=STANDARD Well purpose=GROUNDWATER  
 Owner=DOE Contact=BHI Well Addr=Compliant  
 X\_coor= 573535.50 Y\_coor= 151955.20 Datum=NAD83(91) Date Survey= 9/30/1994  
 Elevation= 143.003 Datum=NAVD88 Date Survey=08/11/94  
 Ref\_Point\_Desc=BRASS CAP Ref\_Point\_side=NONE Contractor=USACE(JECA)  
 Total Number of perforation Intervals=1  
 NPERF#=1 Perf\_top= 120.48 Bot= 114.08 MCas\_size= 0.00 Perf\_cuts= 0.00  
 Total Number of Screen Intervals=1  
 Screen#=1 Screen\_diam= 4.00 in Top= 23.26 Bottom= 29.57 m Slot\_size= 0.01 in  
 Screen\_material=Stainless Steel

## VOLATILE ORGANIC COMPOUNDS

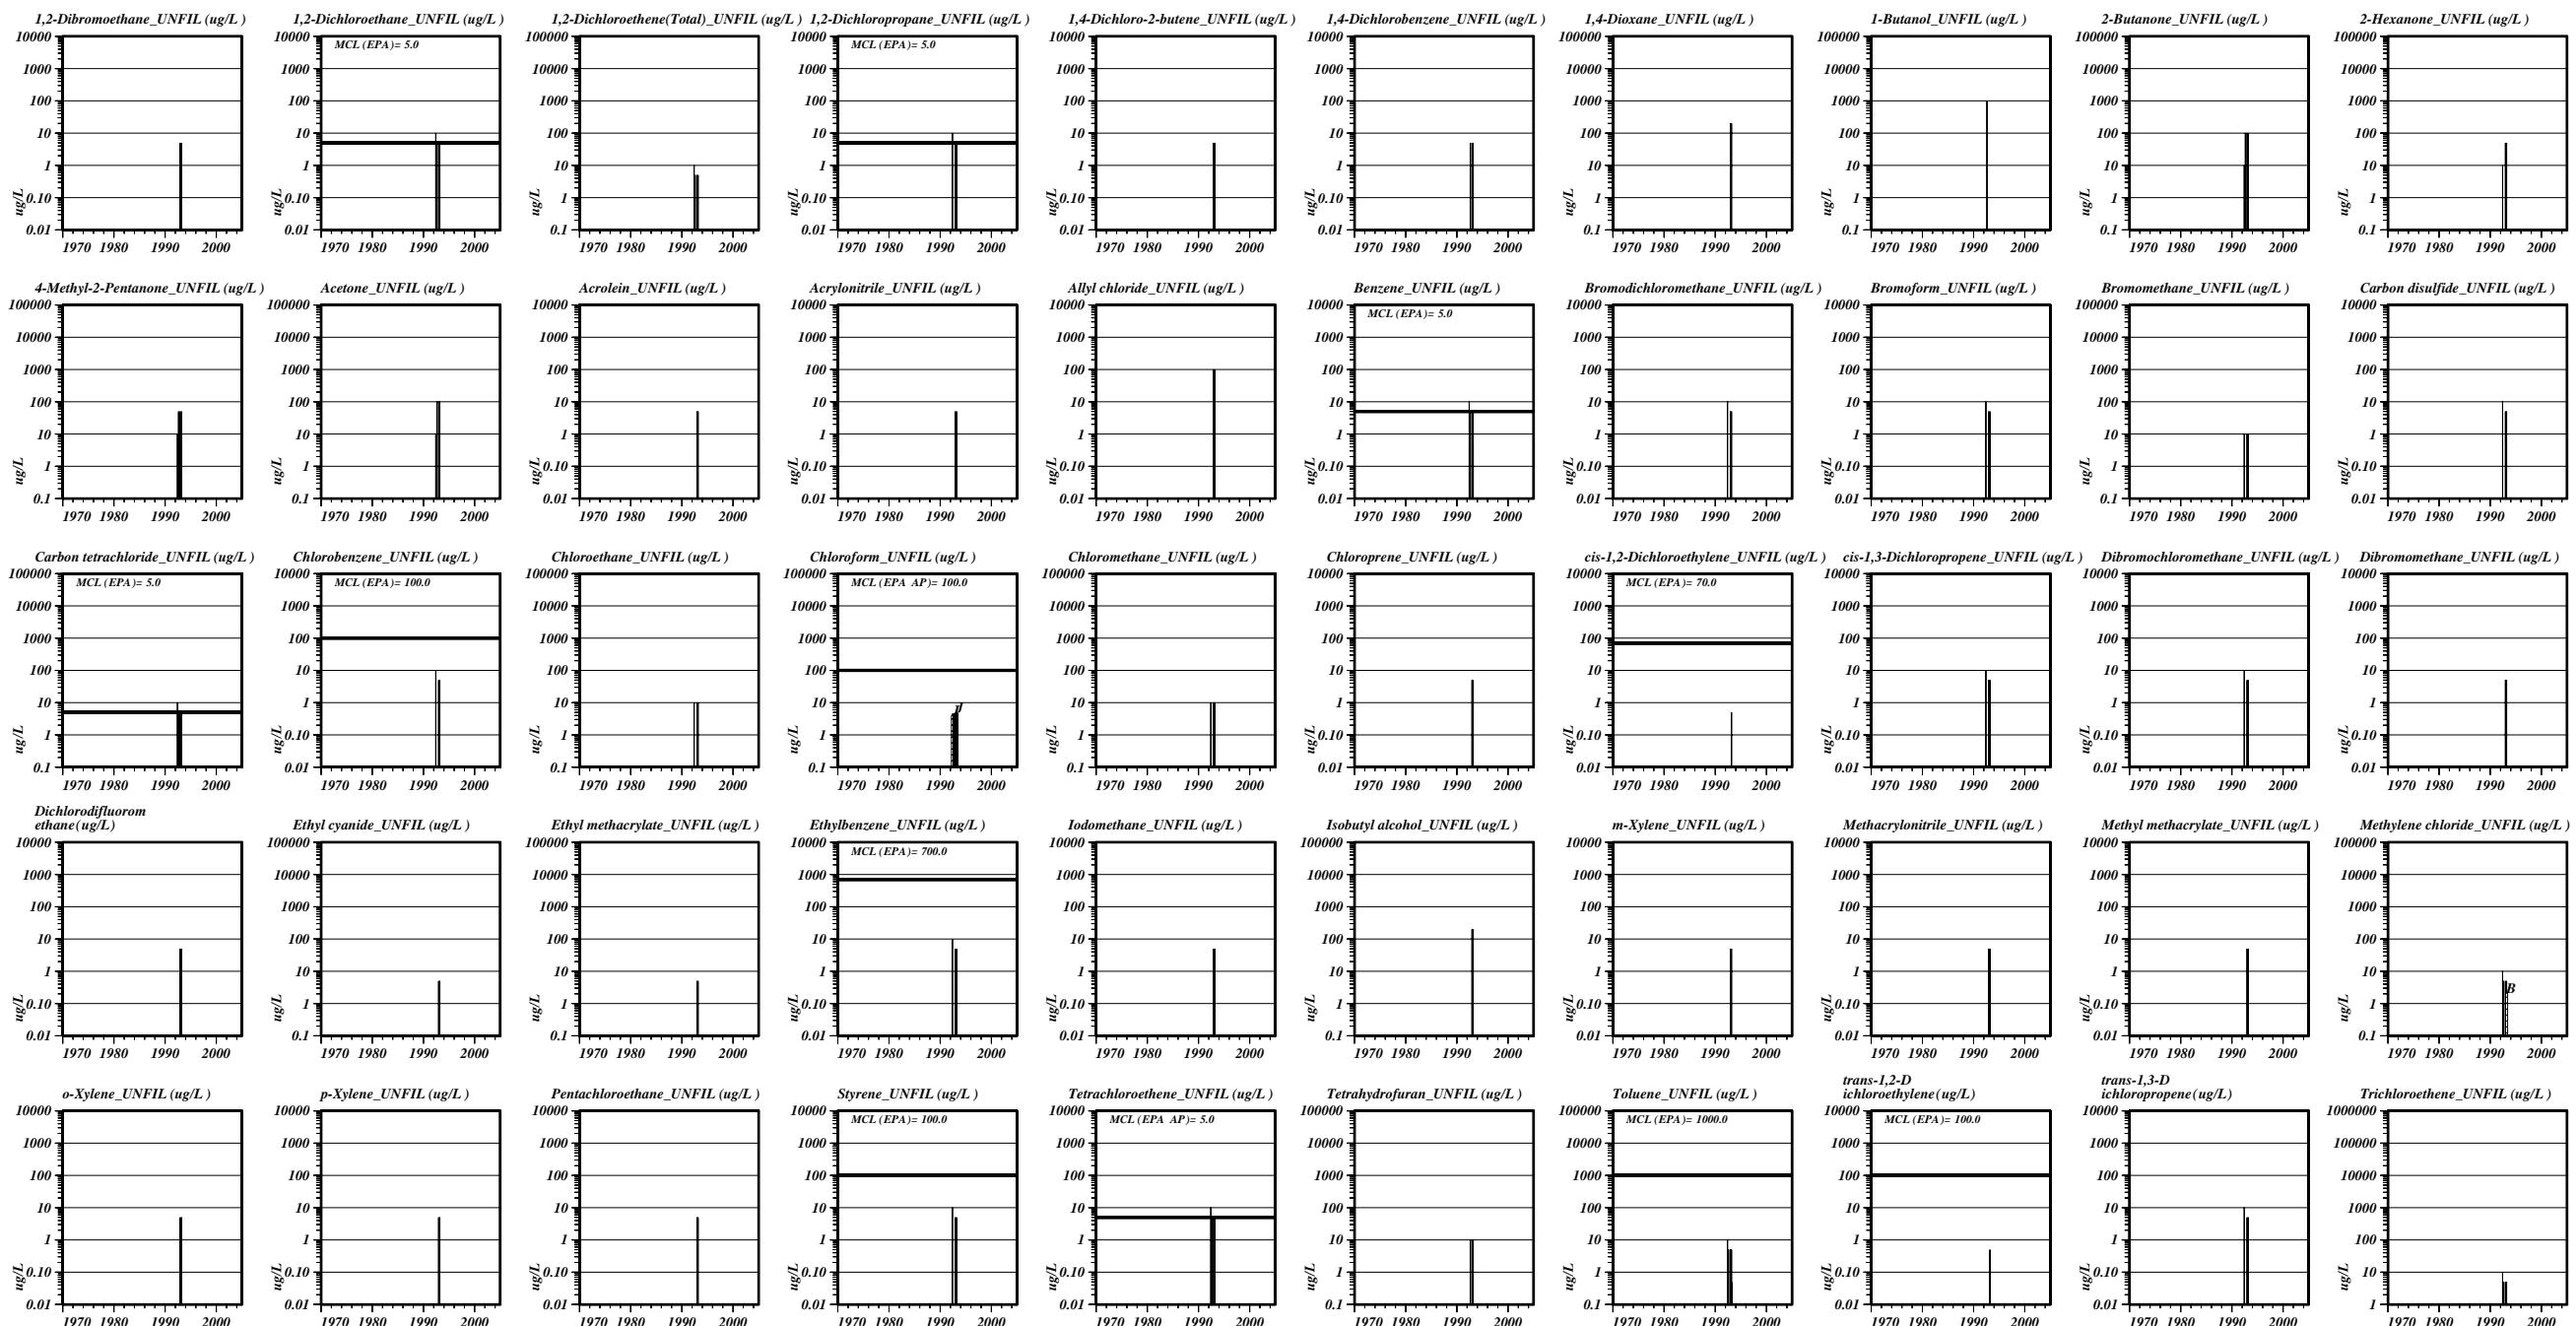


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-100-199 WELL#=199-D5-13

## VOLATILE ORGANIC COMPOUNDS

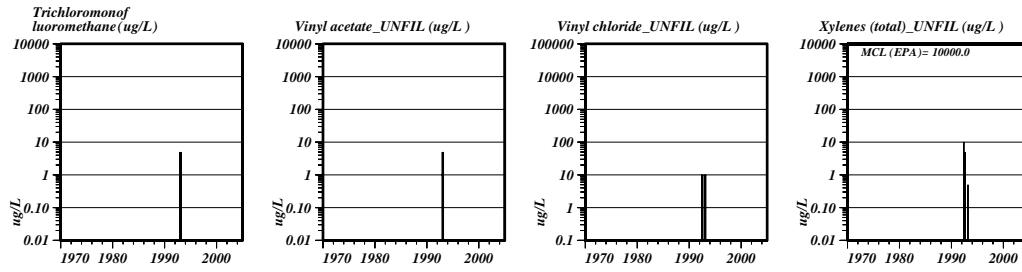


## SEMI-VOLATILE ORGANIC COMPOUNDS

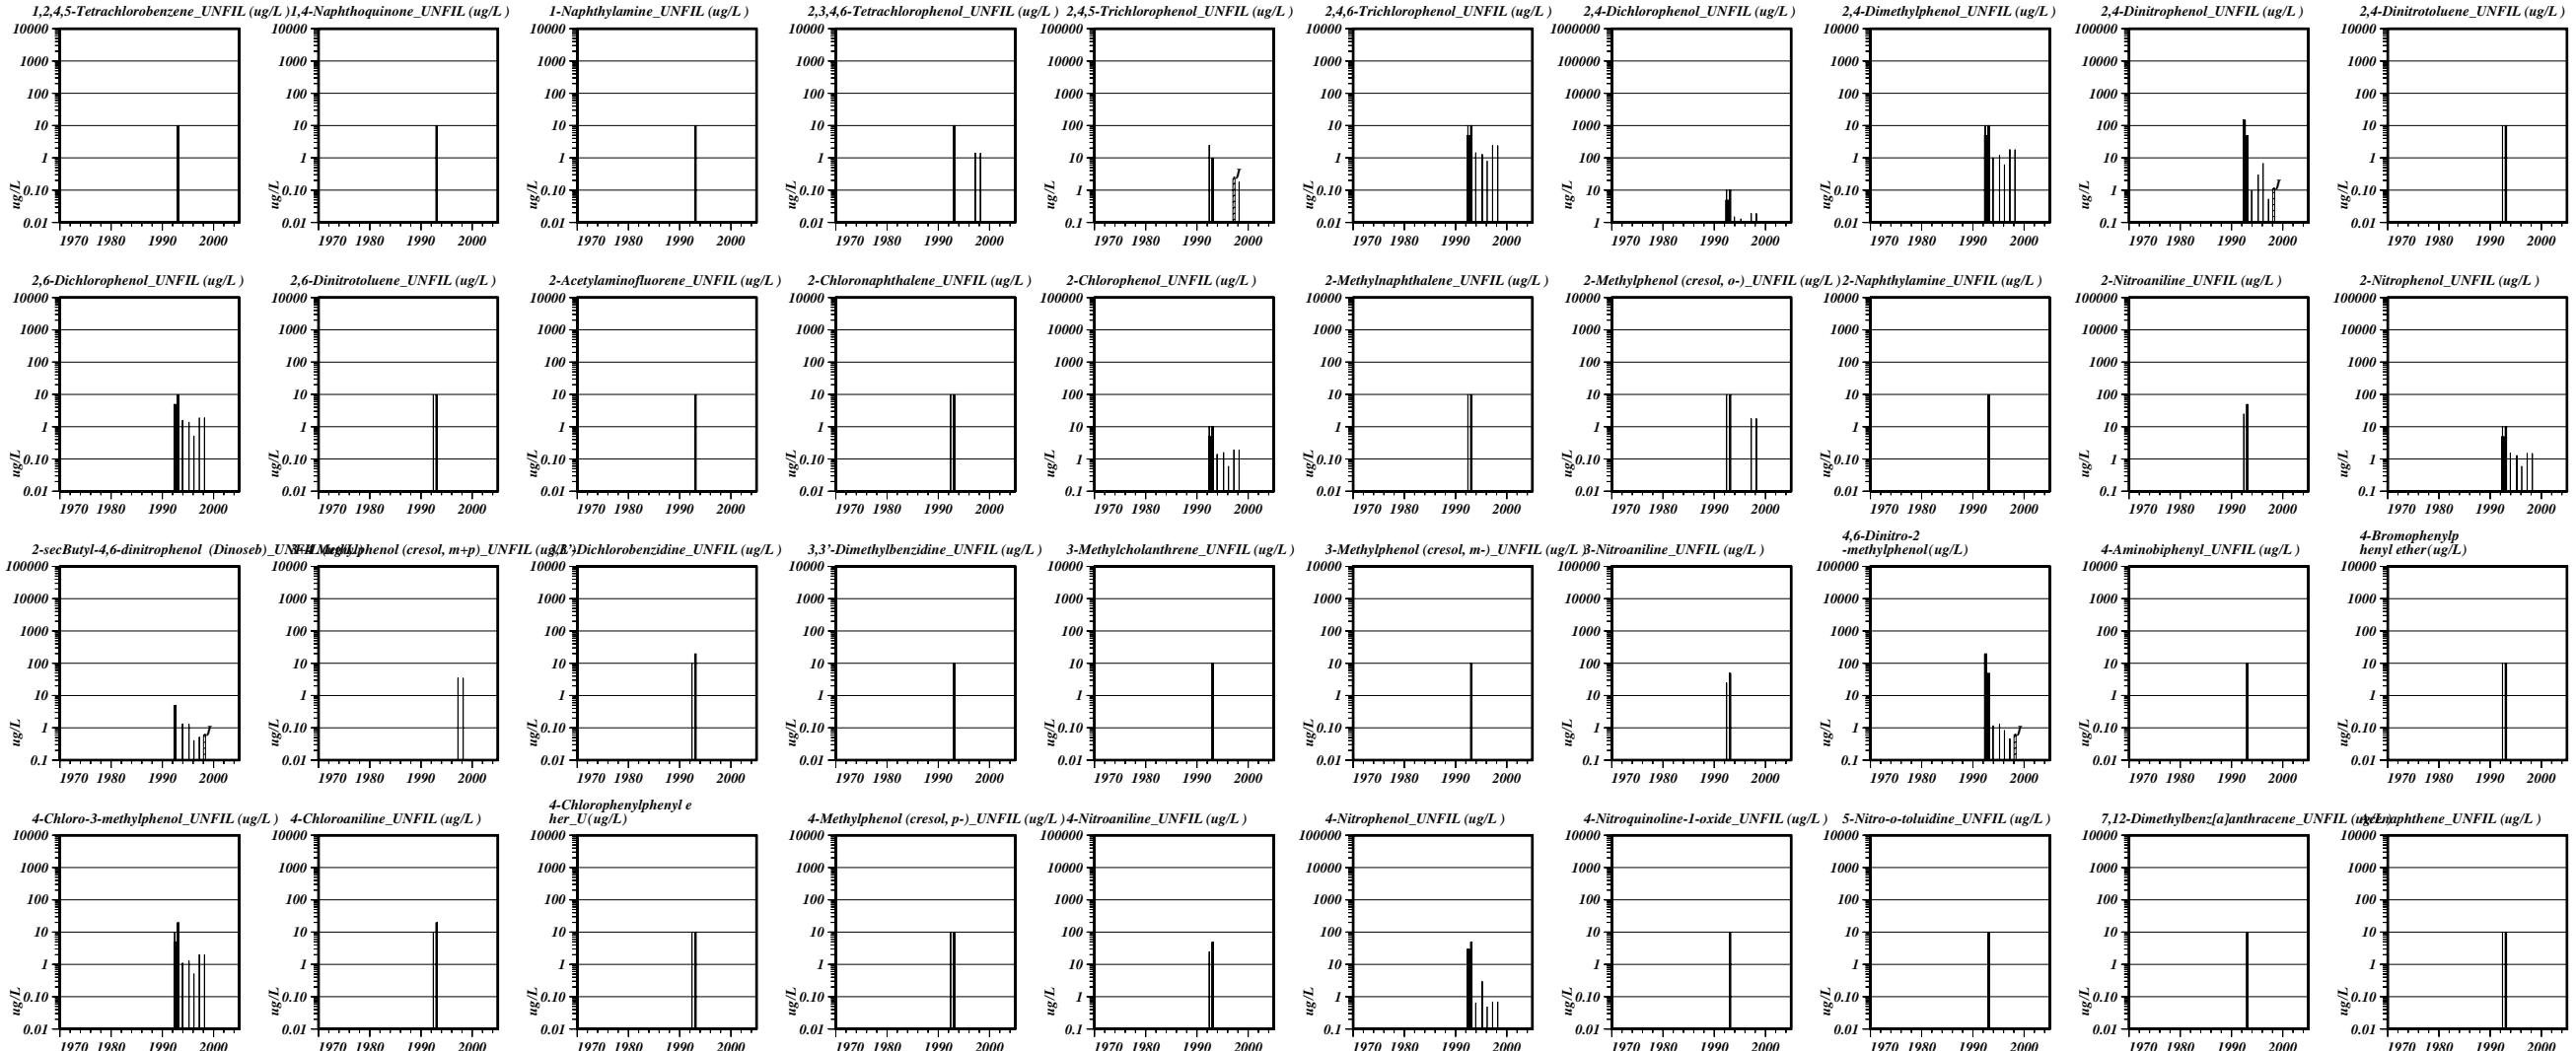

LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

## SEMI-VOLATILE ORGANIC COMPOUNDS

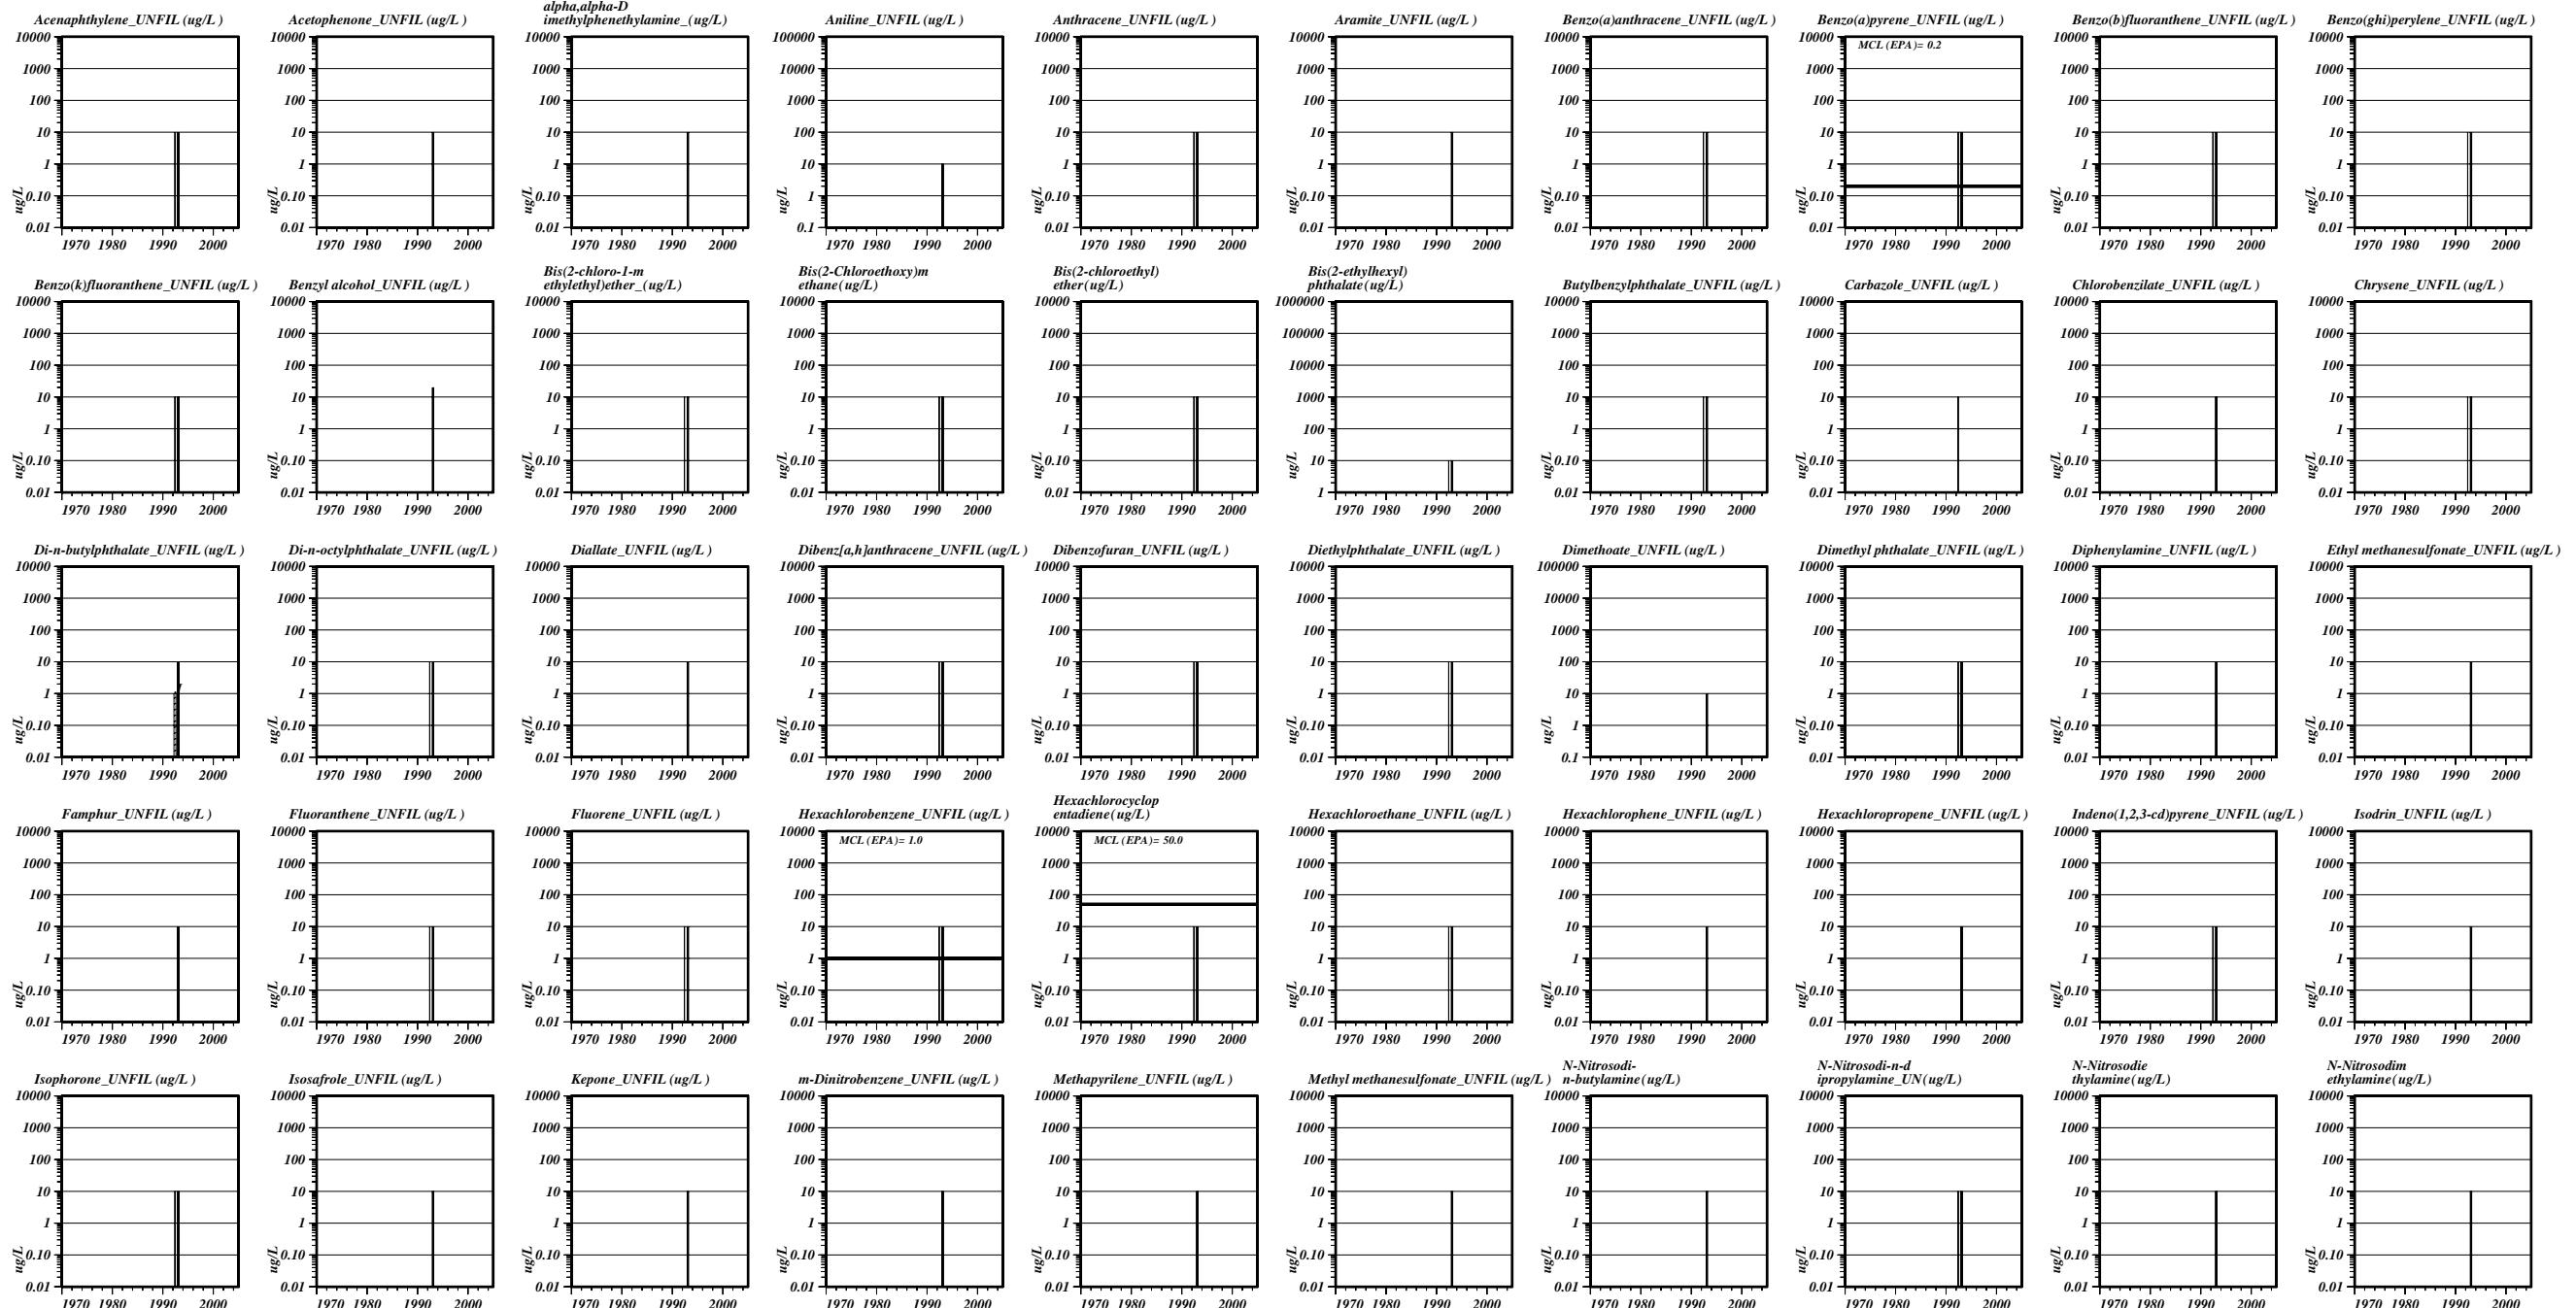


LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-100-199 WELL#=199-D5-13

## SEMI-VOLATILE ORGANIC COMPOUNDS

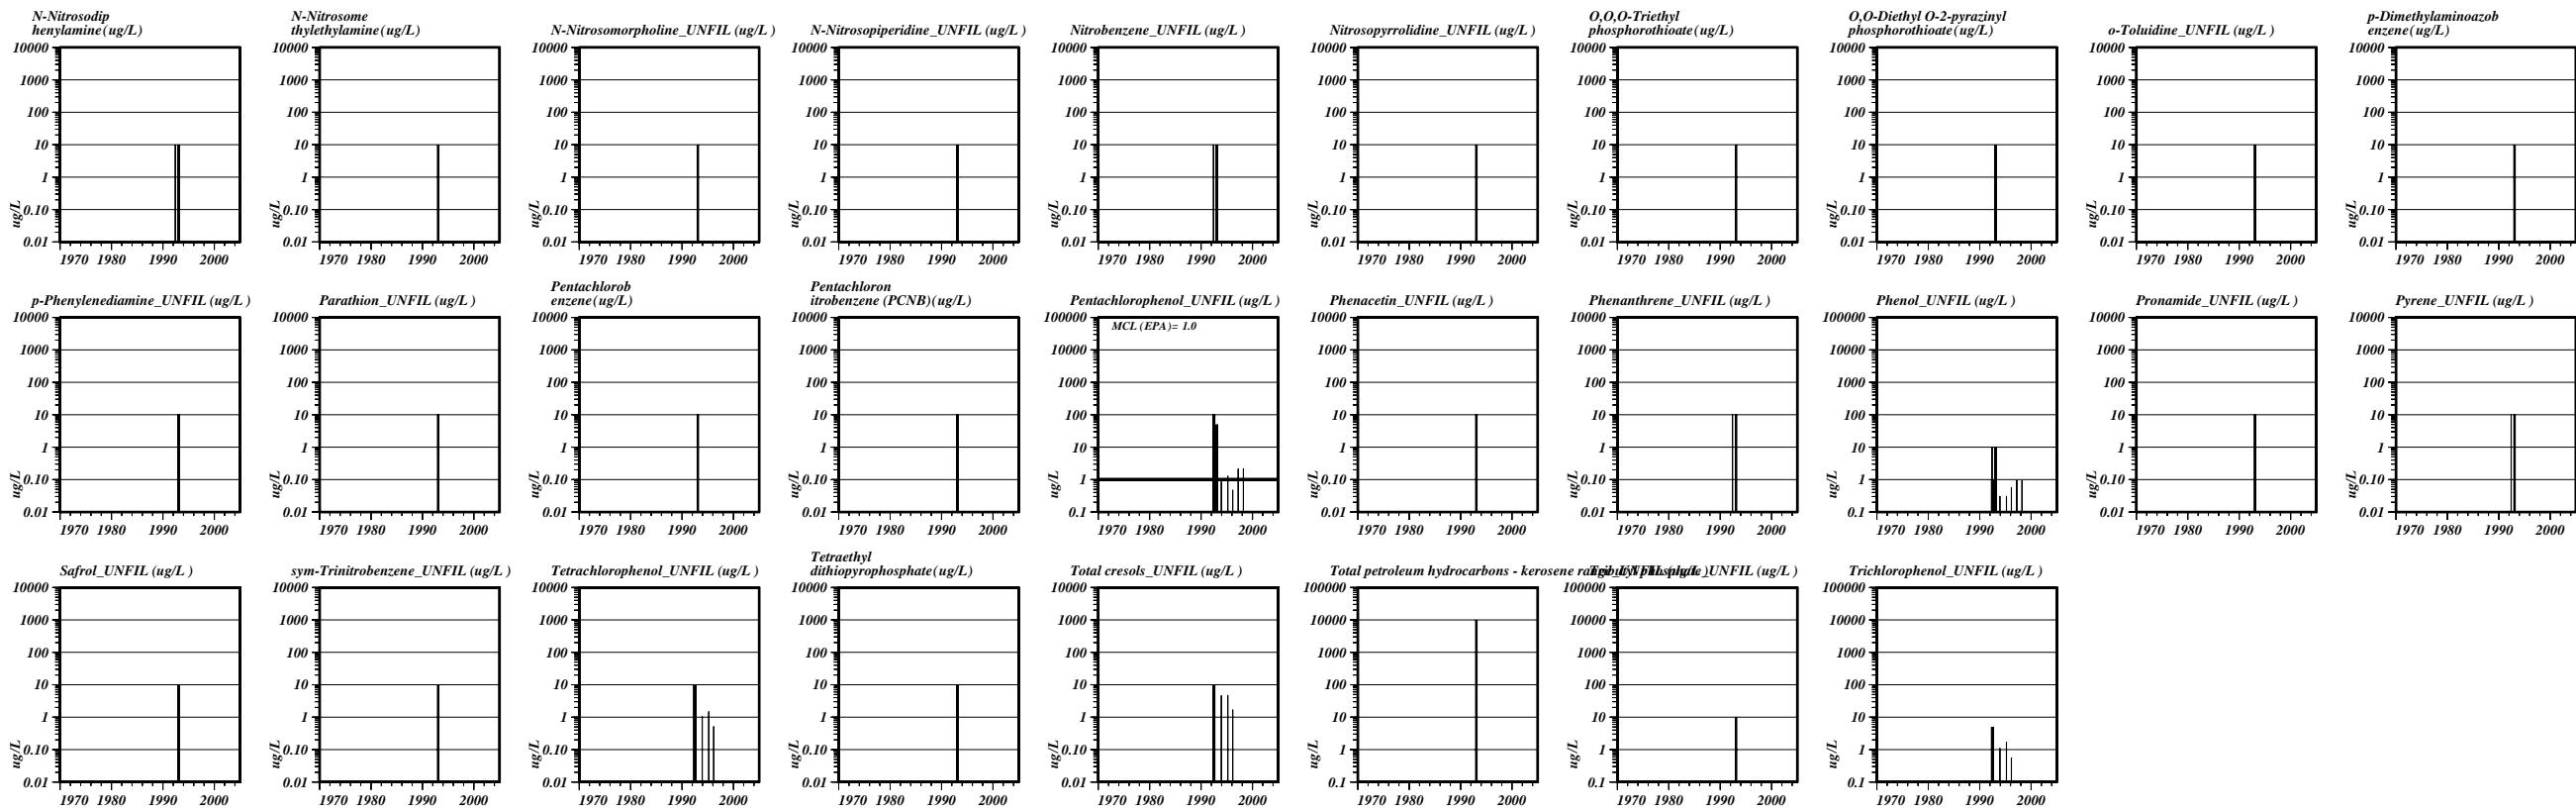

## METALS & PHYSICAL PARAMETERS

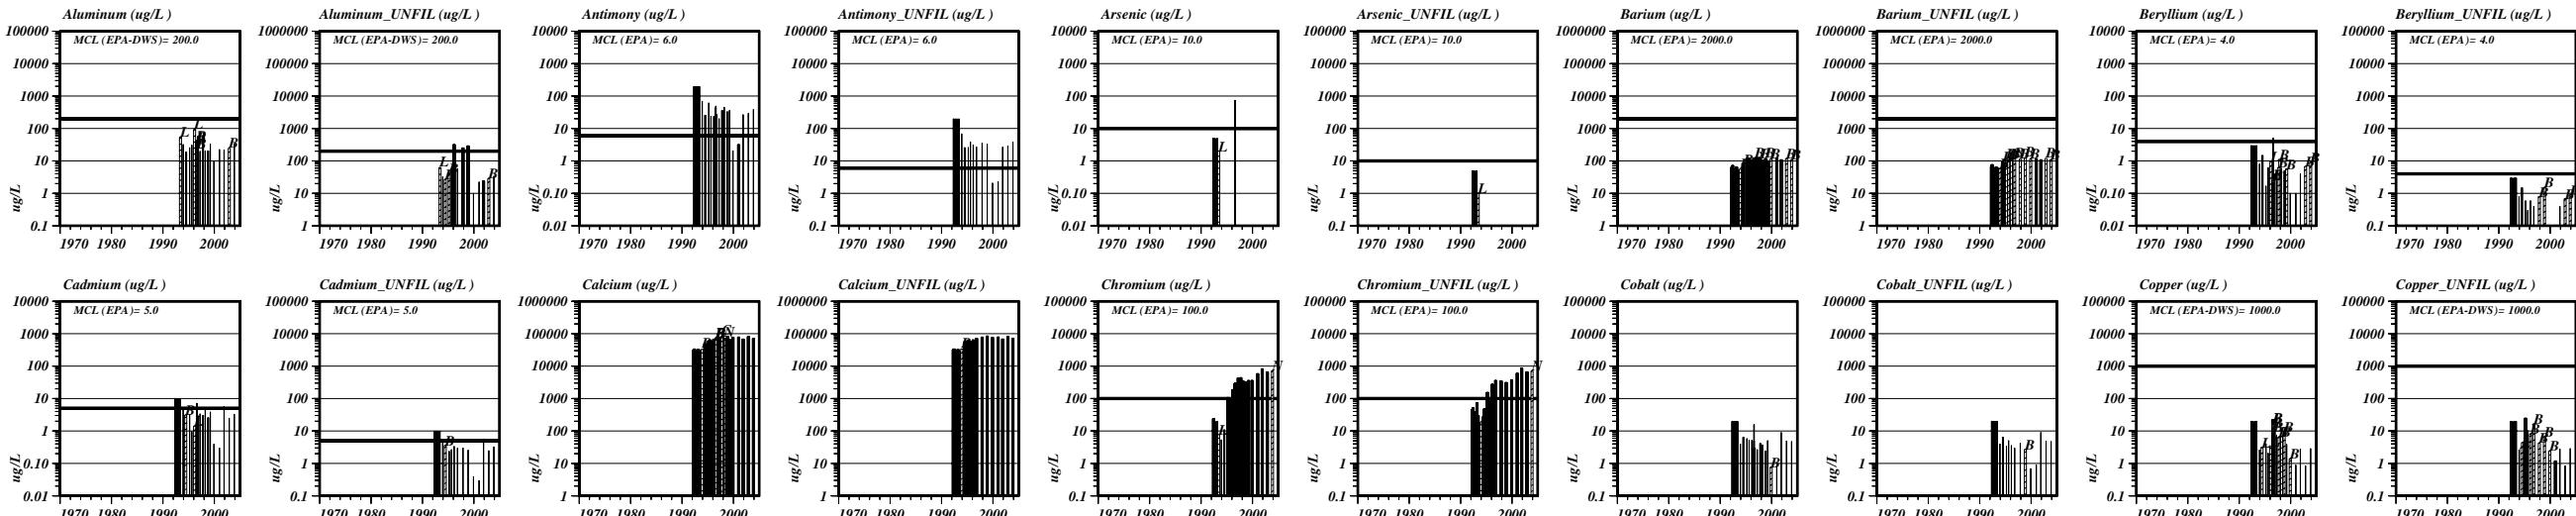


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-100-199 WELL#=199-D5-13

## METALS & PHYSICAL PARAMETERS

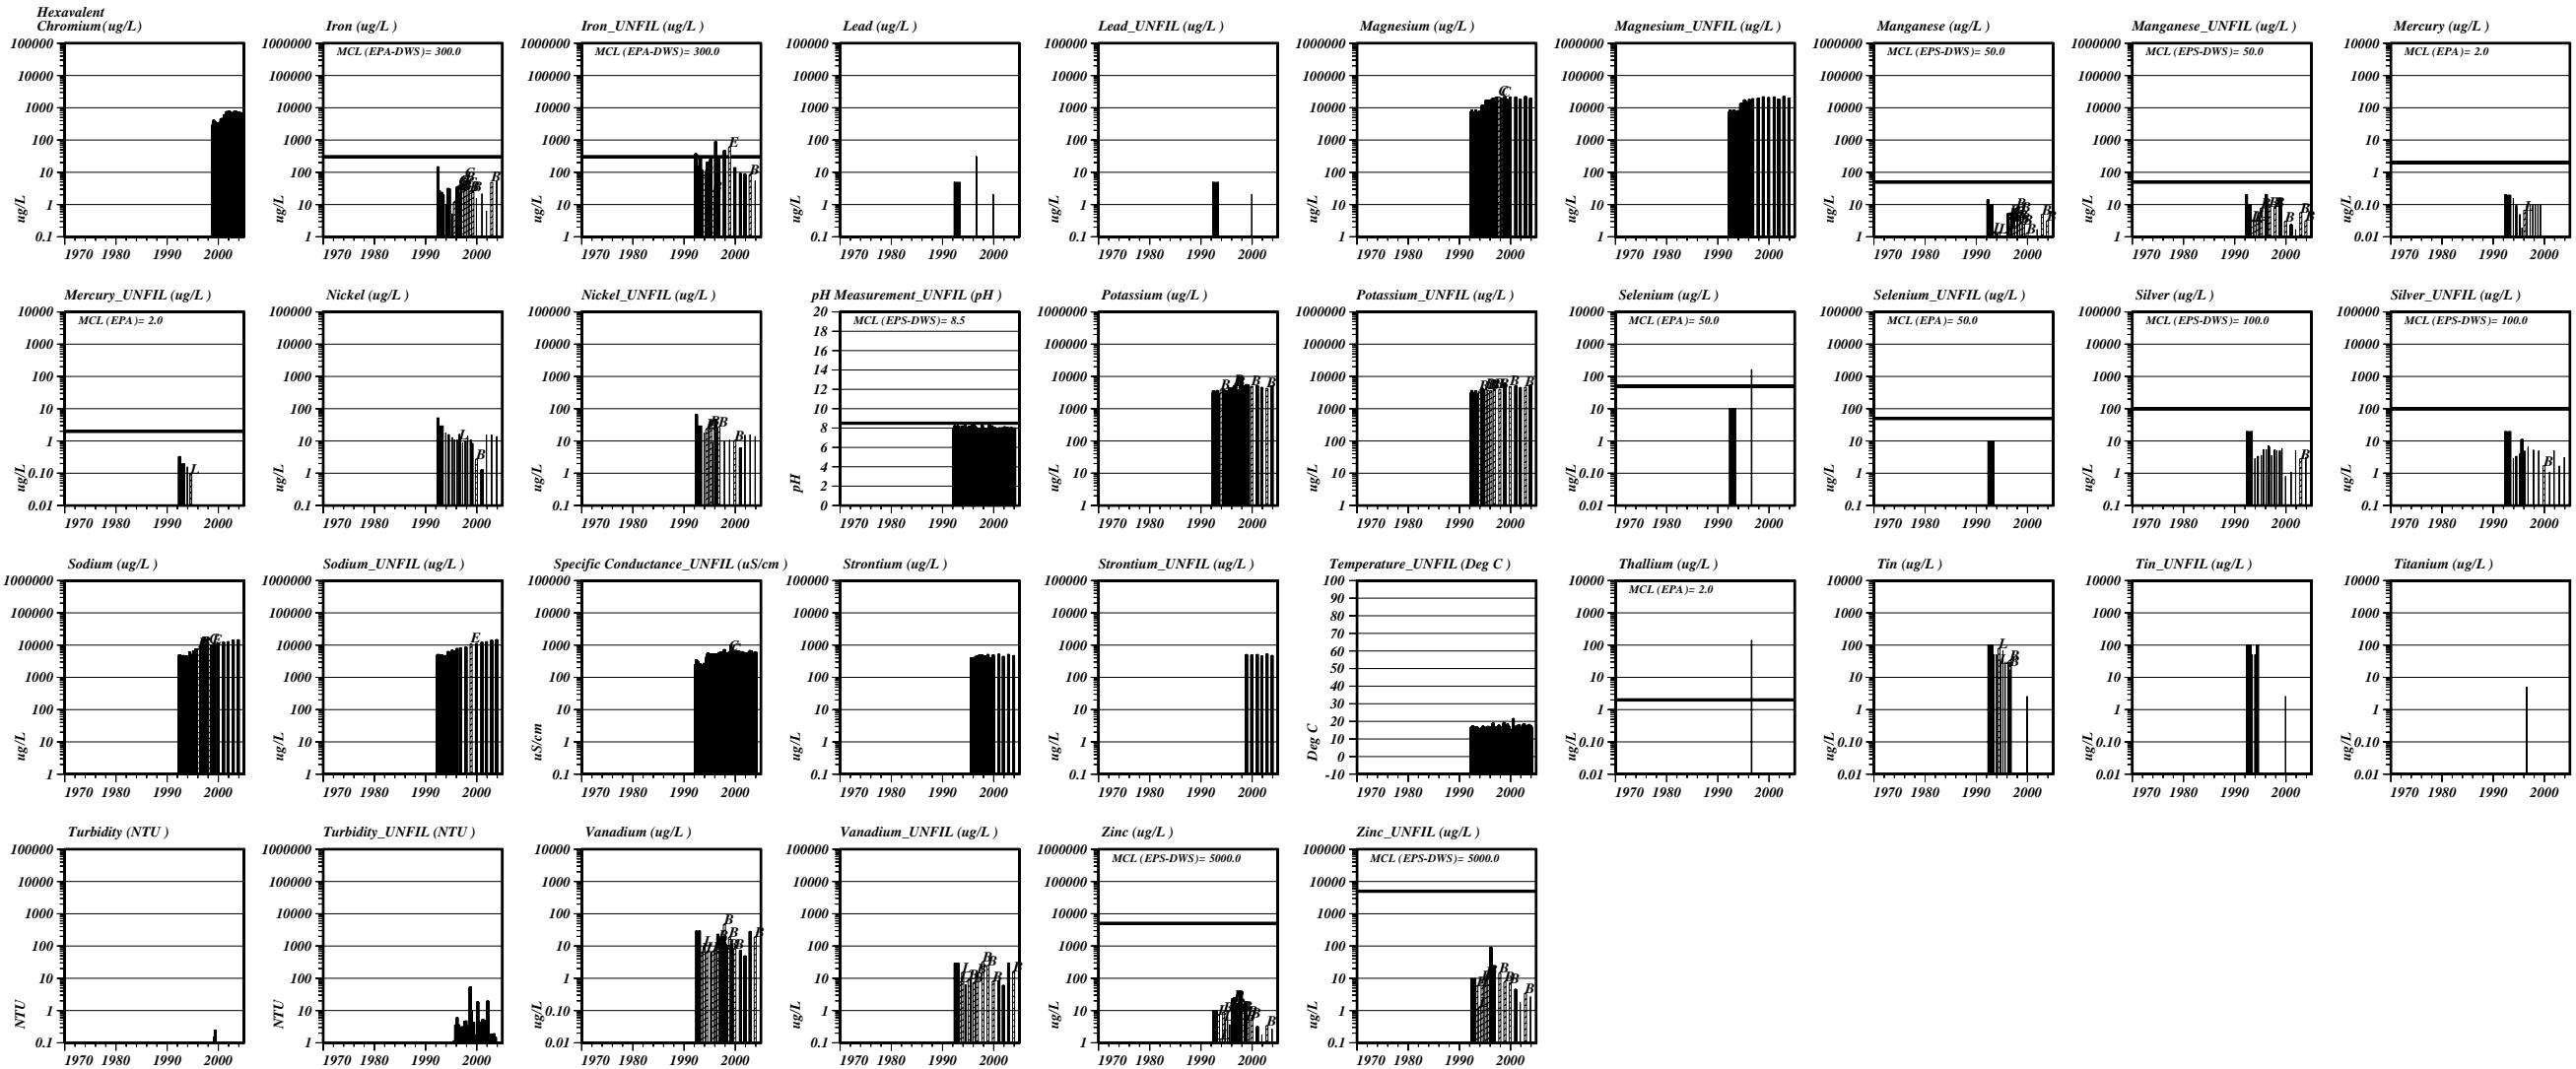

## PEST/PCB, HERB, & DIOXINS

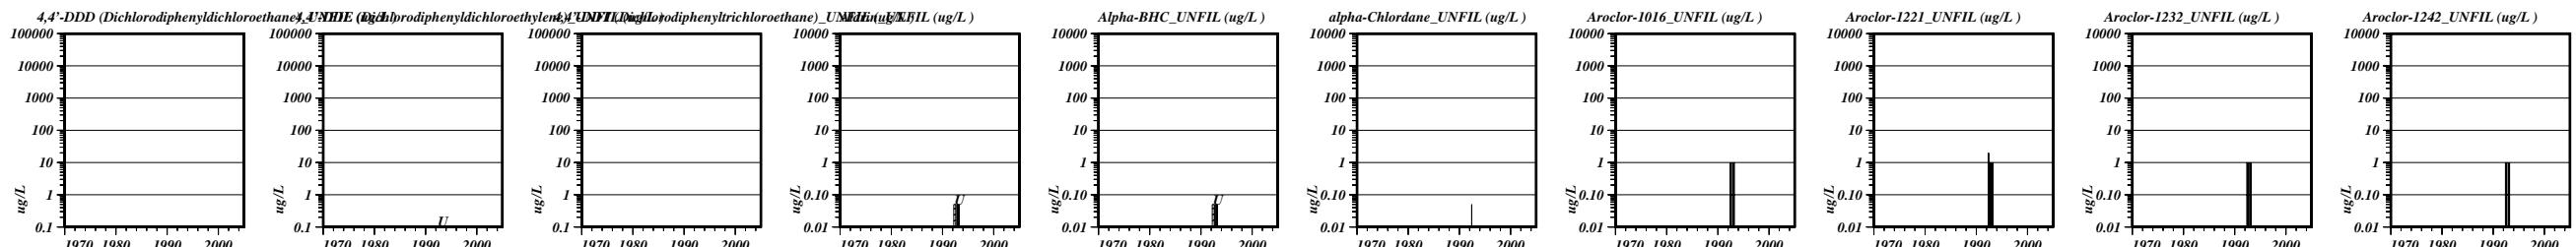


LABORATORY QUALIFIER FLAGS in HEIS are \*; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-100-199 WELL#=199-D5-13

## PEST/PCB, HERB, & DIOXINS

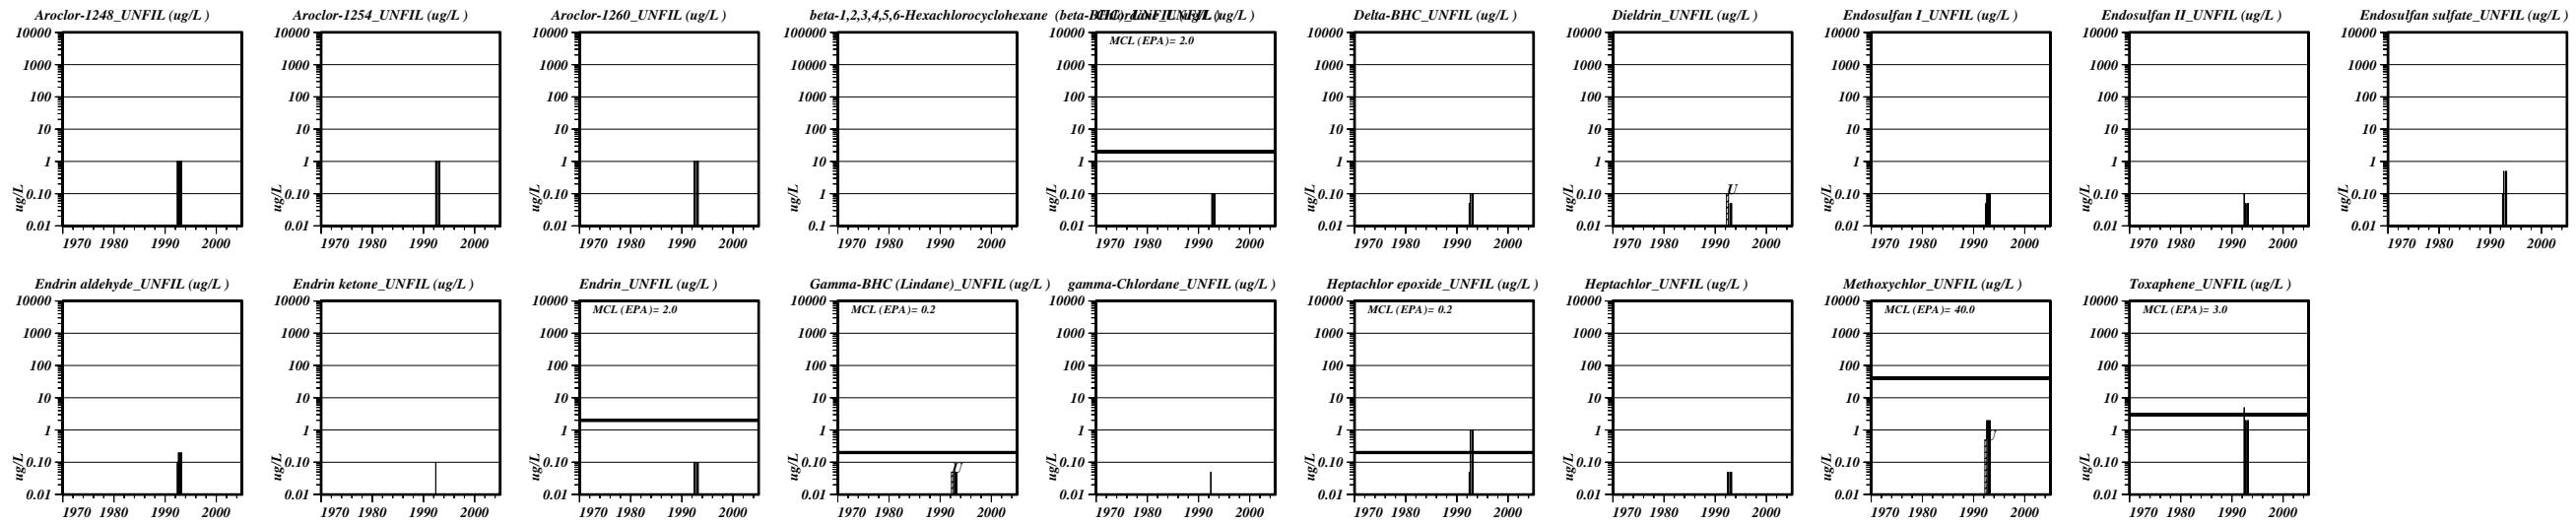

## GENCHEM & ORGANICS & GENORGANICS

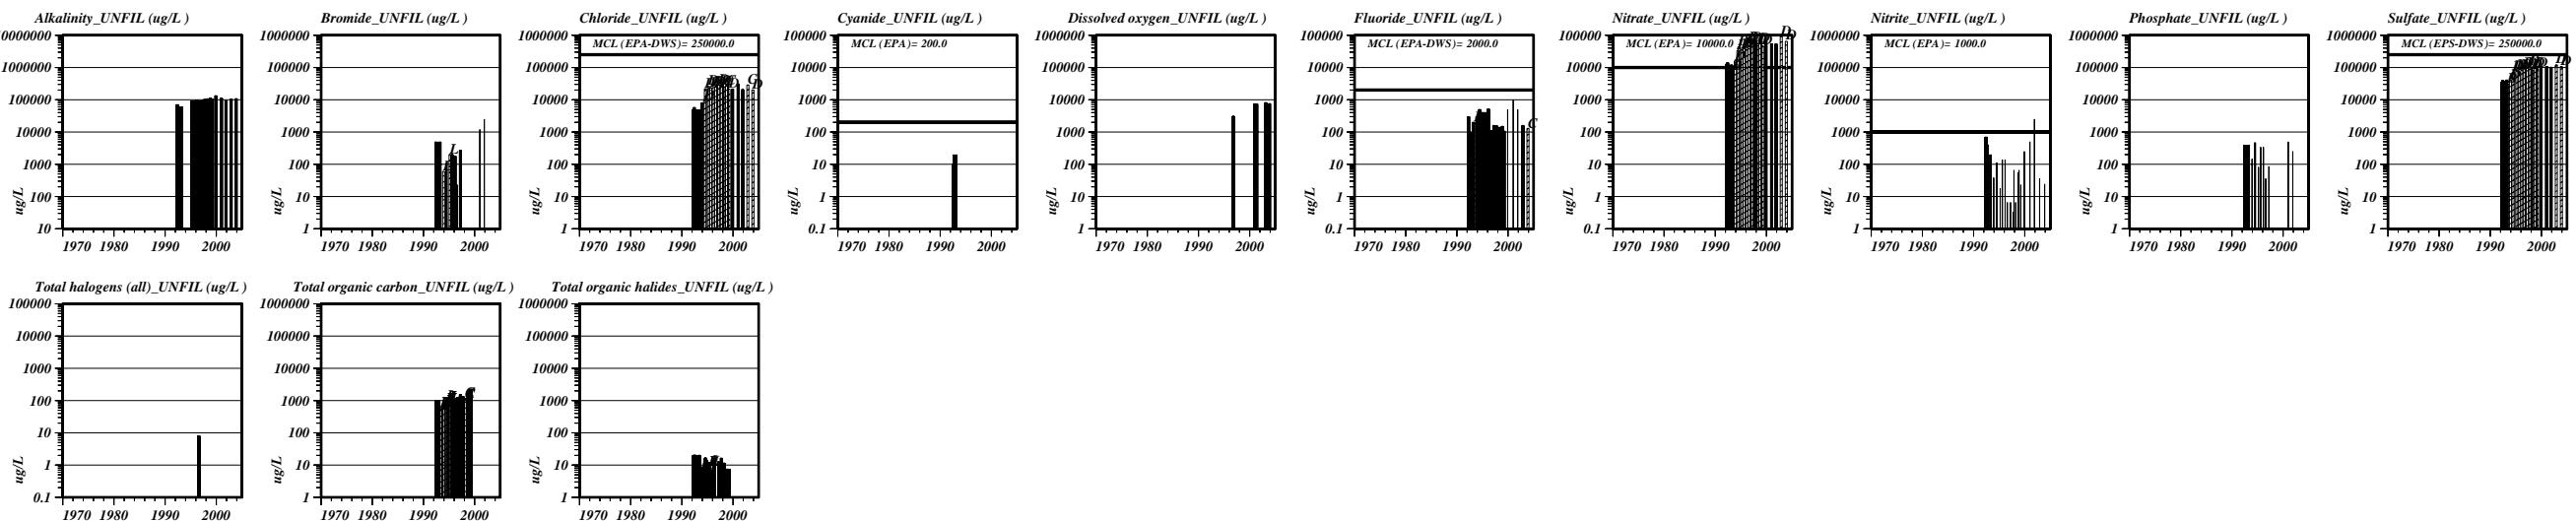

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag