






**RADIONUCLIDES**

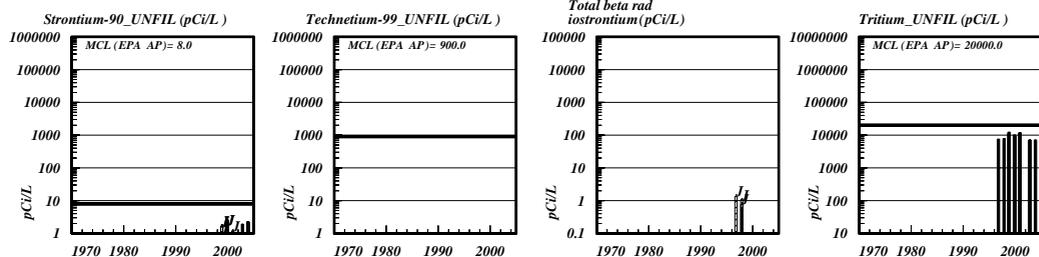

**VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE**

**SEMI-VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE**

**METALS & PHYSICAL PARAMETERS**

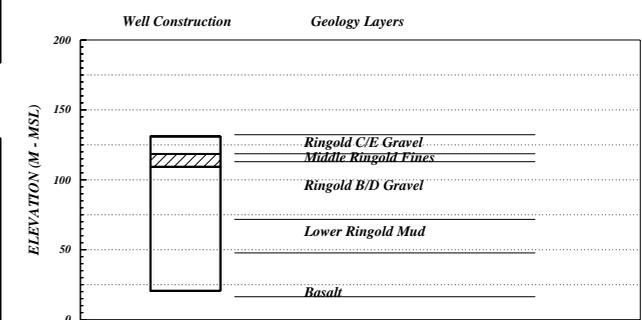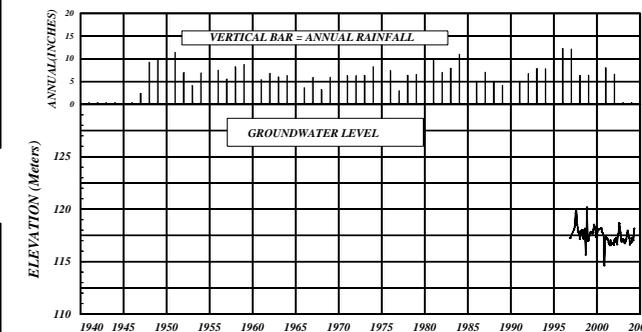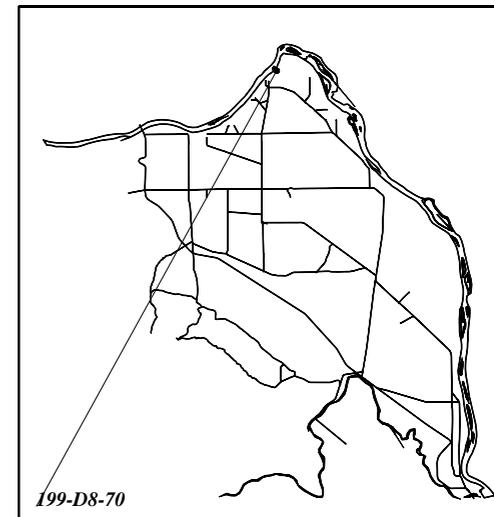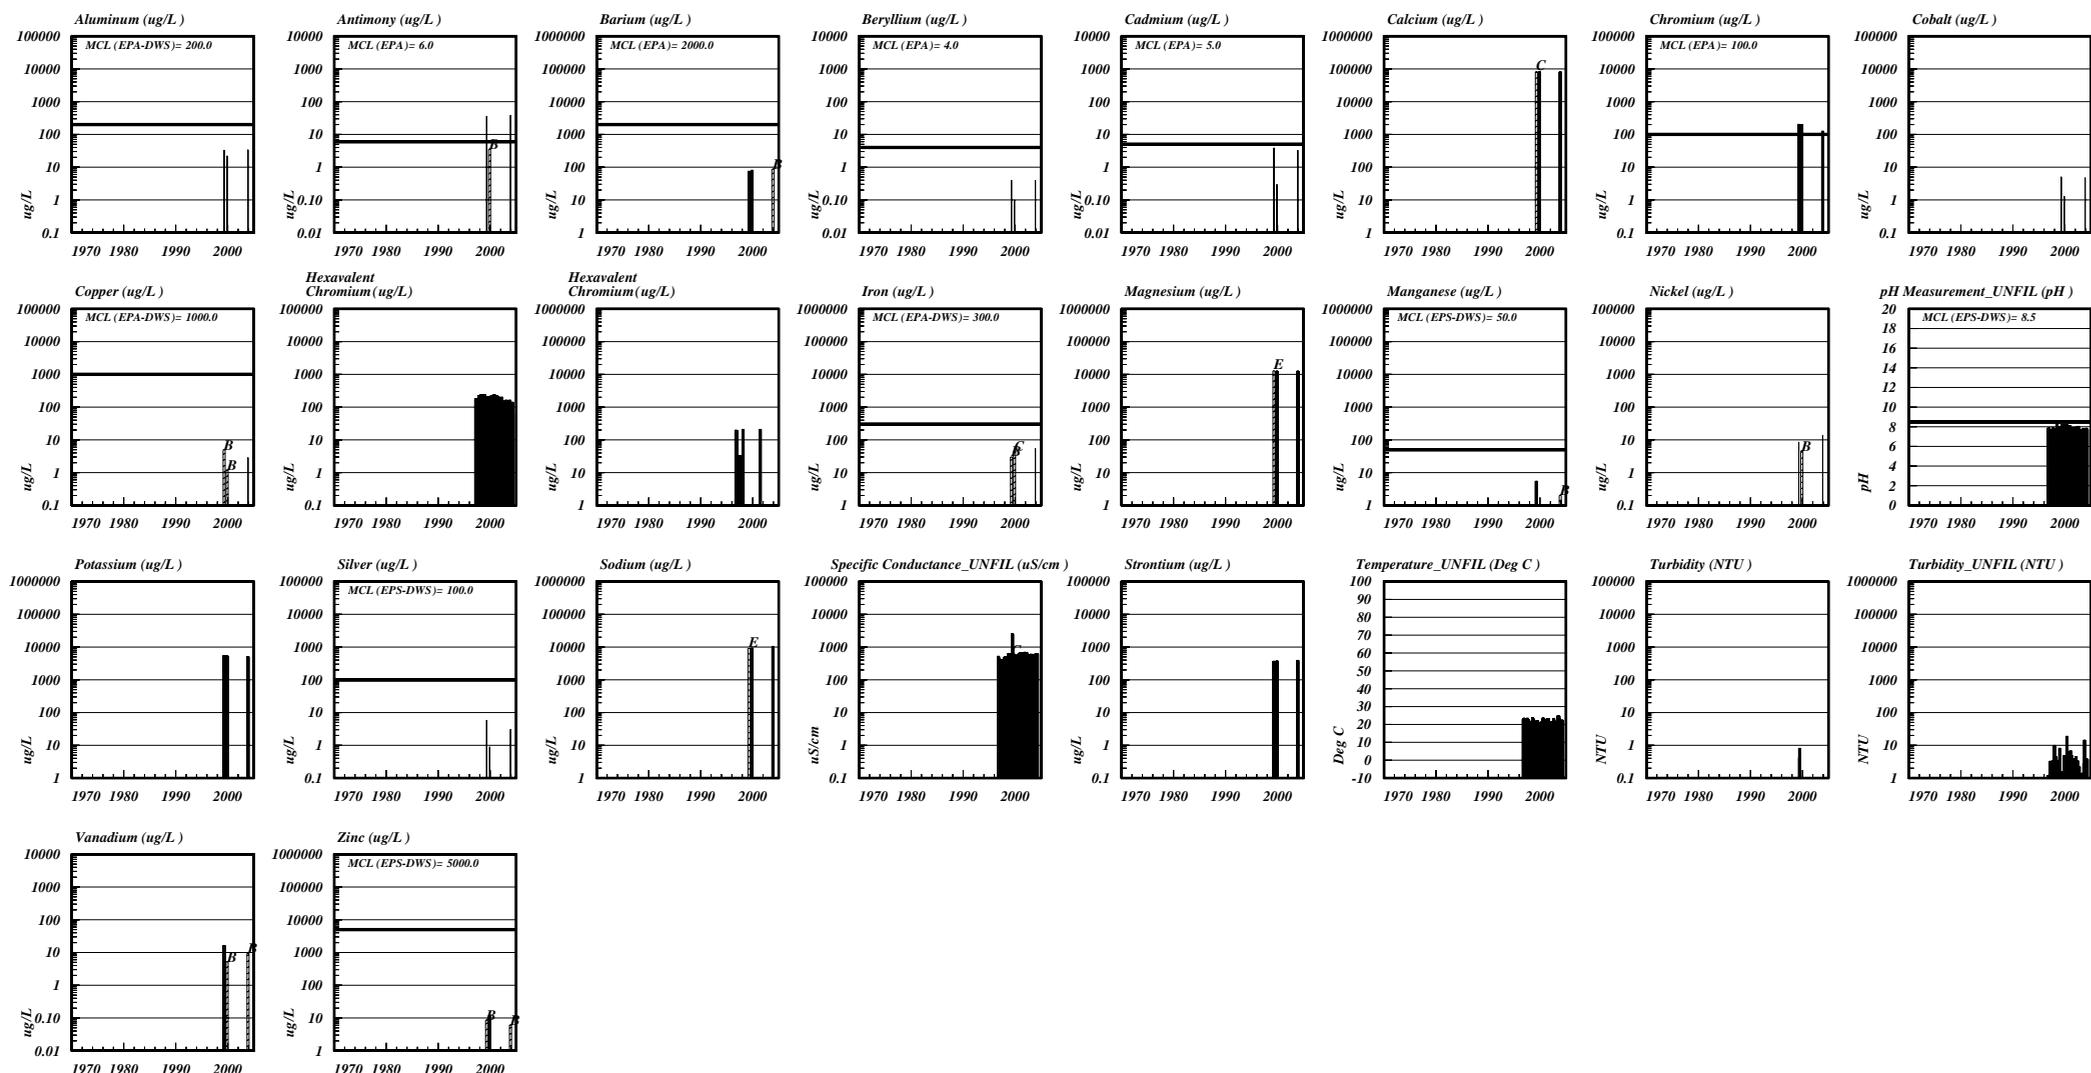


**WELLNAME=199-D8-70 WELLID=B2774**  
 Well Type=STANDARD Well purpose=GROUNDWATER  
 Owner=DOE Contact=BHI Well Adm Compliance=COMPLIANT  
 X\_coord= 573942.10 Y\_coord= 152508.70 Datum=NA83(91) Date Survey=11/11/1996  
 Elevation= 131.008 Datum=NAVD88 Date Survey=11/11/96  
 Ref\_Point\_Desc=BRASS CAP Ref\_Point\_side=NONE Contractor=ROGERS  
 Well\_Comment= PRODUCTION WELLS (PUMP & TREAT/GW MONITORING)  
 Total Number of perforation Intervals=1  
 NPERF#=1 Perf\_top= 119.45 Bot= 110.31 MCas\_size= 0.00 Perf\_cuts= 0.00  
 Total Number of Screen Intervals=1  
 Screen#=1 Screen\_diam= 6.00 in Top= 12.50 Bottom= 21.64 m Slot\_size= 0.04 in  
 Screen\_material=Stainless Steel

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value;L=Value between IDL and CRQL (estimated);T=Tentatively identified compound;  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit;THIN BARS=Value Below Detection Limit;HATCHED BARS=Value With Data Qualifier Flag

PEST/PCB, HERB, & DIOXINS NO DATA AVAILABLE

GENCHEM & ORGANICS & GENORGANICS

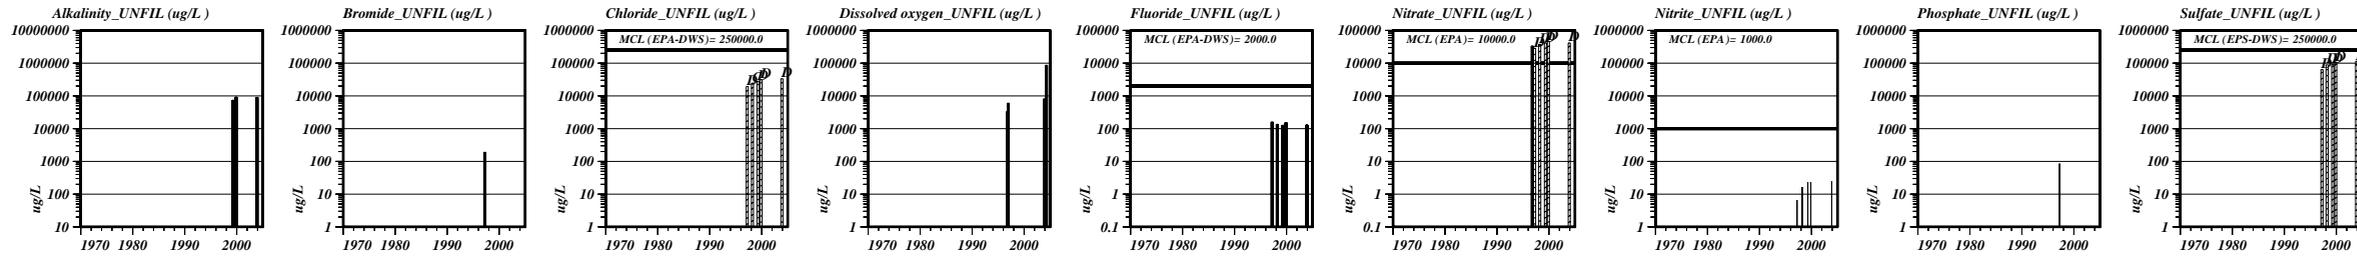

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag