
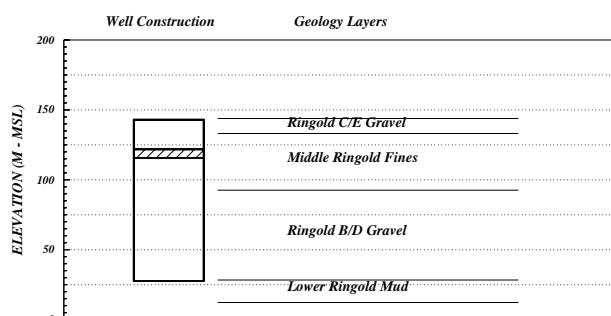
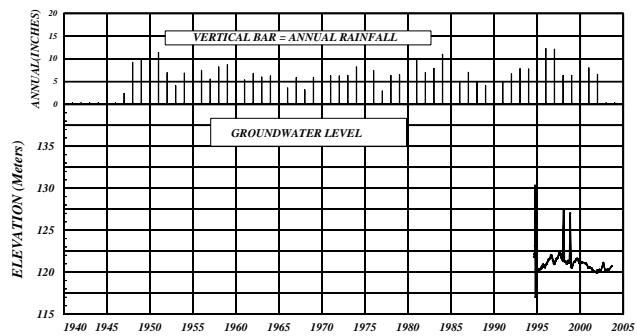
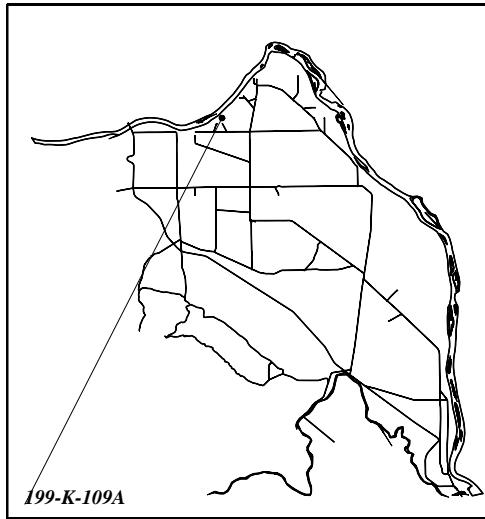


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-100-199 WELL#=199-K-109A


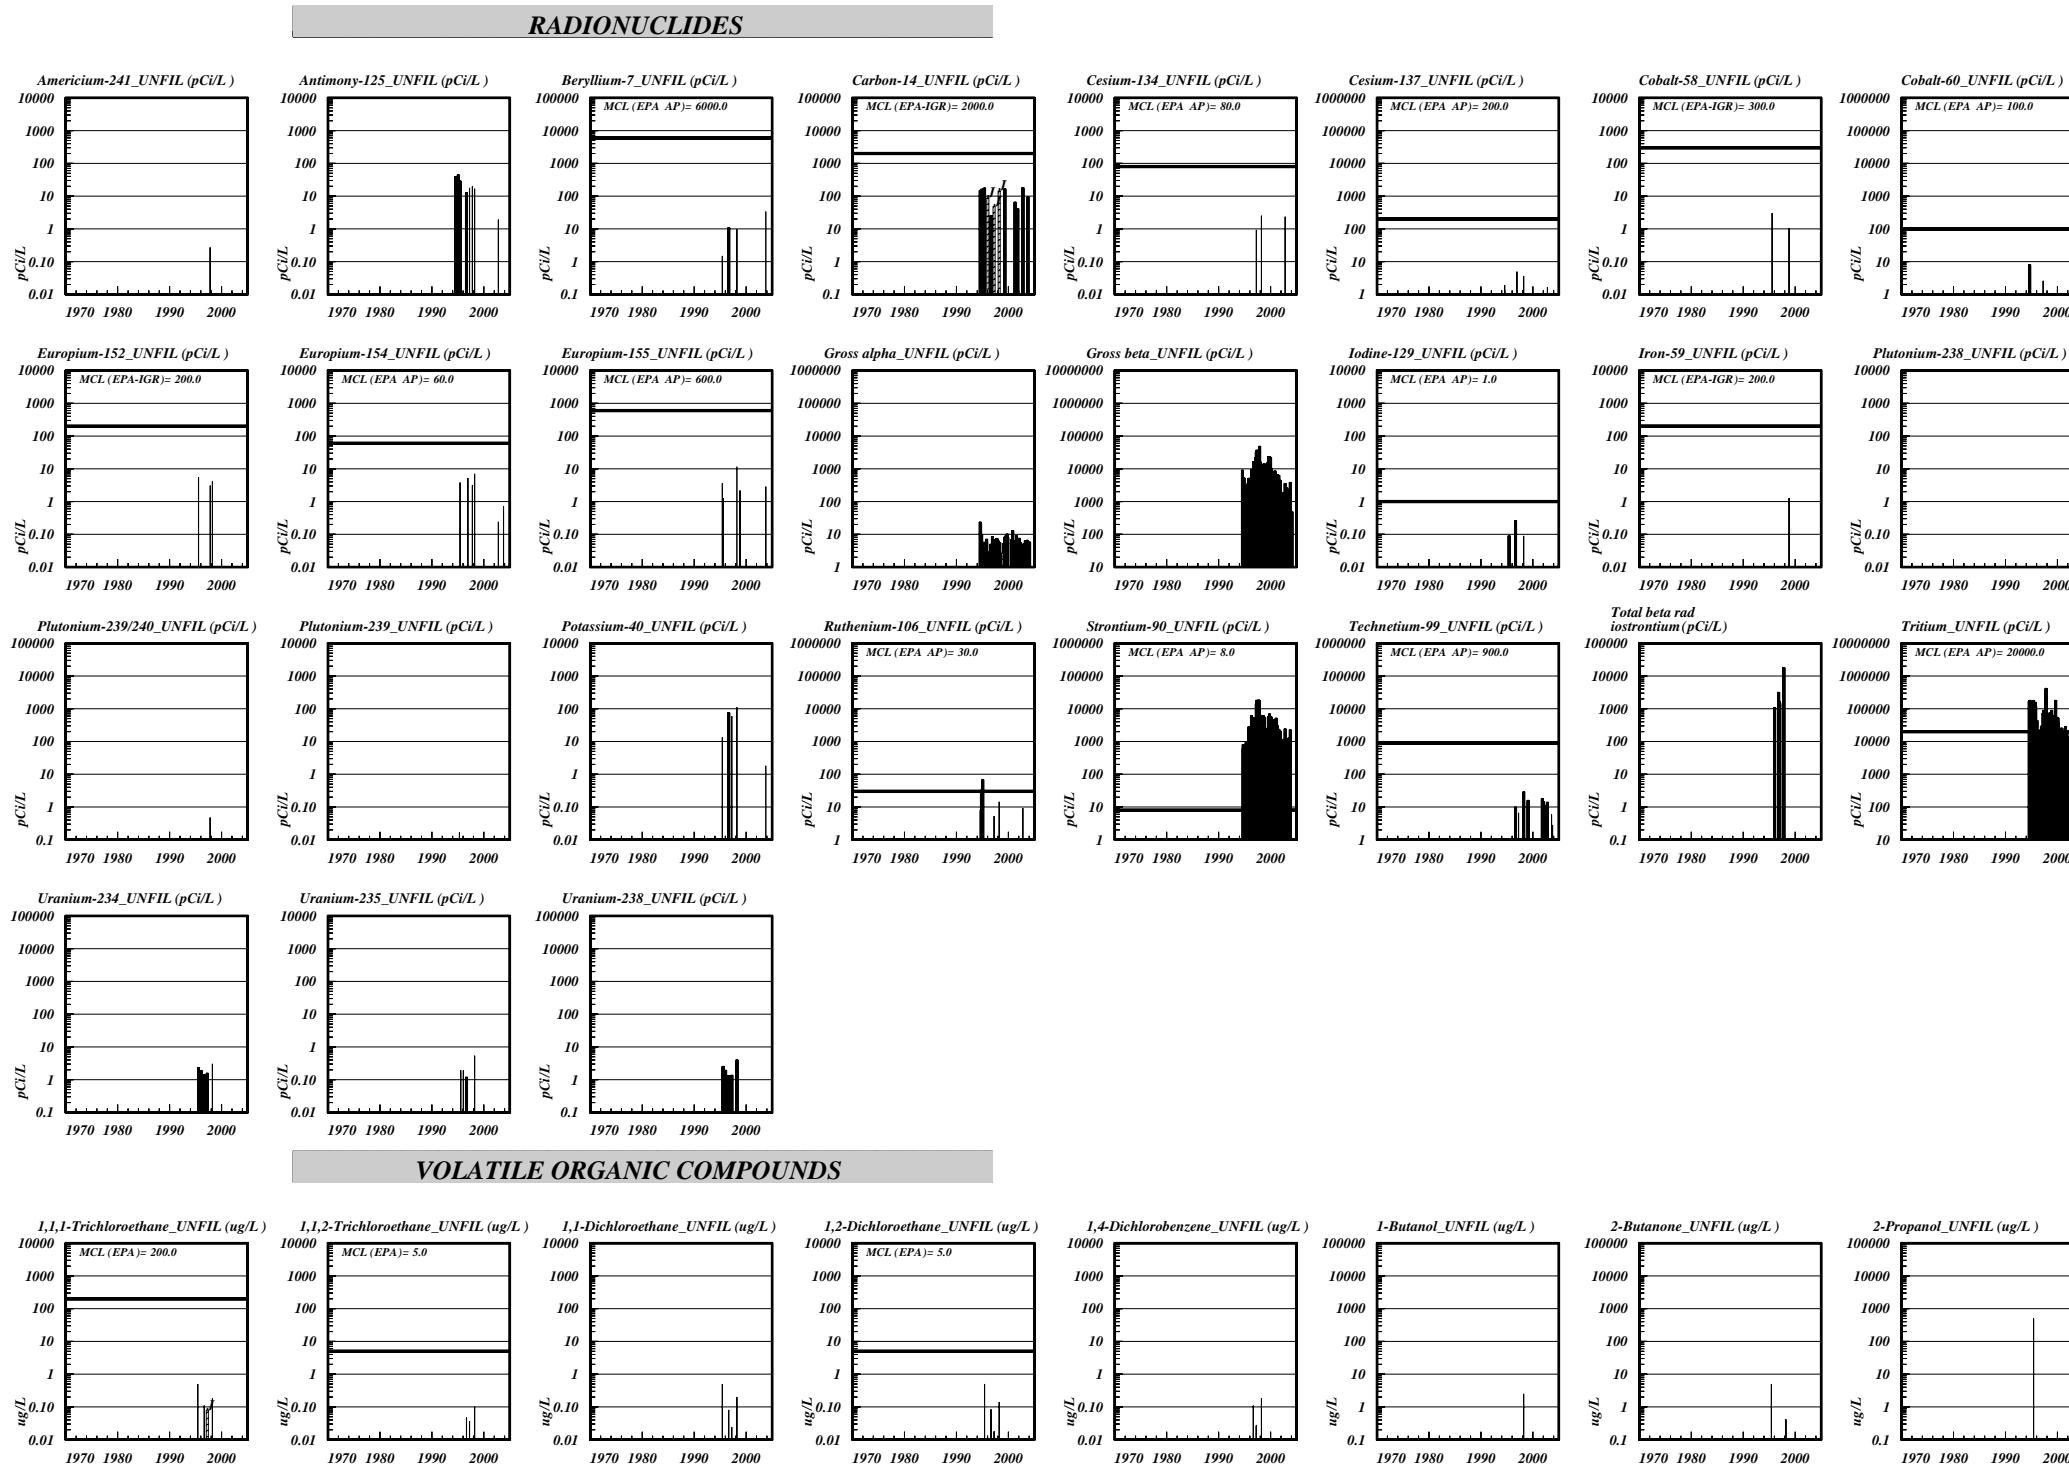


**WELLNAME=199-K-109A WELLID=A9828**

Well Type=STANDARD Well purpose=GROUNDWATER  
 Owner=DOE Contact=BHI Well Adm Compliance=COMPLIANT  
 X\_coor= 569122.20 Y\_coor= 146748.50 Datum=NAD83(91) Date Survey=10/20/1994  
 Elevation= 143.003 Datum=NAVD88 Date Survey=10/20/94  
 Ref\_Point\_Desc=TOP OF CASING Ref\_Point\_side=NONE Contractor=KEH  
 Total Number of perforation Intervals=1  
 NPERF#=1 Perf\_top= 121.47 Bot= 115.38 MCas\_size= 0.00 Perf\_cuts= 0.00  
 Total Number of Screen Intervals=1  
 Screen#=1 Screen\_diam= 4.00 in Top= 21.21 Bottom= 27.37 m Slot\_size= 0.02 in  
 Screen\_material=Stainless Steel

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

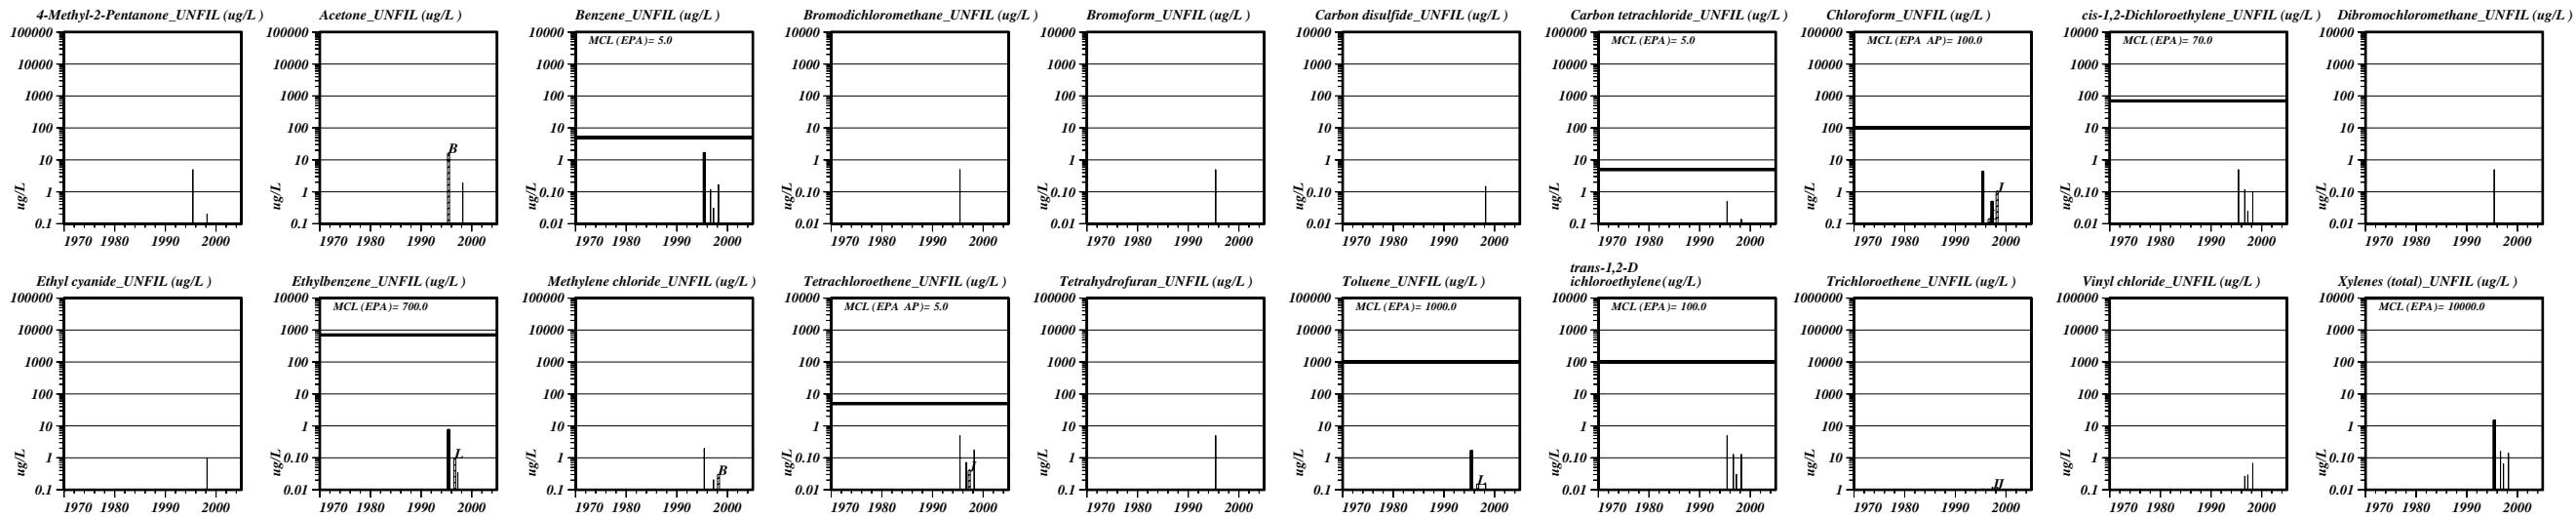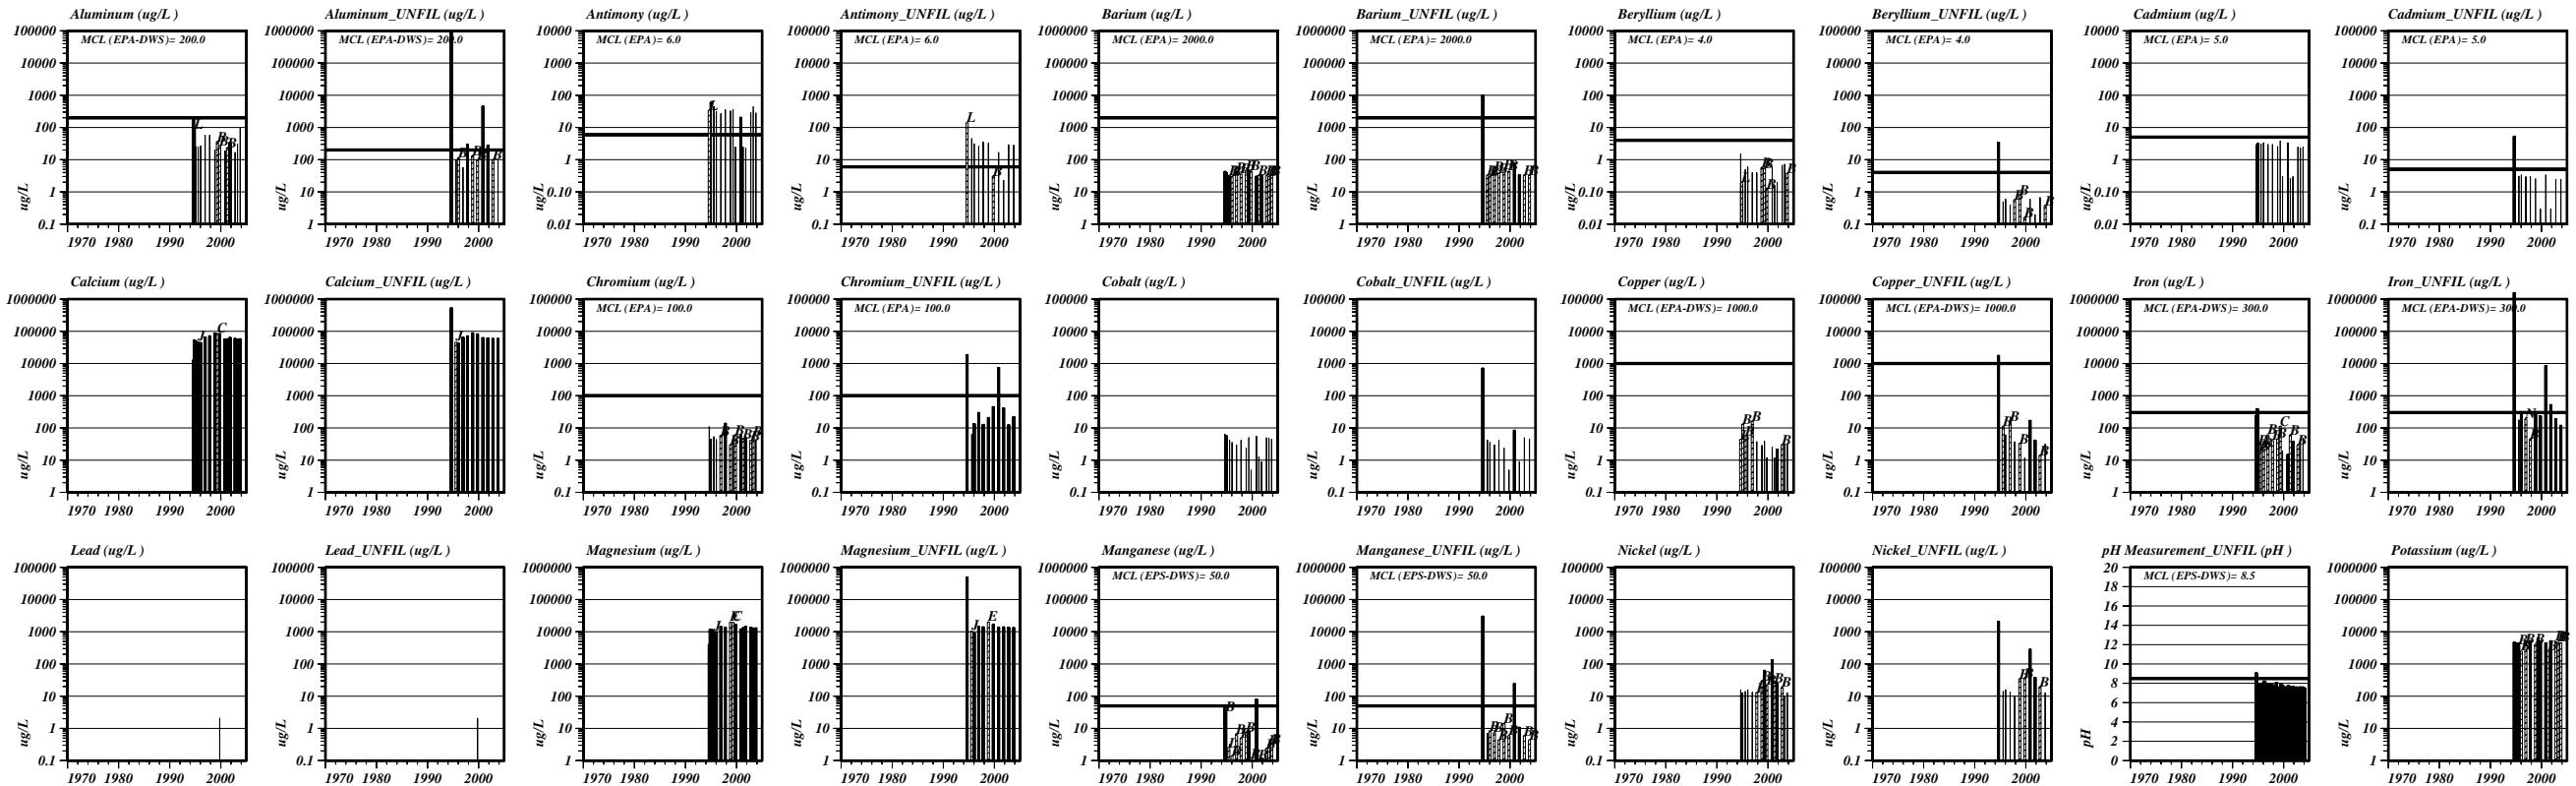**VOLATILE ORGANIC COMPOUNDS****SEMI-VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE****METALS & PHYSICAL PARAMETERS**


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-100-199 WELL#=199-K-109A


## METALS & PHYSICAL PARAMETERS

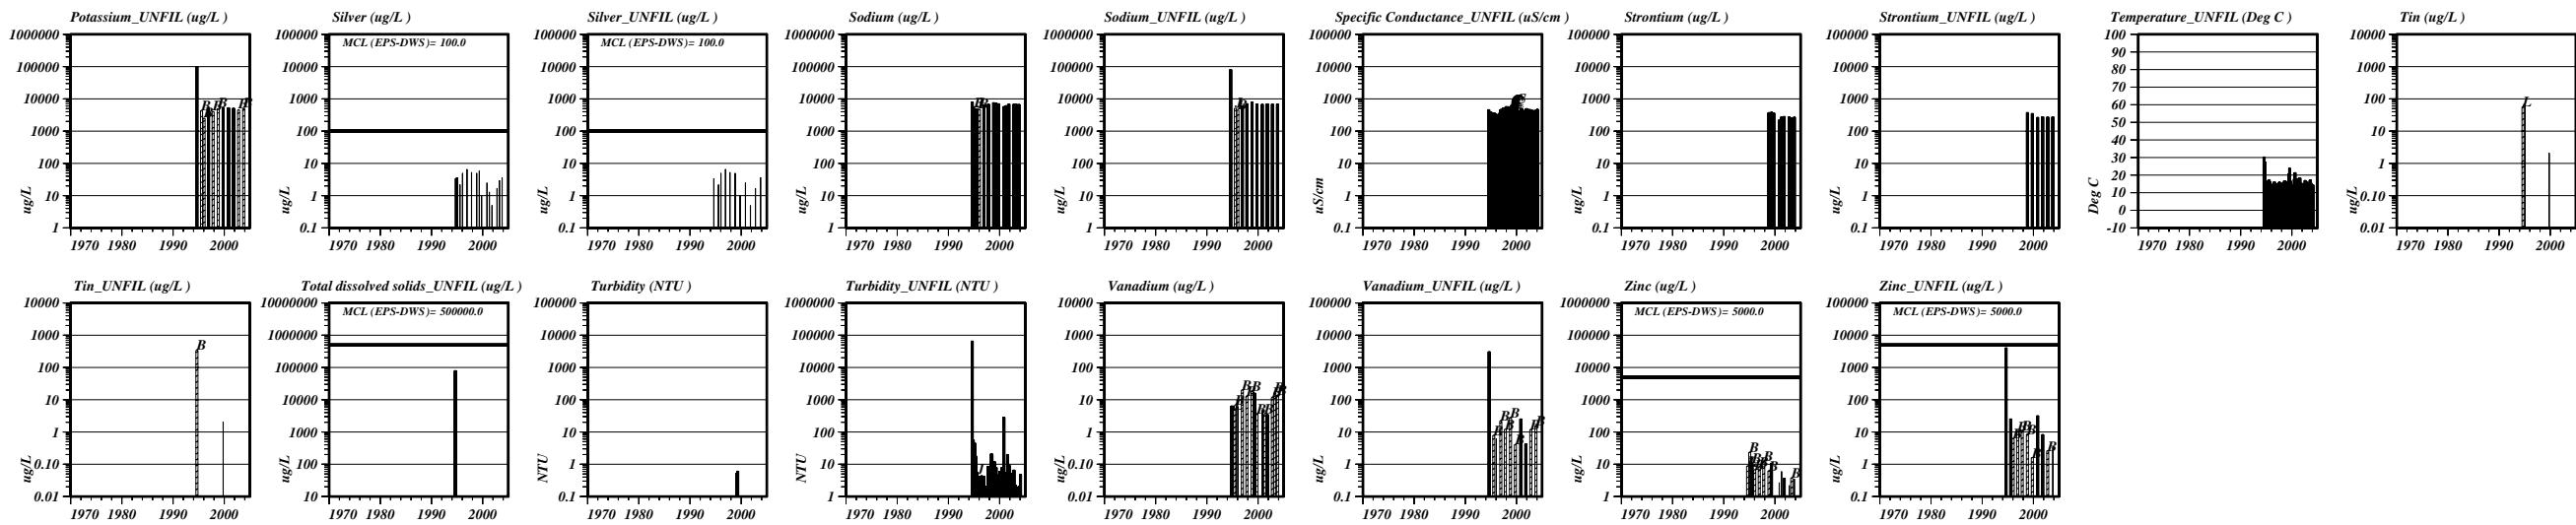

## PEST/PCB, HERB, & DIOXINS

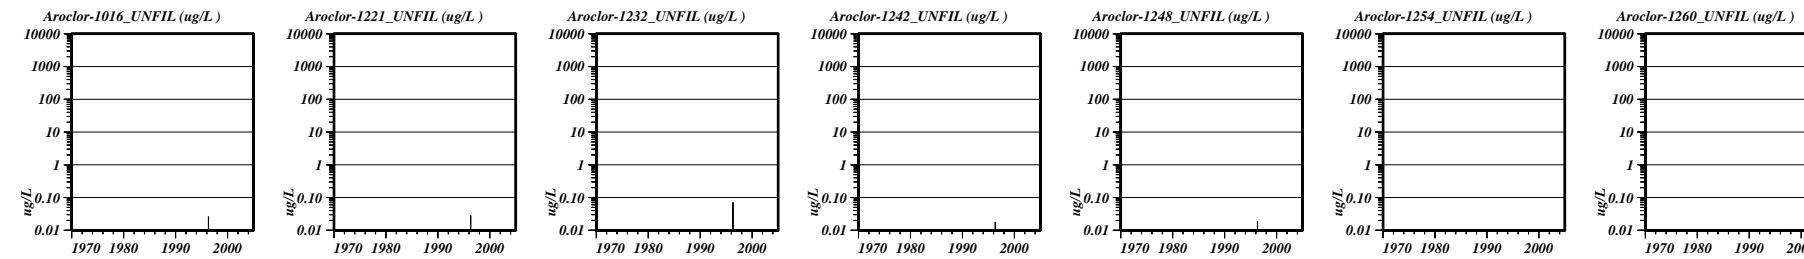

## GENCHEM & ORGANICS & GENORGANICS

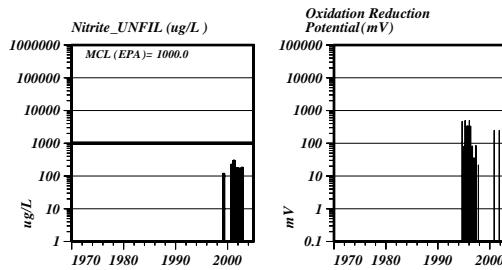

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag