

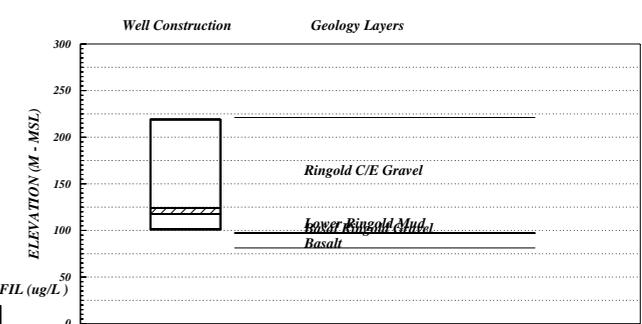
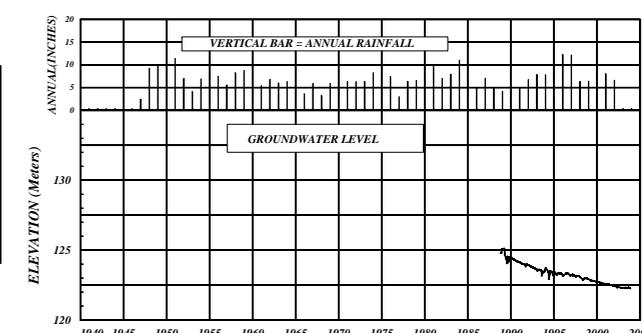
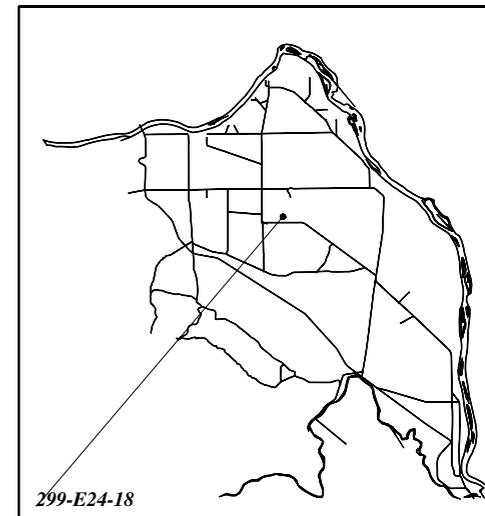


**RADIONUCLIDES**

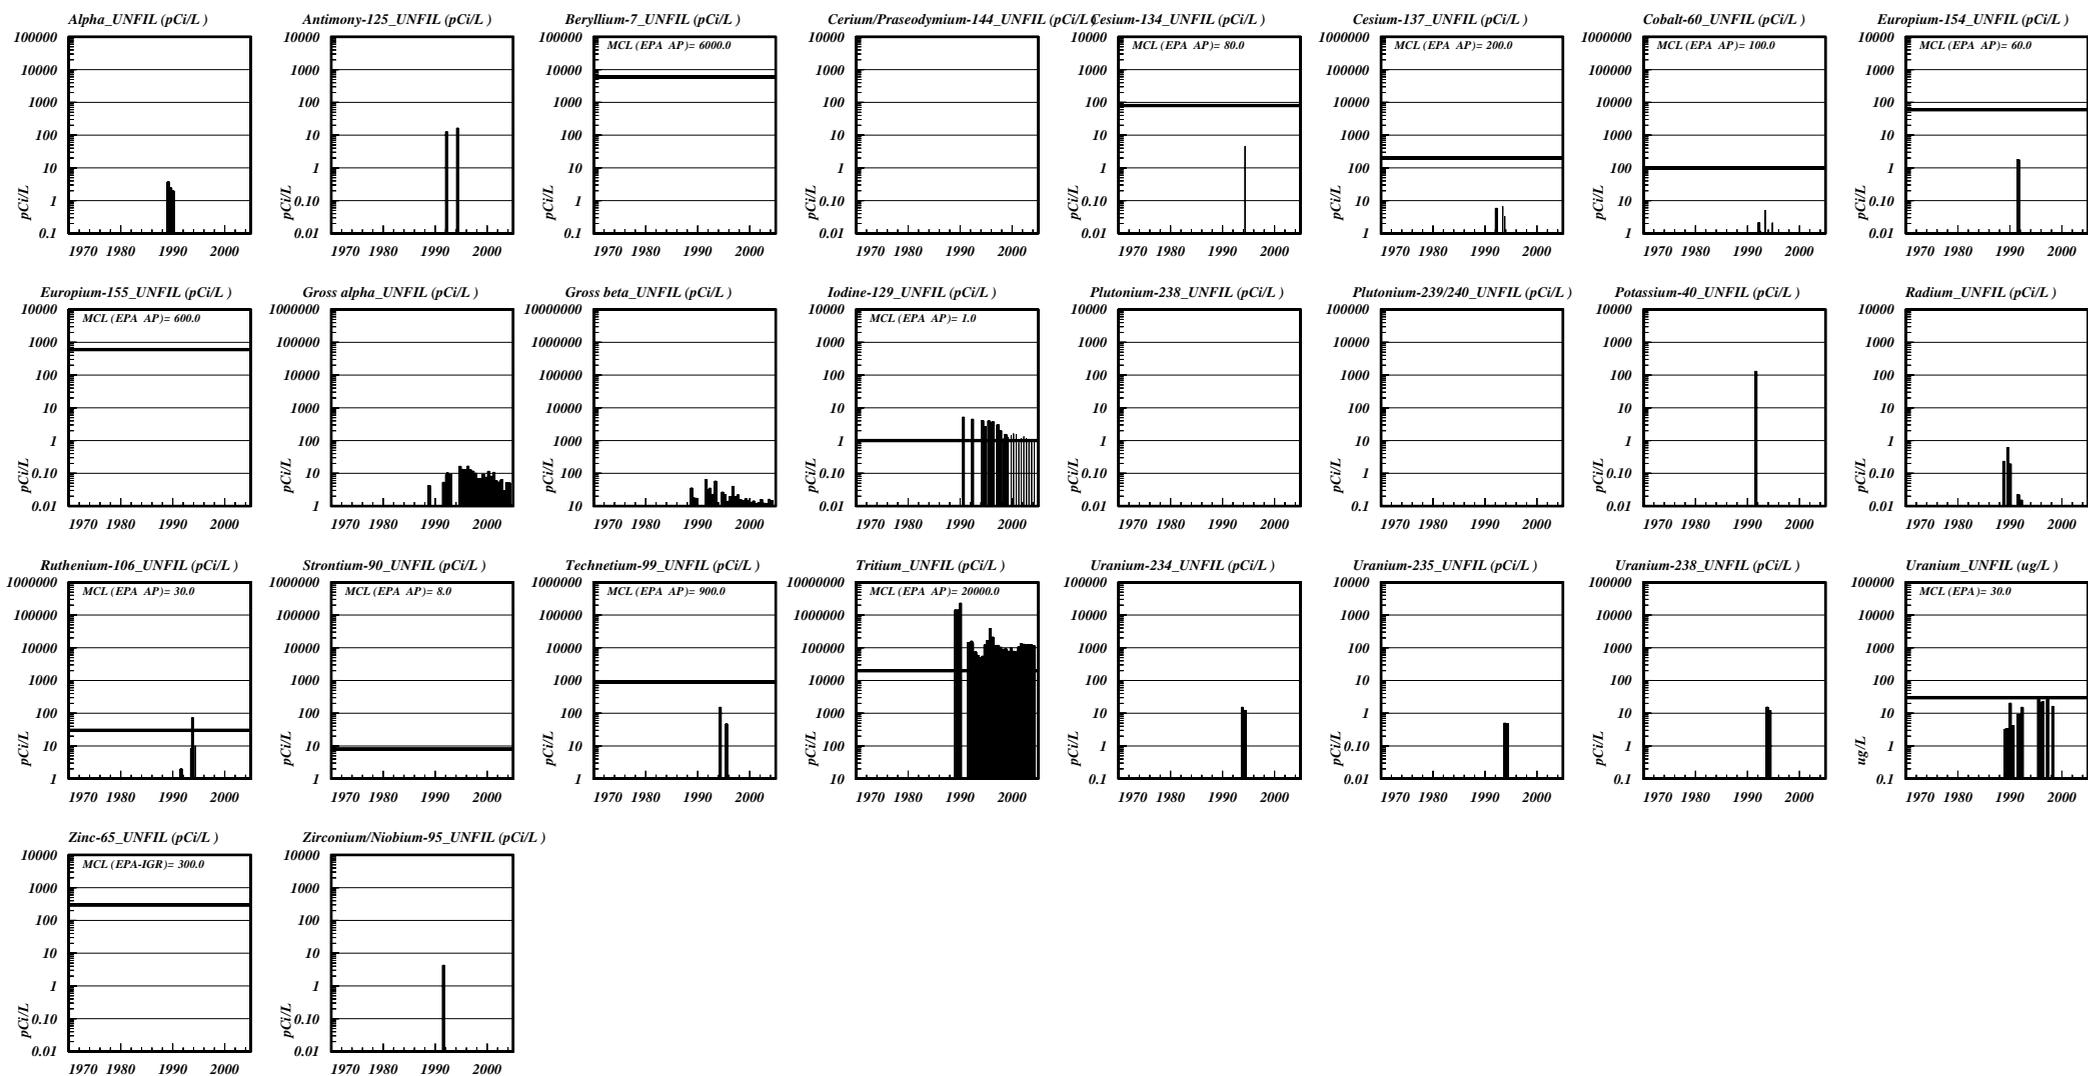

**VOLATILE ORGANIC COMPOUNDS**

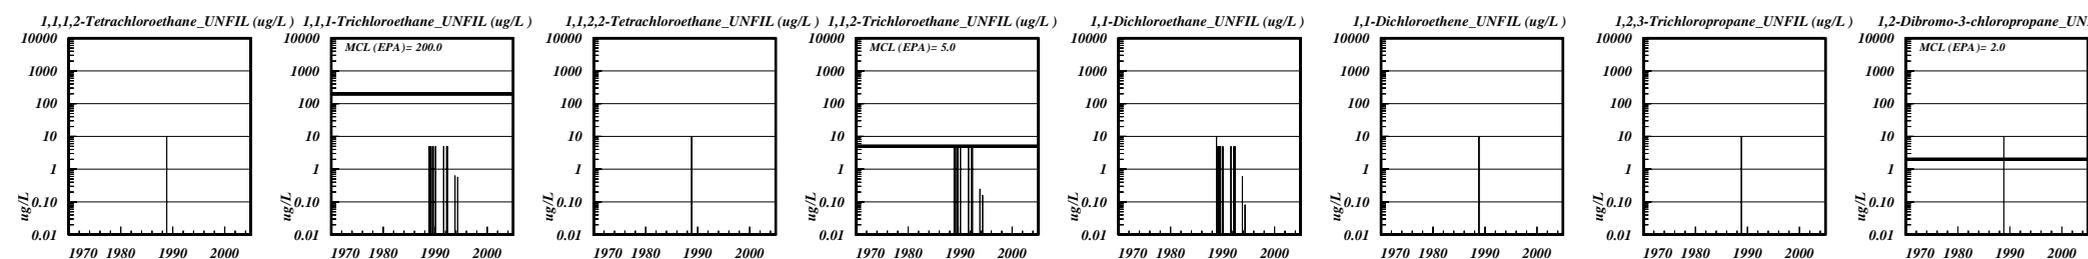


**WELLNAME=299-E24-18 WELLID=A4753**  
 Well Type=STANDARD Well purpose=GROUNDWATER  
 Owner=DOE Contact=BHI Well Adm Compliance=NON-COMPLIANT  
 X\_coord= 574647.10 Y\_coord= 135469.80 Datum=NAD83(91) Date Survey= 9/30/1994  
 Elevation= 219.000 Datum=NAVD88 Date Survey=07/14/94  
 Ref\_Point\_Desc=BRASS CAP Ref\_Point\_side=NONE Contractor=USACE(JECA)  
 Total Number of perforation Intervals=1  
 NPERF#-1 Perf\_top= 125.90 Bot= 117.94 MCas\_size= 0.00 Perf\_cuts= 0.00  
 Total Number of Screen Intervals=1  
 Screen#-1 Screen\_diam= 4.00 in Top= 94.95 Bottom= 101.35 m Slot\_size= 0.01 in  
 Screen\_material=Stainless Steel  
 Total Number of Seals=9  
 Seal#-1 Depth\_top= 0.79 Bottom= 5.79 m Material=Cement Grout  
 Seal#-2 Depth\_top= 92.05 Bottom= 99.82 m Material=Sand Pack  
 Seal#-3 Depth\_top=-0.15 Bottom= 0.79 m Material=Concrete  
 Seal#-4 Depth\_top= 5.79 Bottom= 12.36 m Material=Pure Gold Bentonite  
 More Information is at <http://www.envirodataaccess.com/wellfiles/299-E24-18.htm>

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


VOLATILE ORGANIC COMPOUNDS

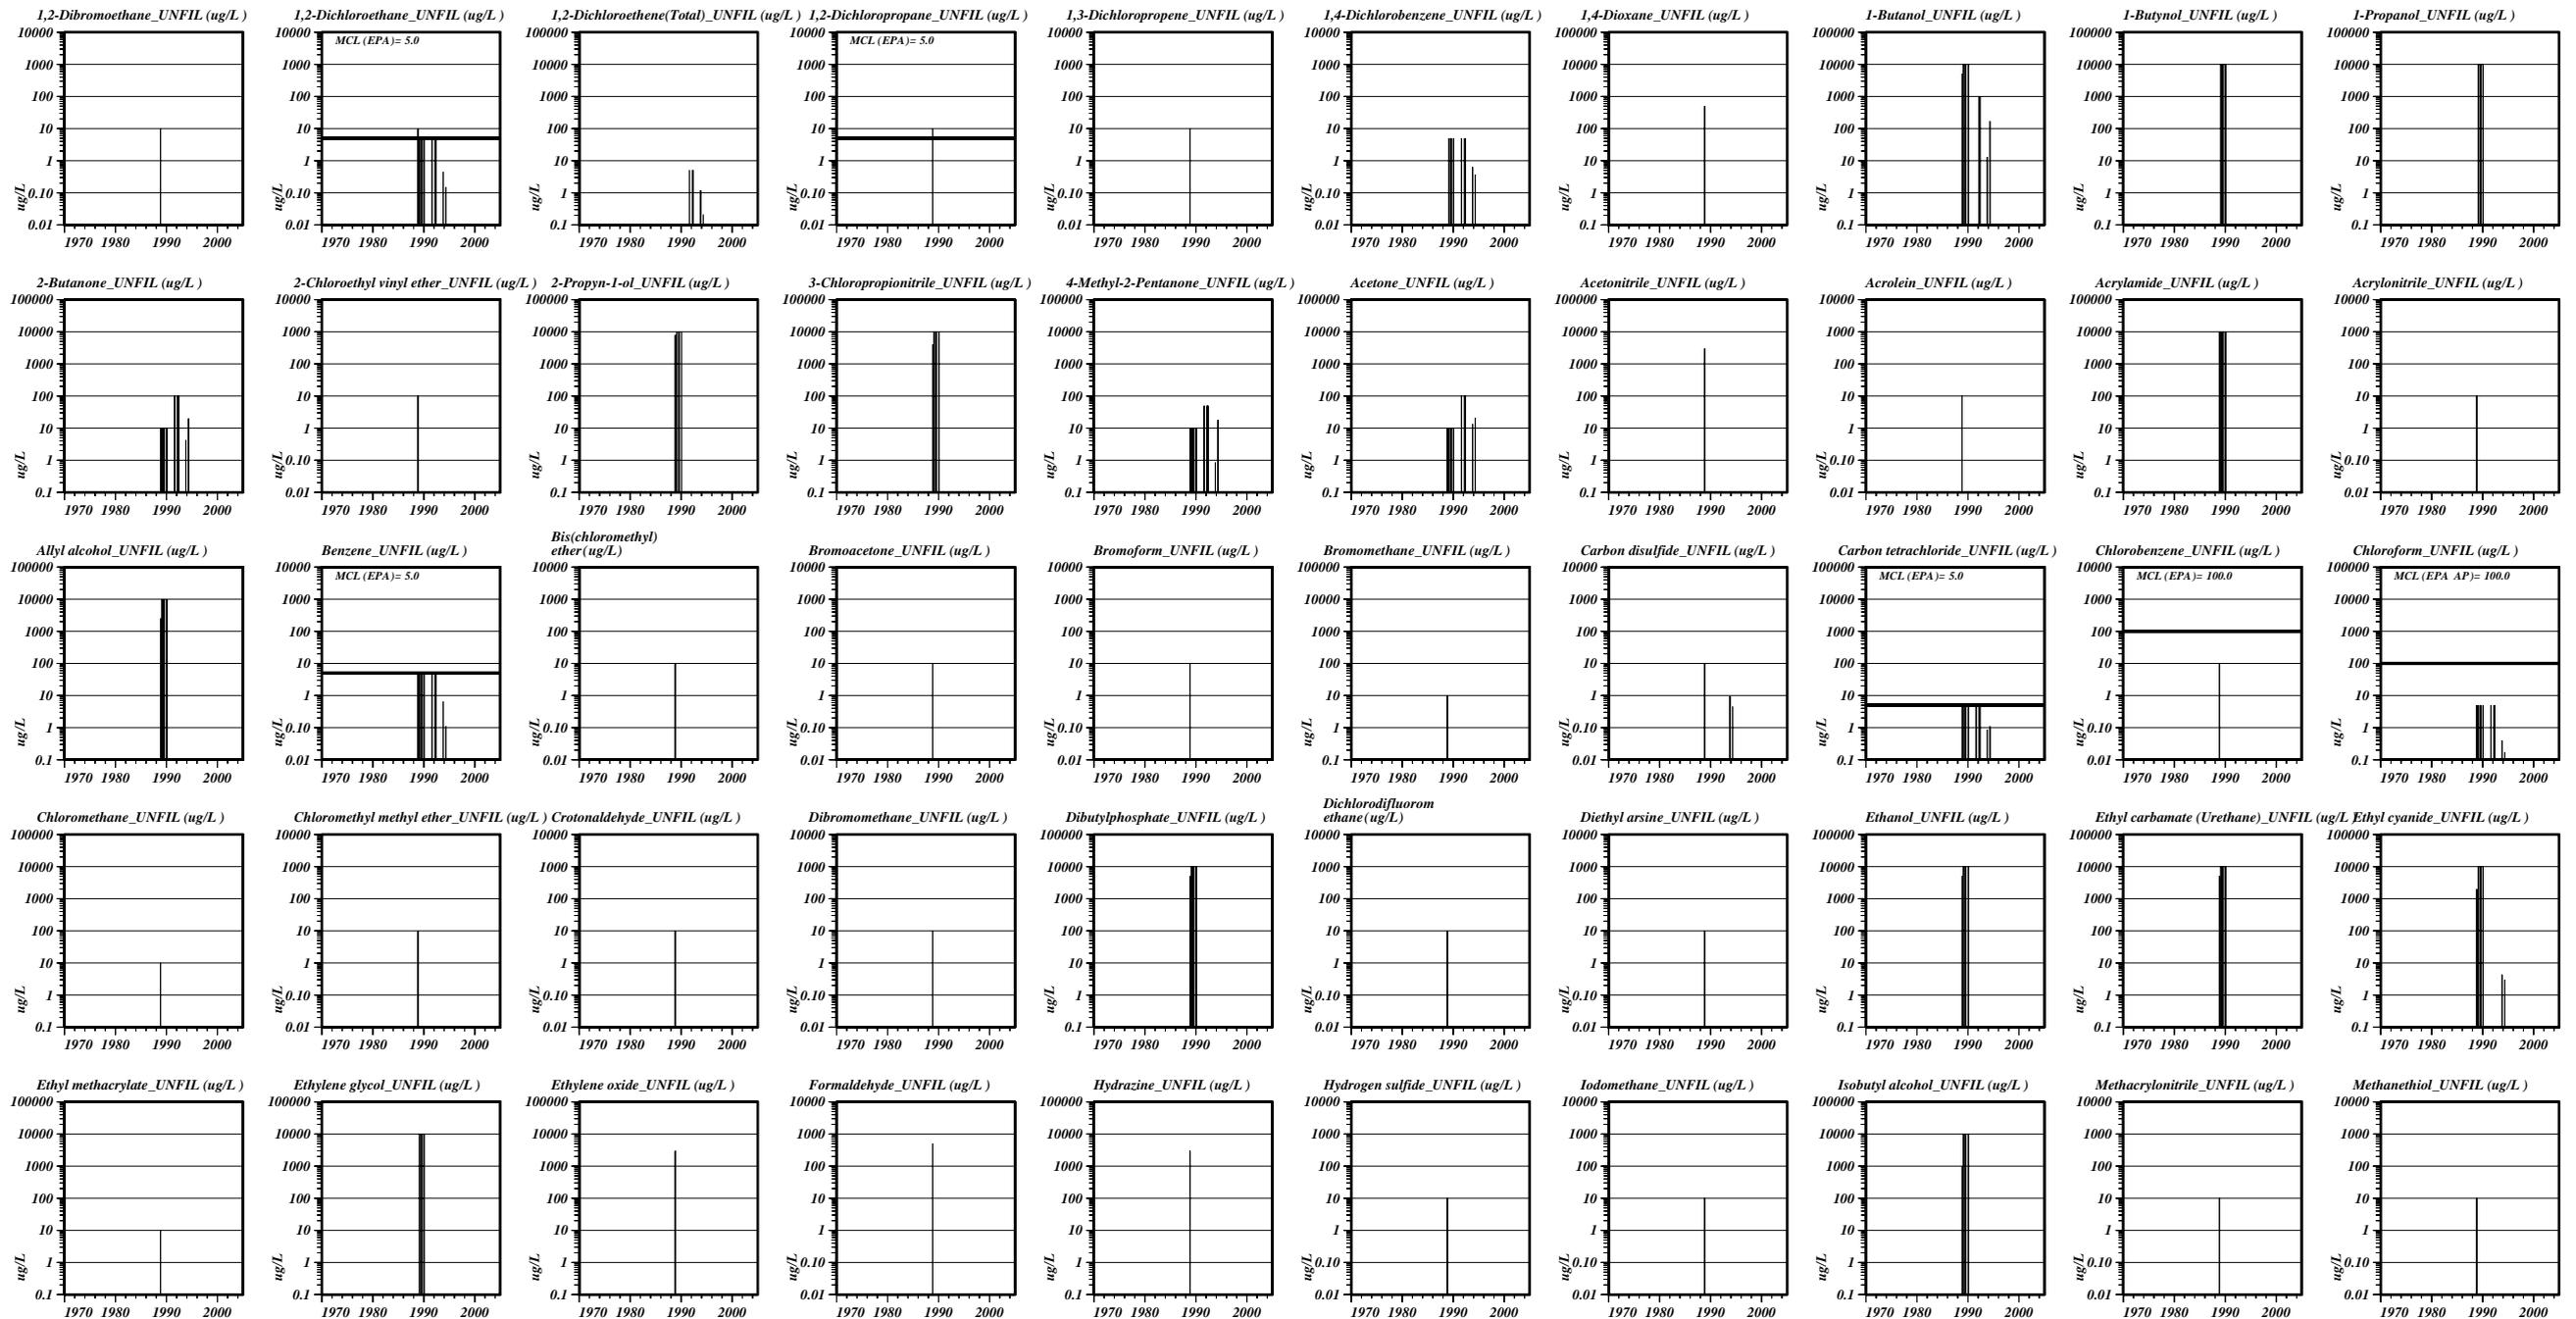


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

**VOLATILE ORGANIC COMPOUNDS**

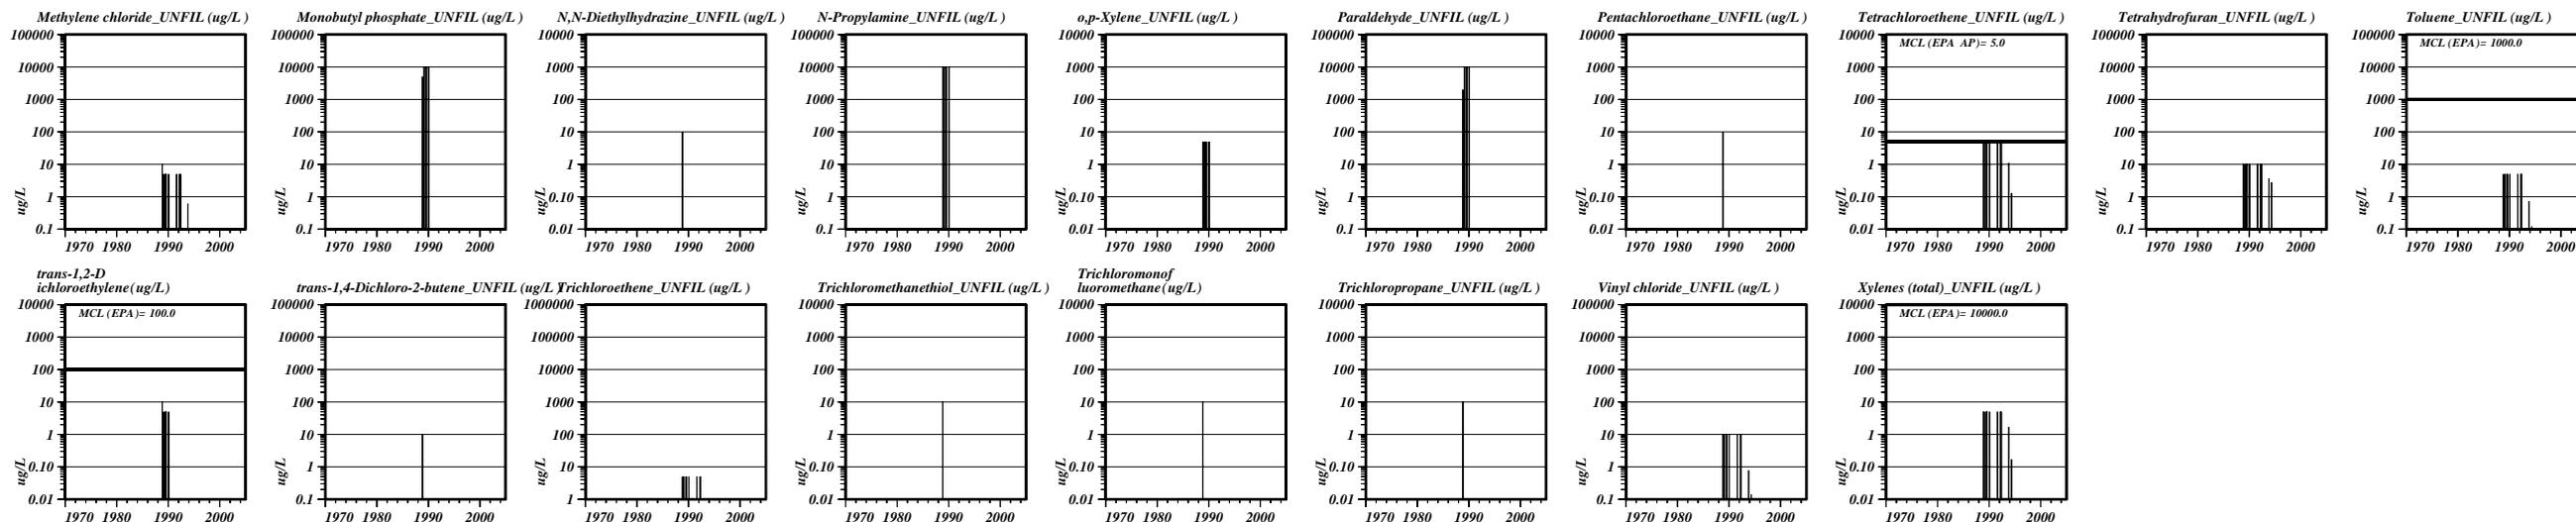

**SEMI-VOLATILE ORGANIC COMPOUNDS**

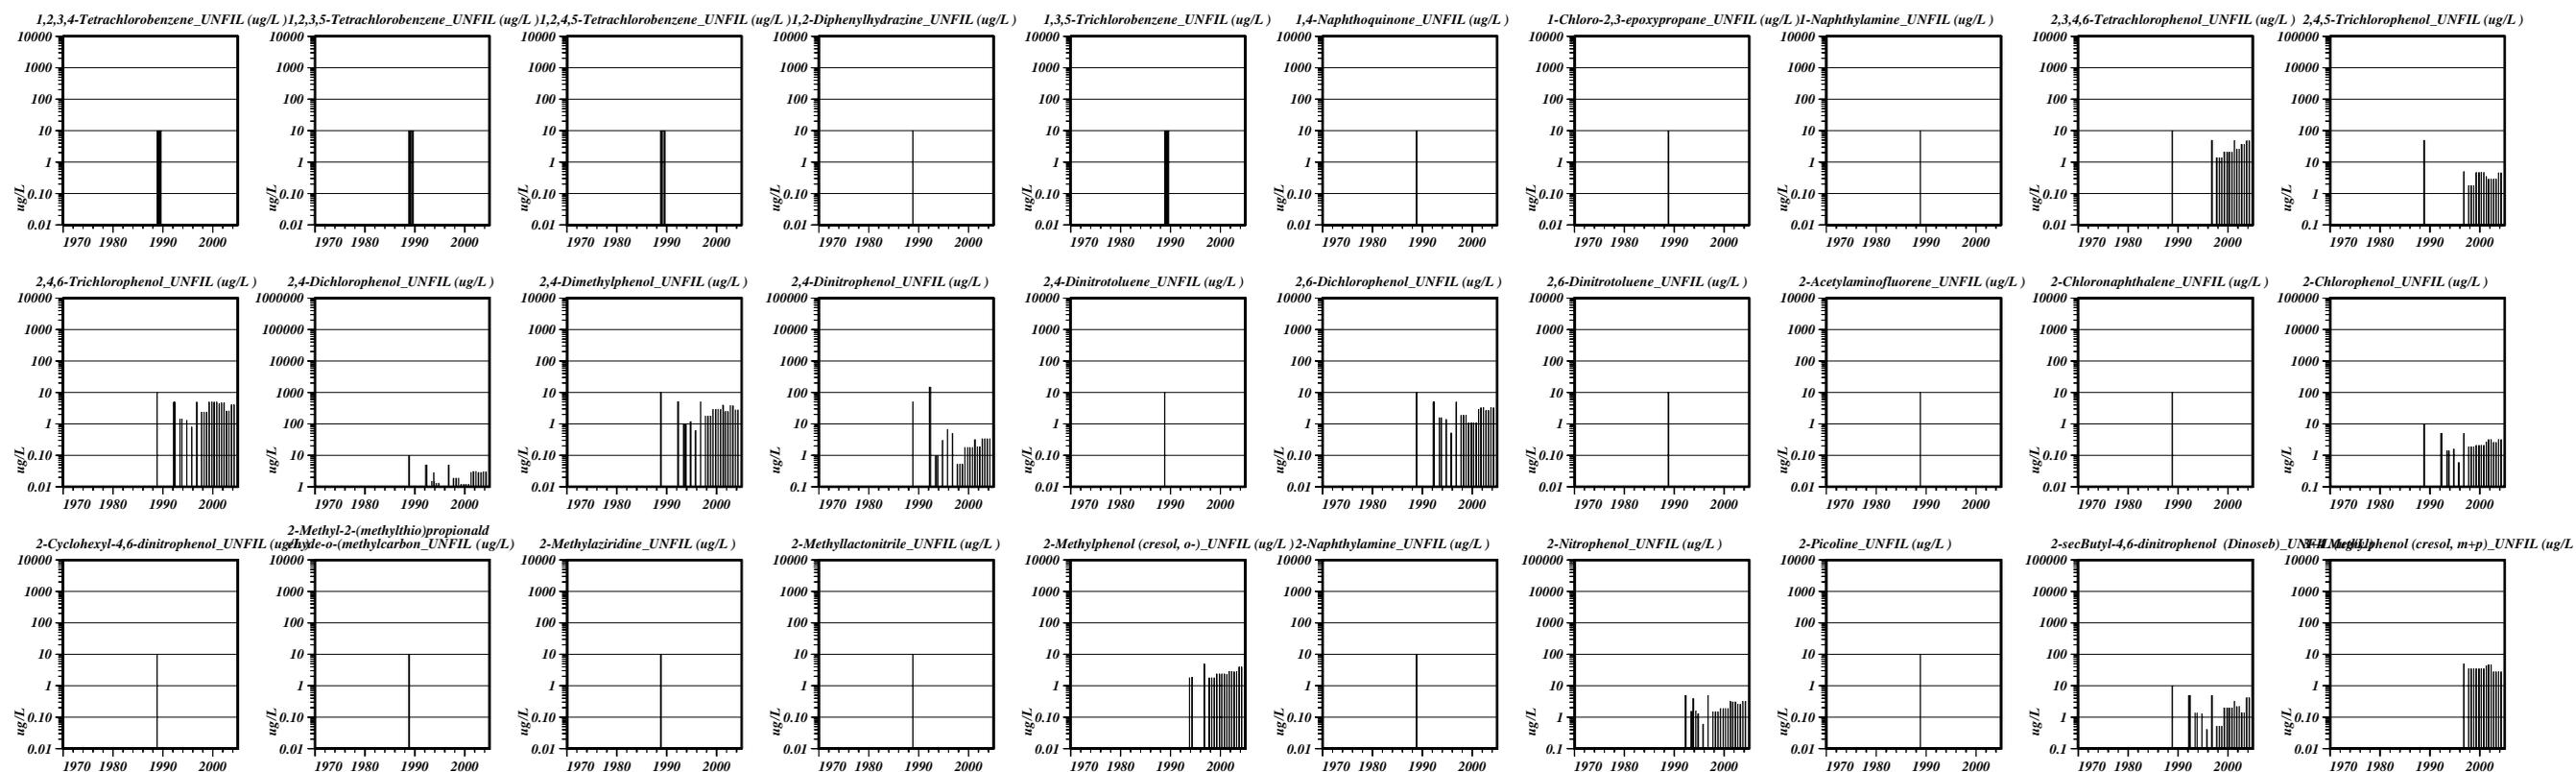


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value;L=Value between IDL and CRQL (estimated);T=Tentatively identified compound;

EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit;THIN BARS=Value Below Detection Limit;HATCHED BARS=Value With Data Qualifier Flag


SEMI-VOLATILE ORGANIC COMPOUNDS

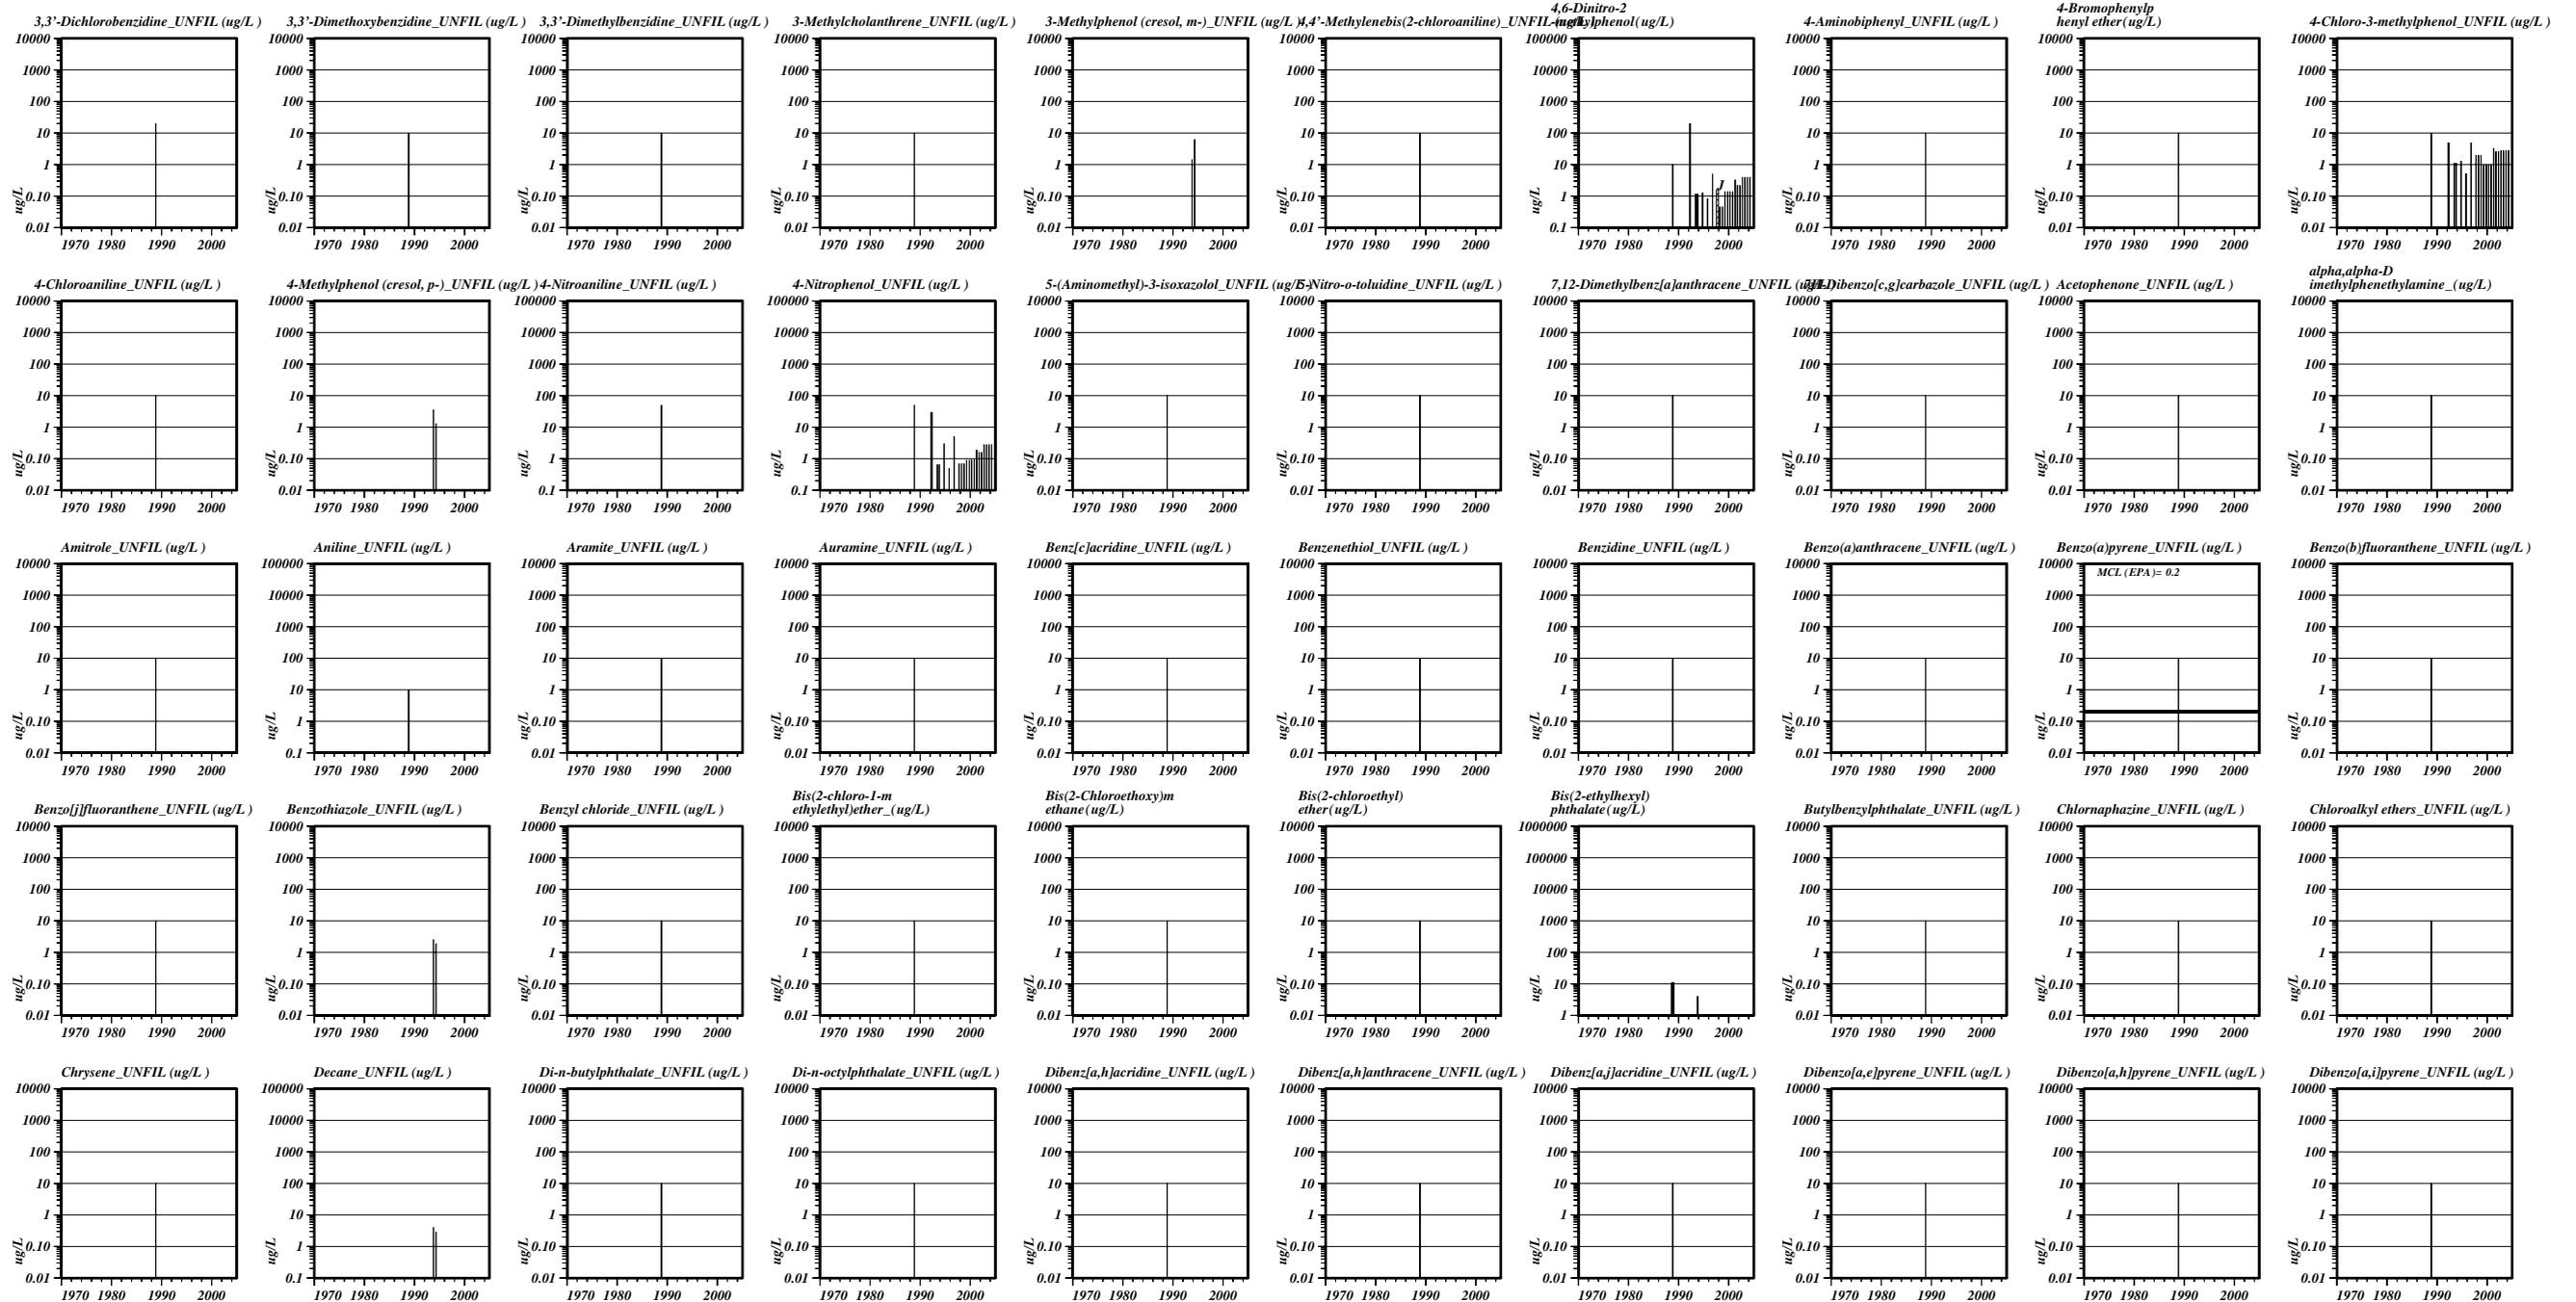

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag


SEMI-VOLATILE ORGANIC COMPOUNDS

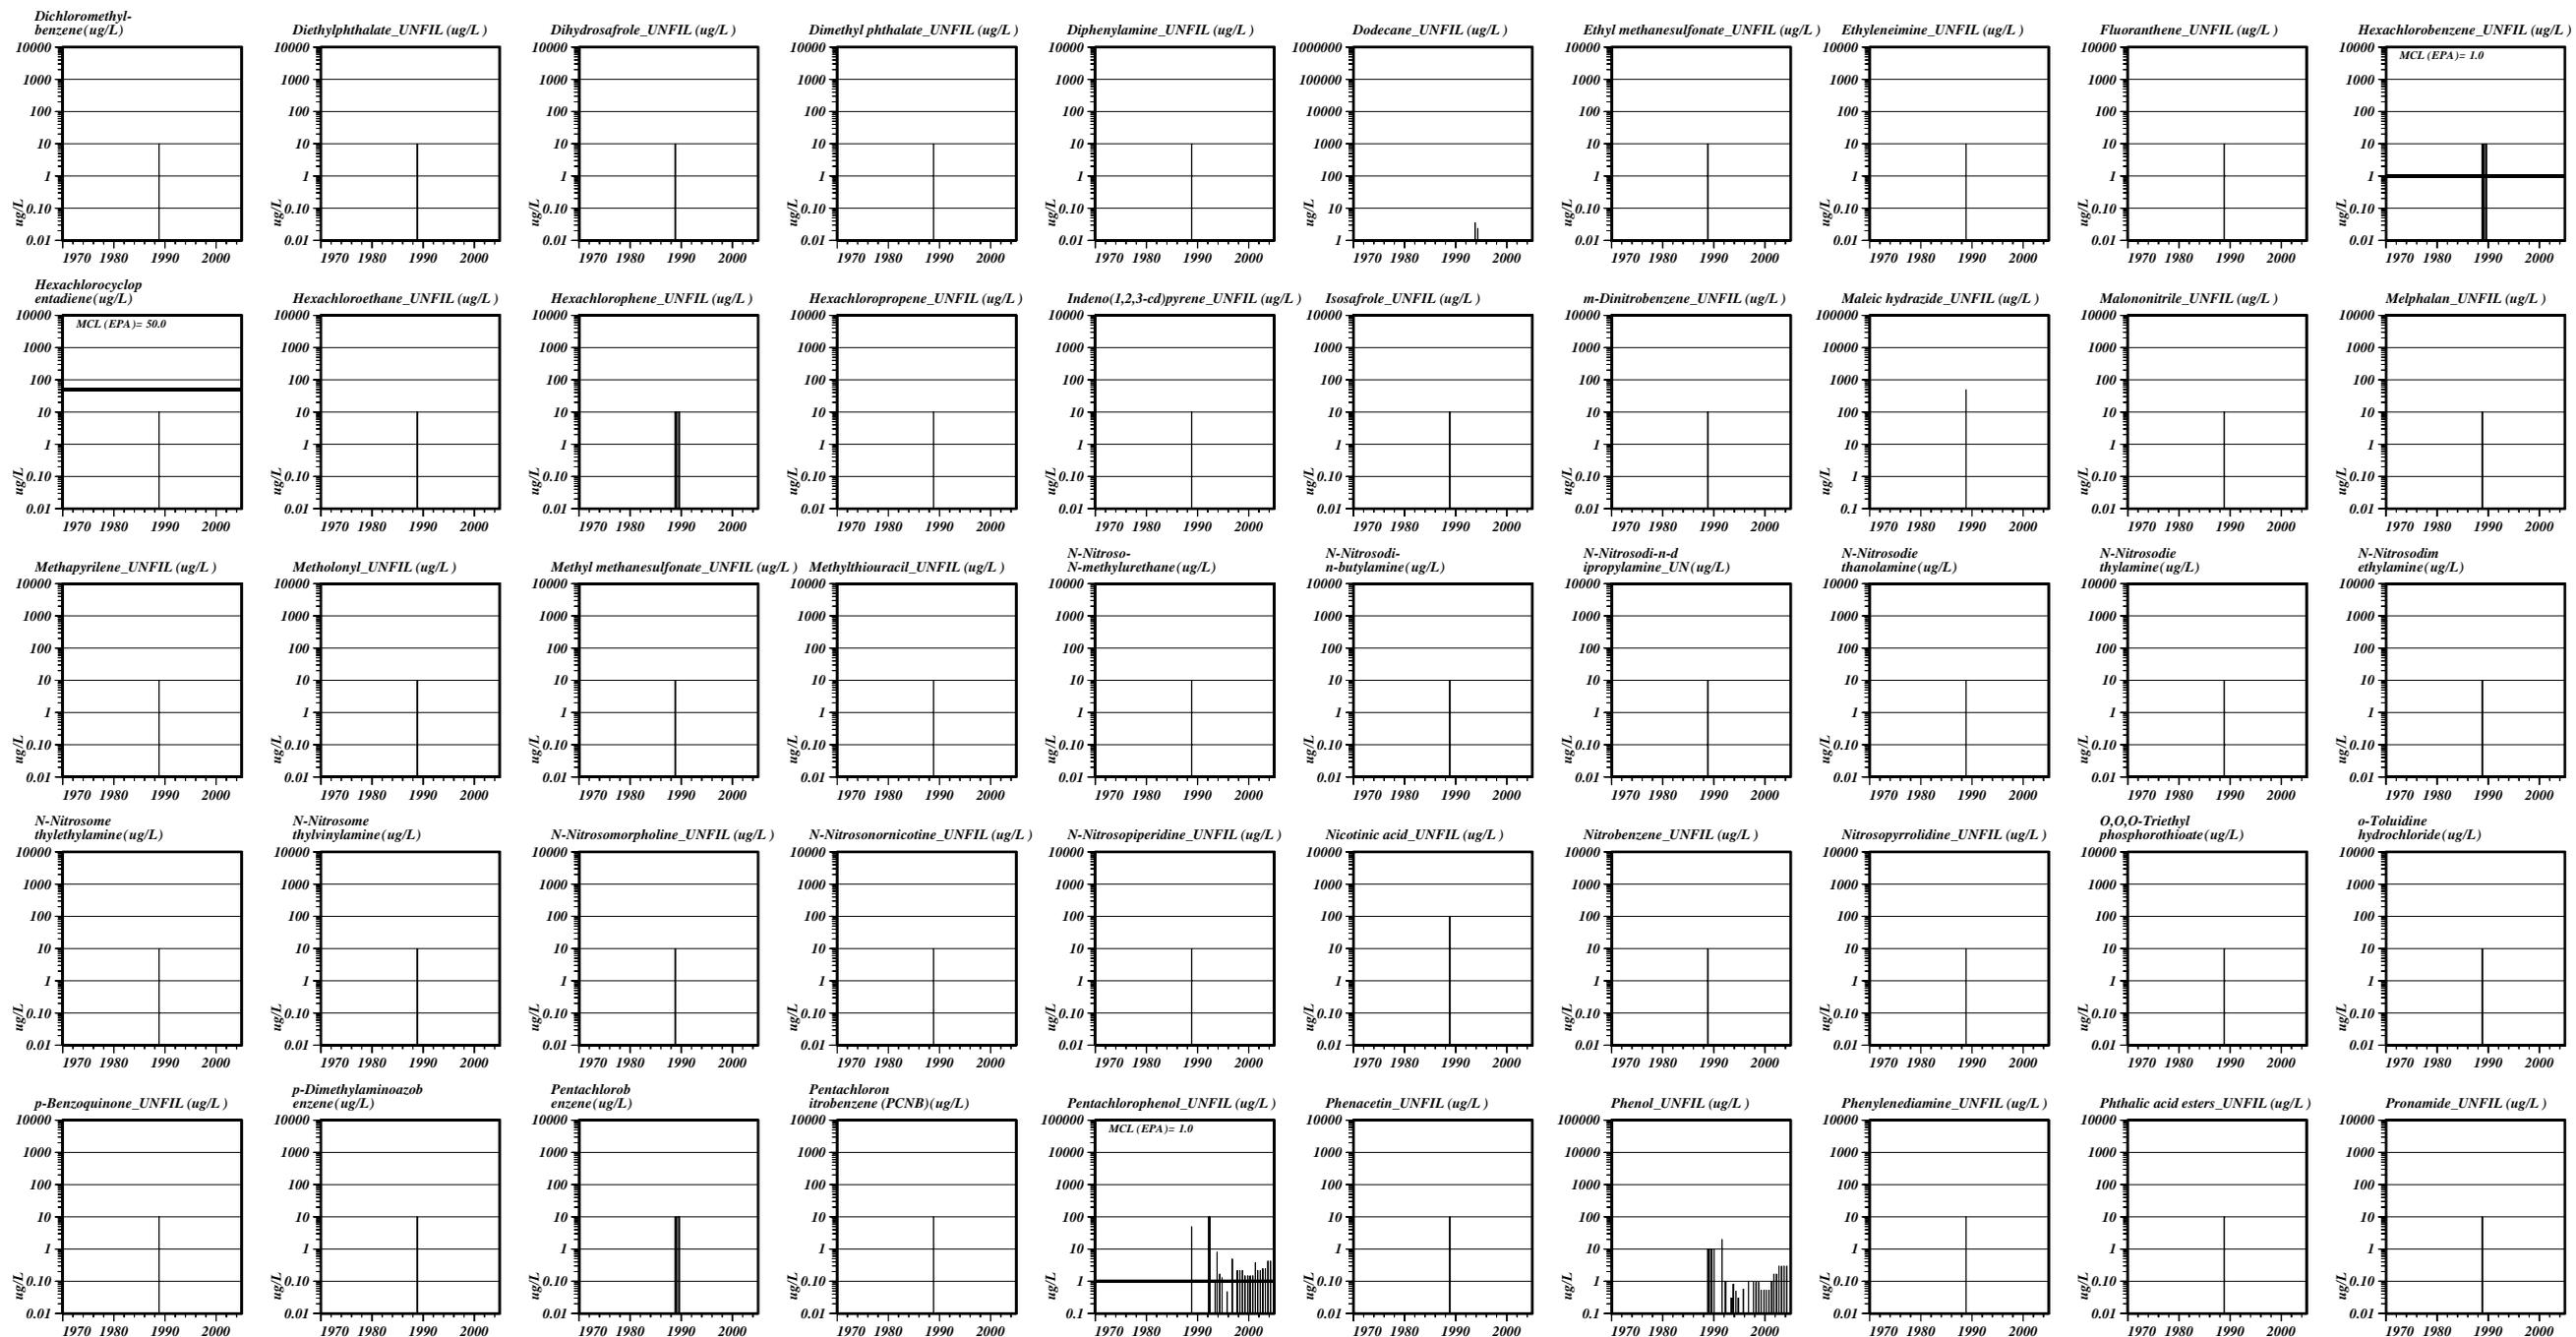


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value;L=Value between IDL and CRQL (estimated);T=Tentatively identified compound; EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit;THIN BARS=Value Below Detection Limit;HATCHED BARS=Value With Data Qualifier Flag

SEMI-VOLATILE ORGANIC COMPOUNDS

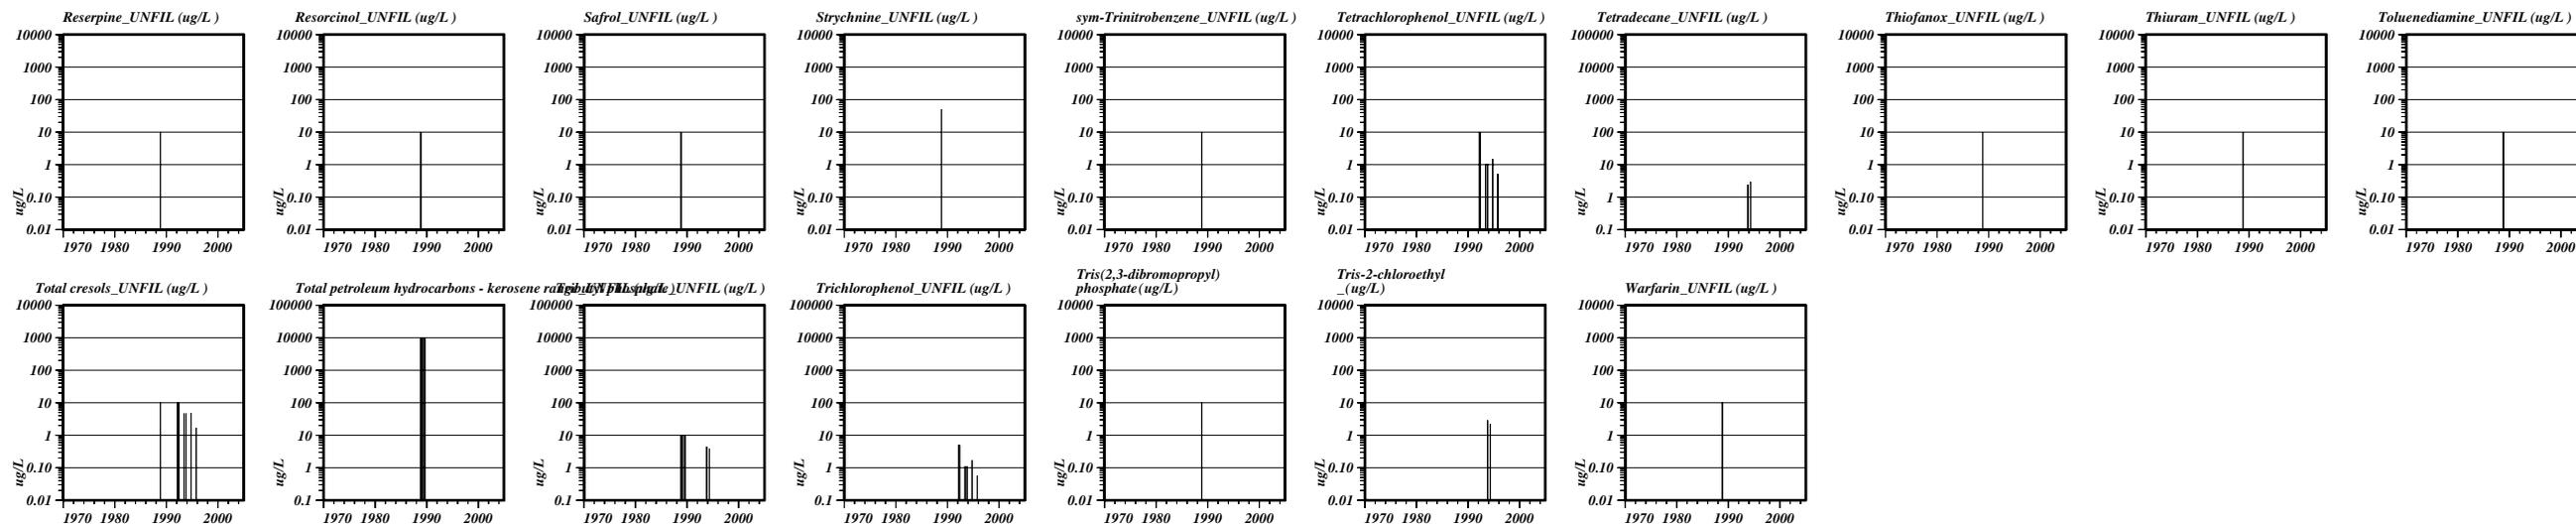


METALS & PHYSICAL PARAMETERS

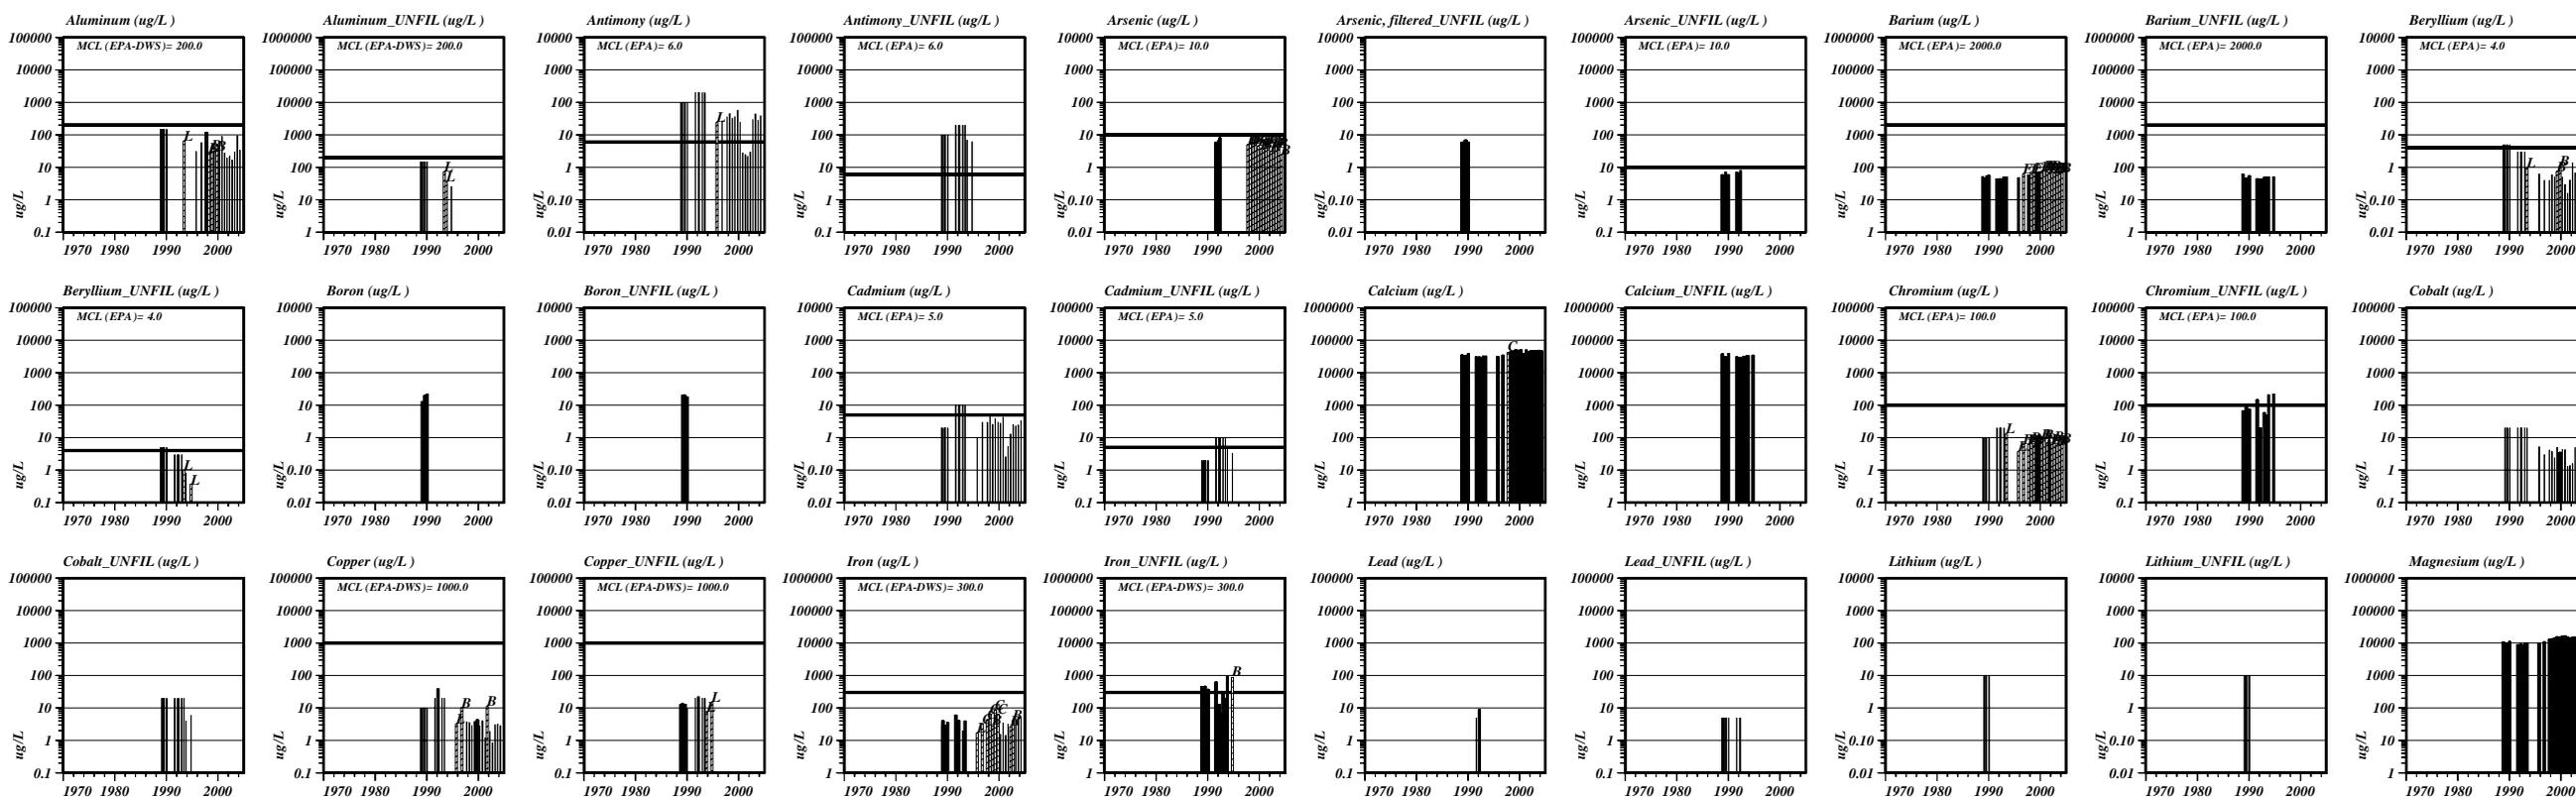


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound; EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

METALS & PHYSICAL PARAMETERS

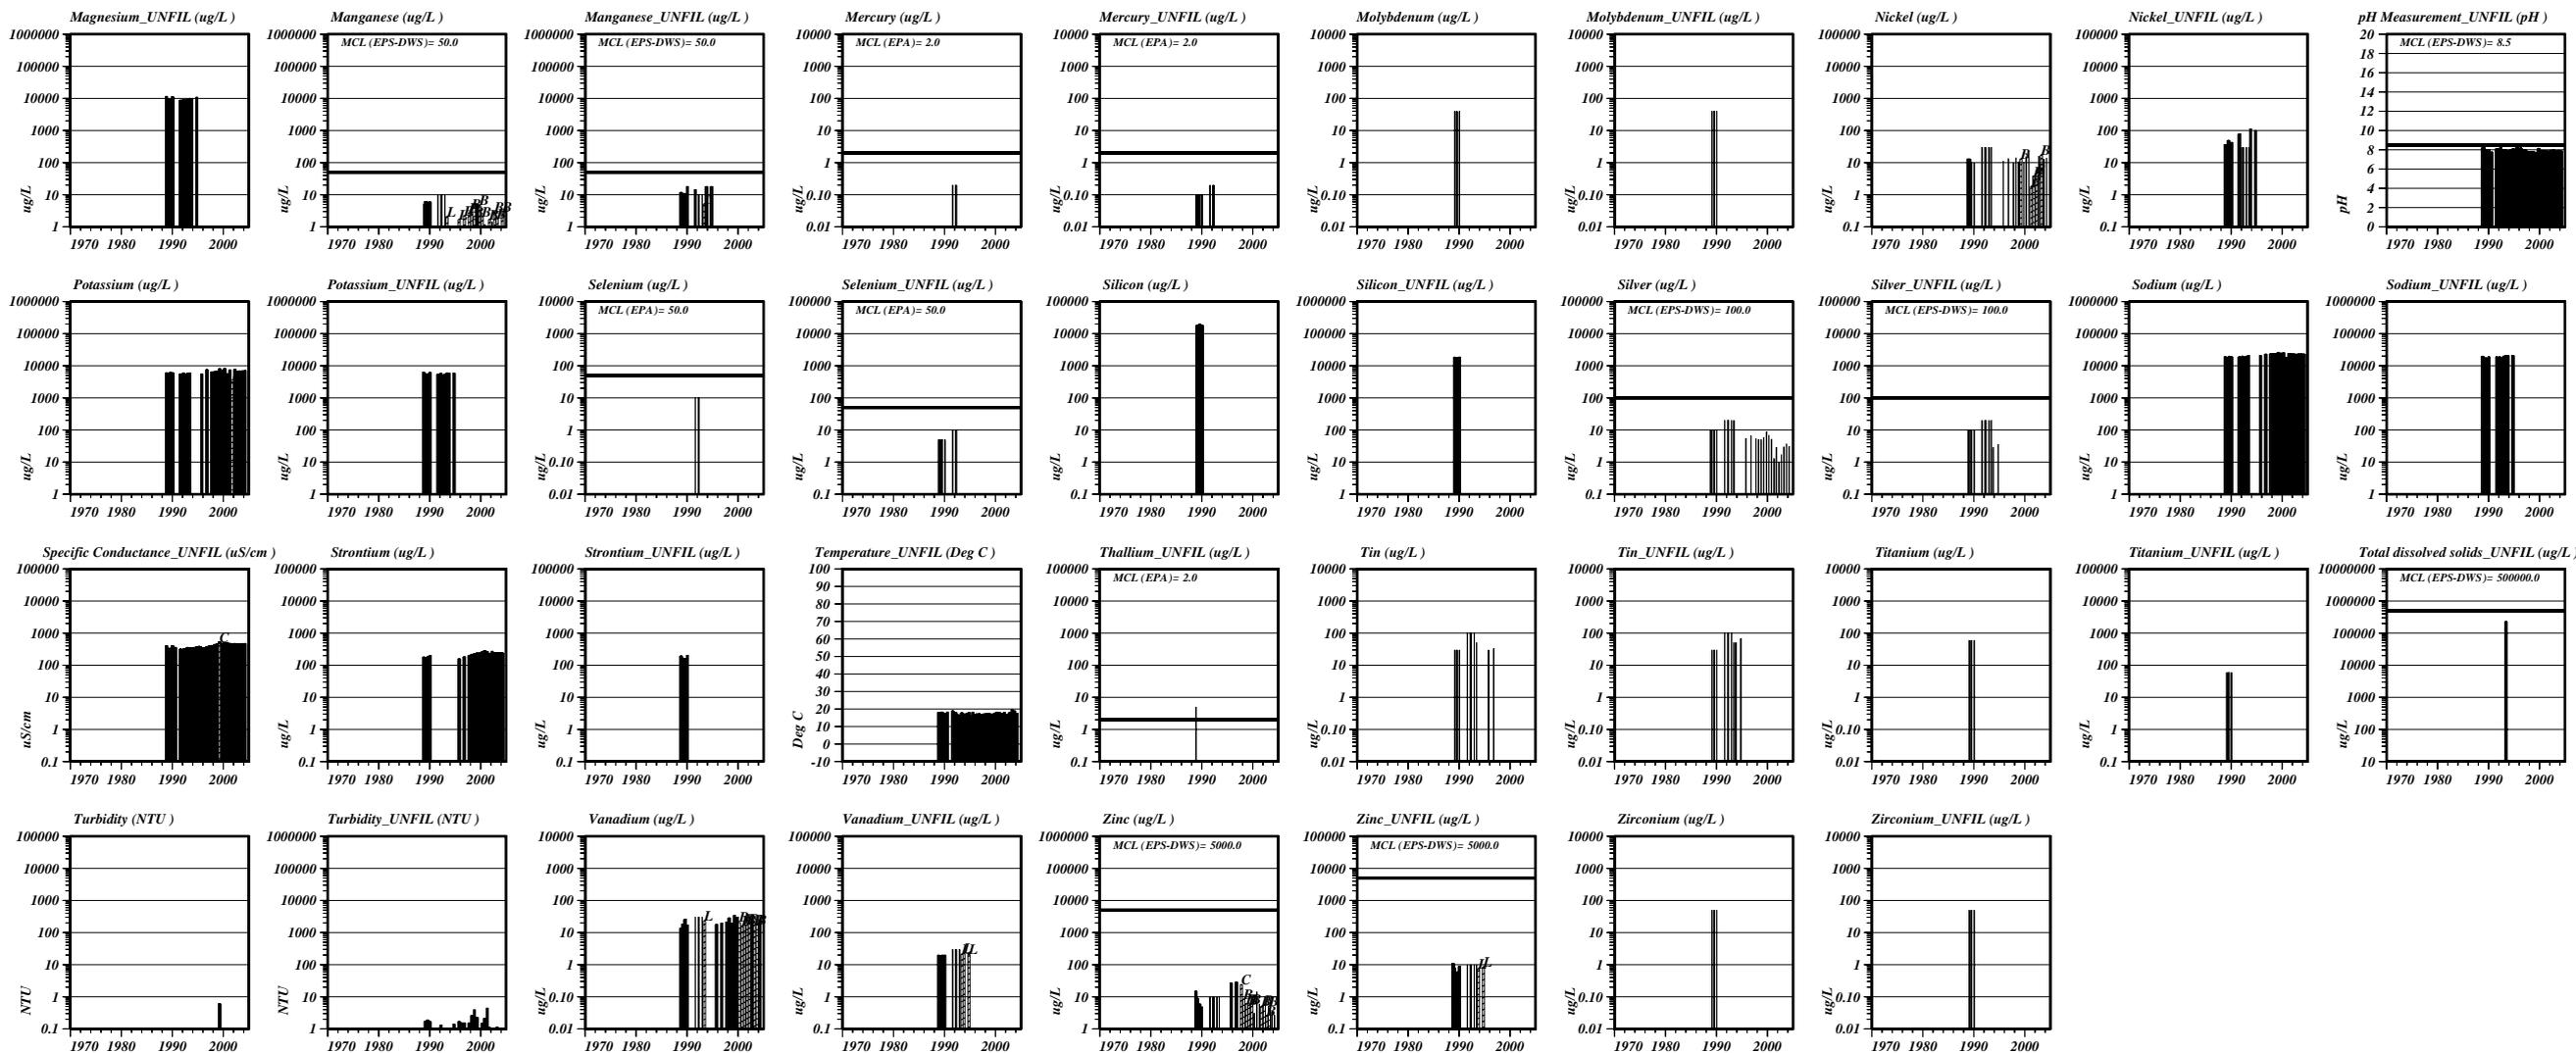


PEST/PCB, HERB, & DIOXINS

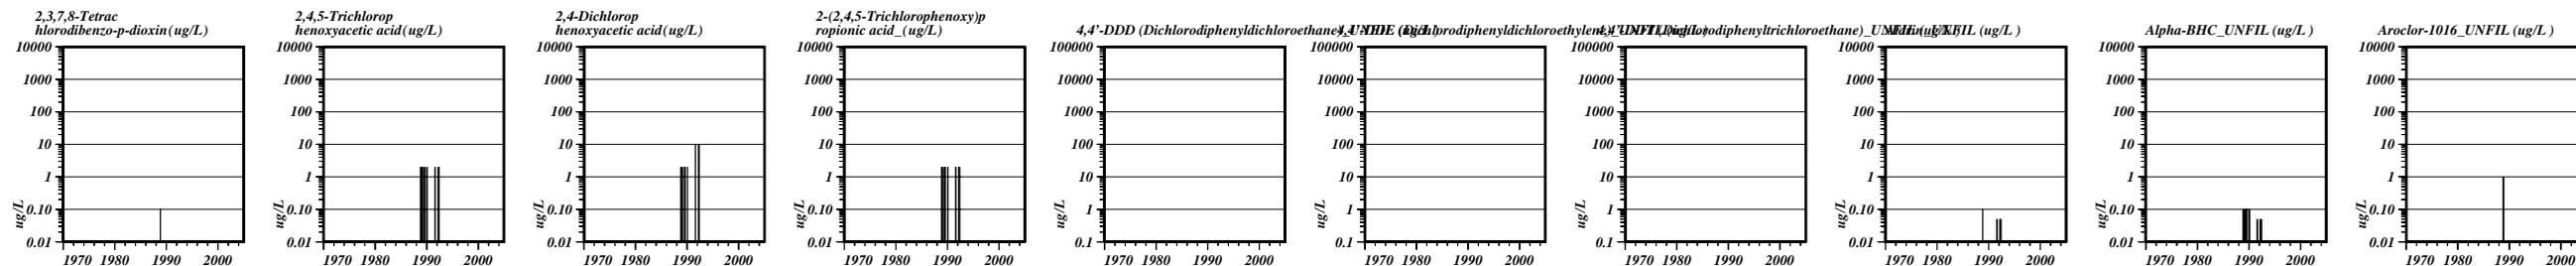


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound; EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

PEST/PCB, HERB, & DIOXINS

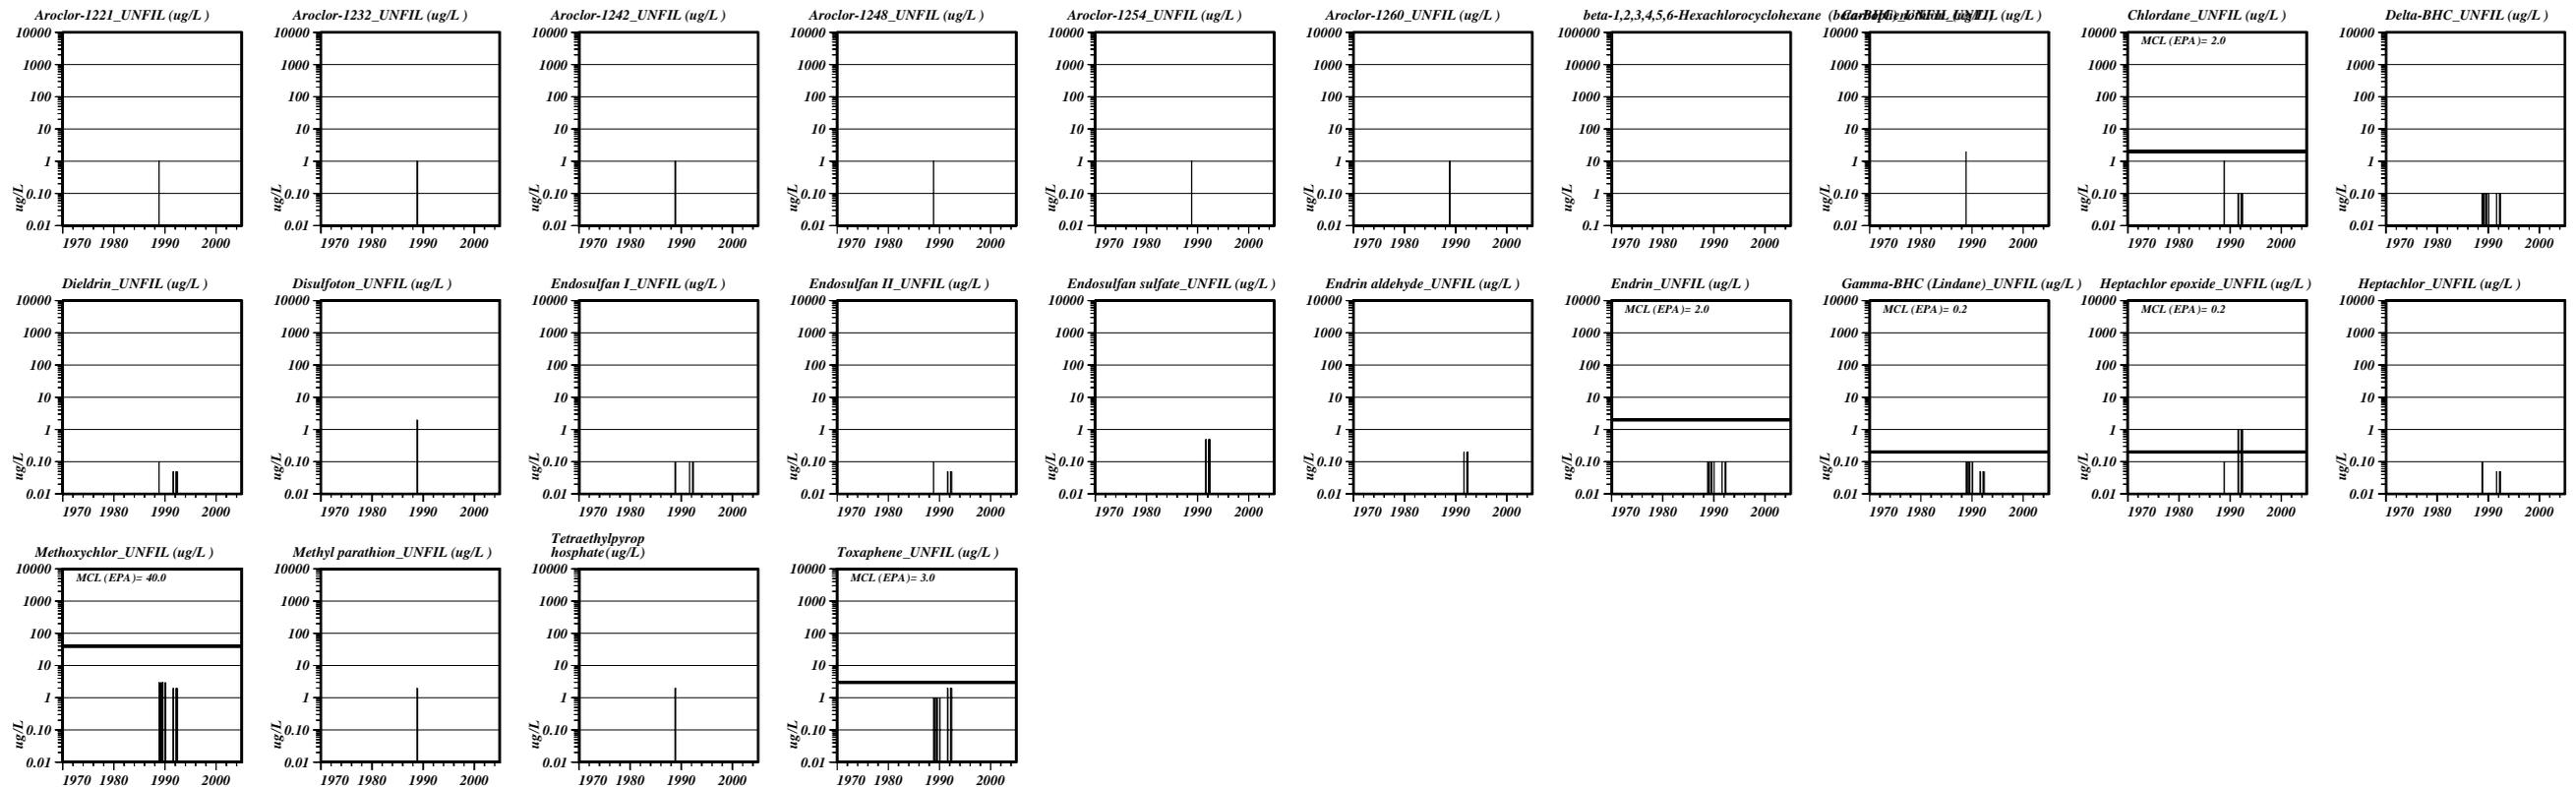


GENCHEM & ORGANICS & GENORGANICS

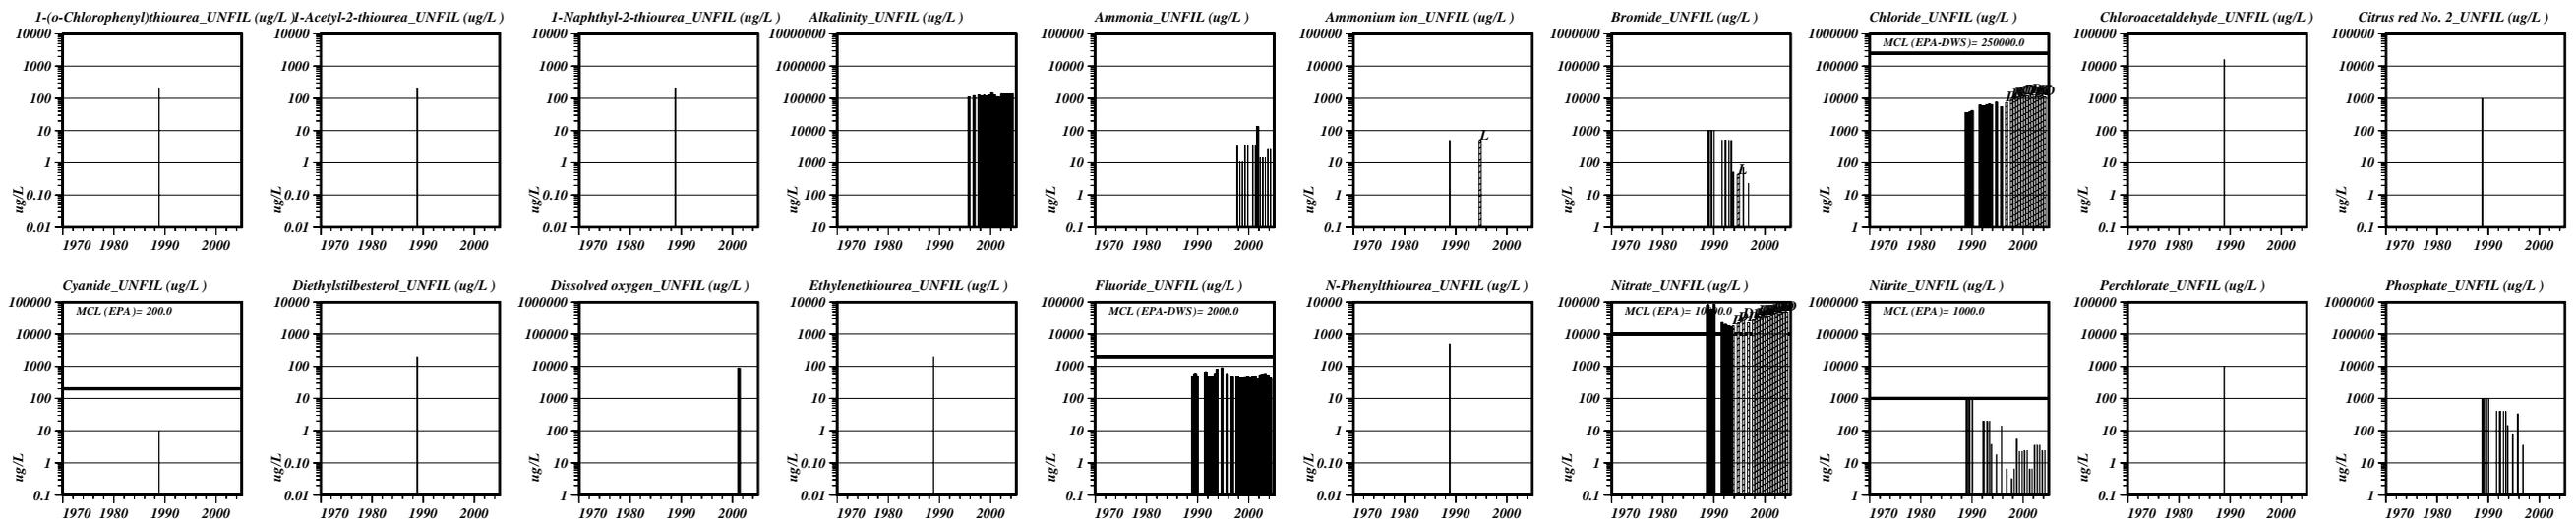

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound; EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

GENCHEM & ORGANICS & GENORGANICS

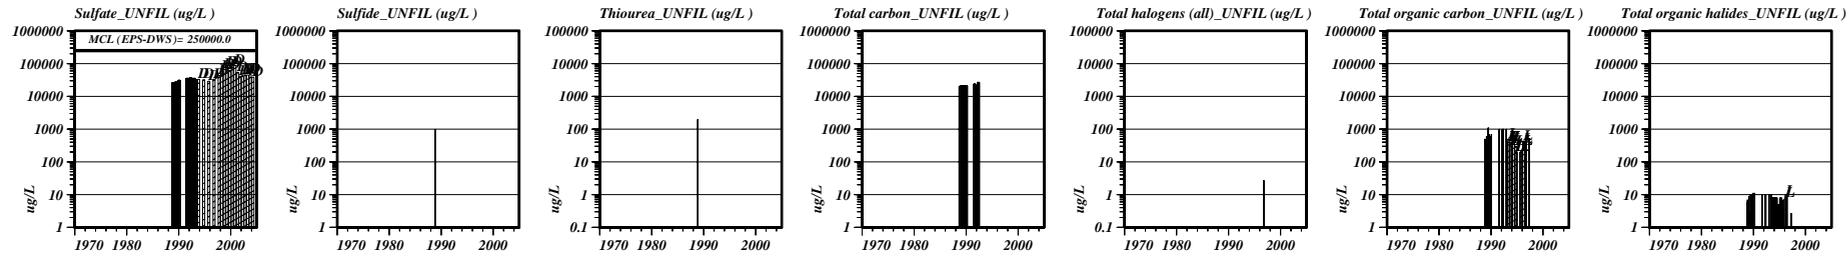

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag