


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS


wellseries-200-299 WELL#=299-E25-50

## RADIONUCLIDES

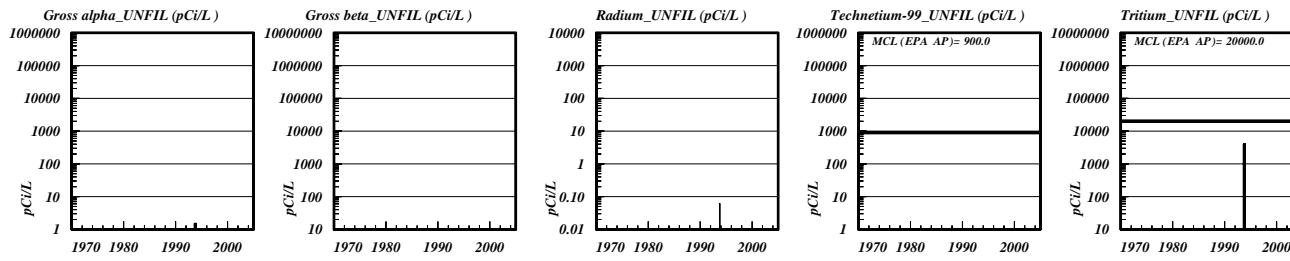


## VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE

## SEMI-VOLATILE ORGANIC COMPOUNDS


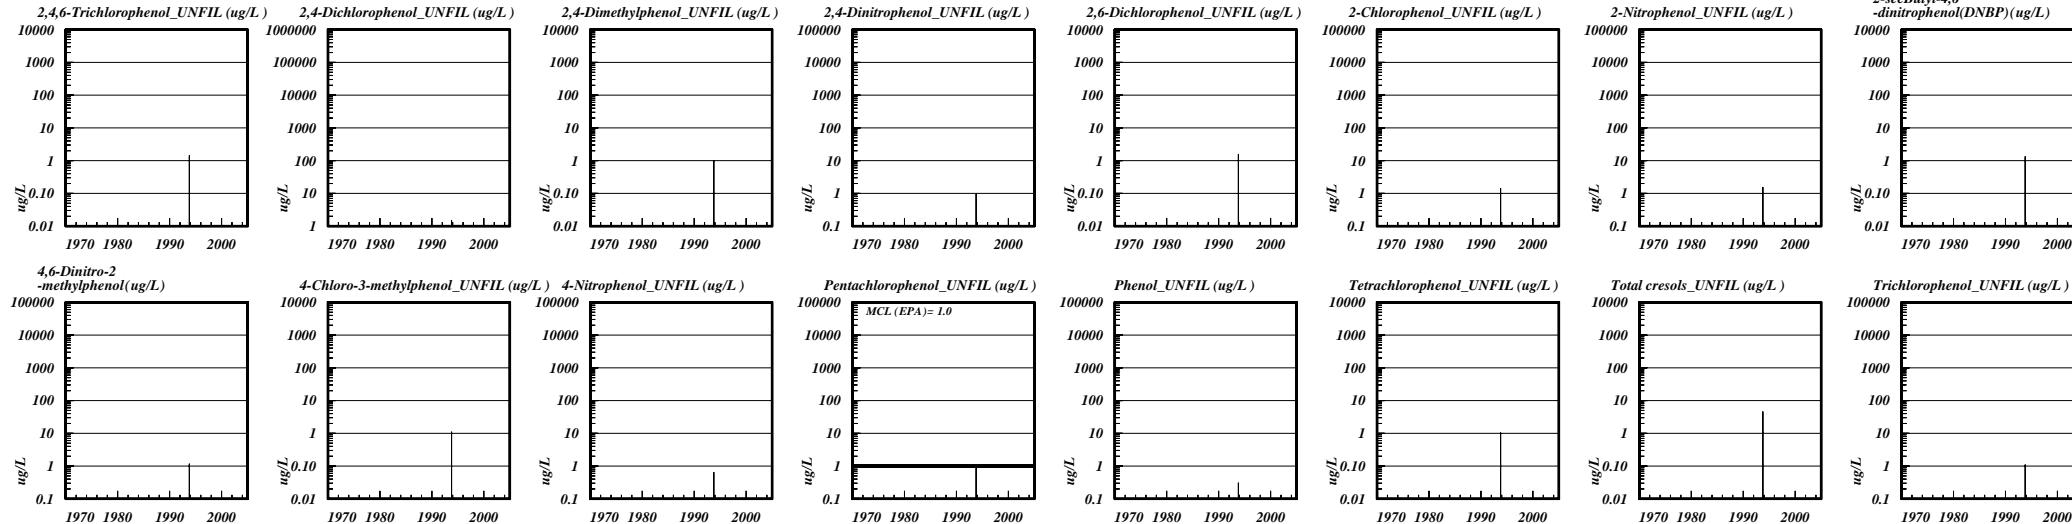


## METALS & PHYSICAL PARAMETERS

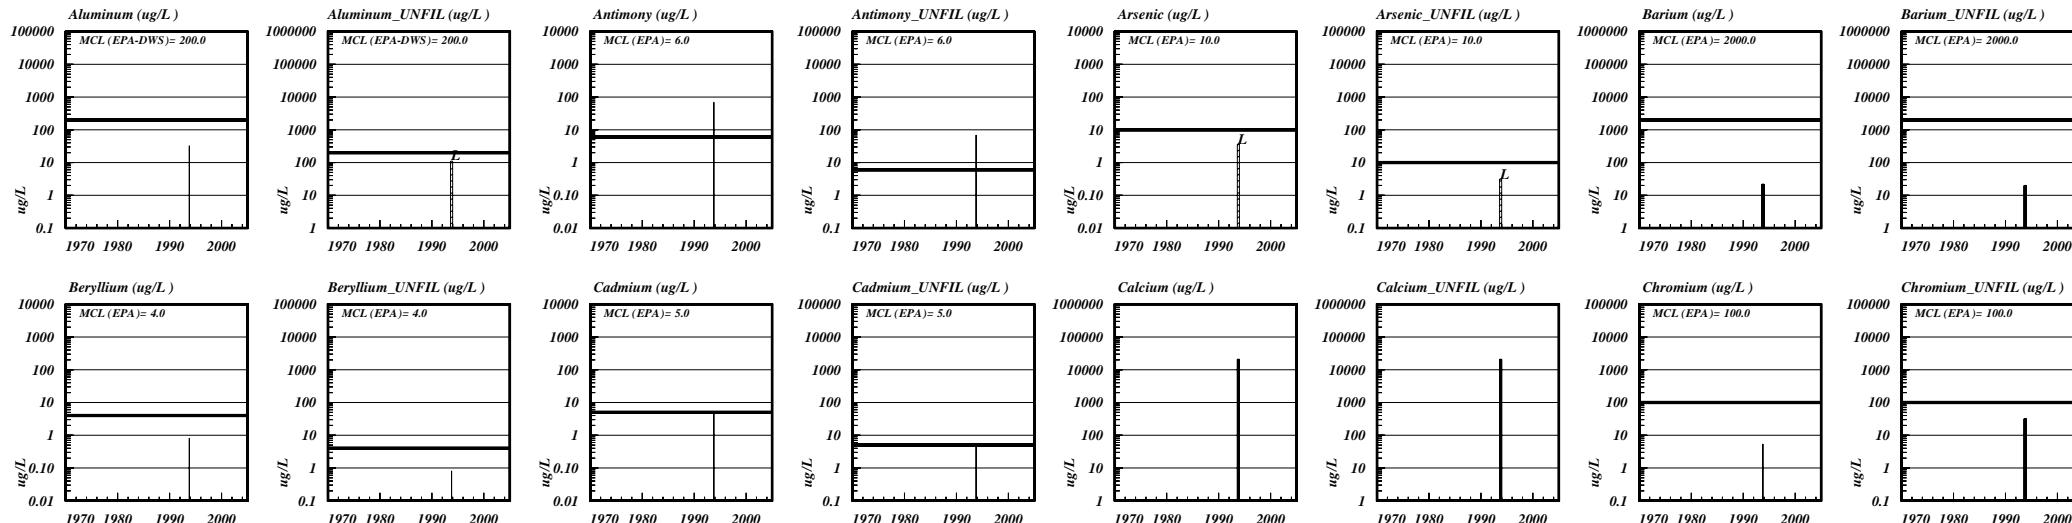

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

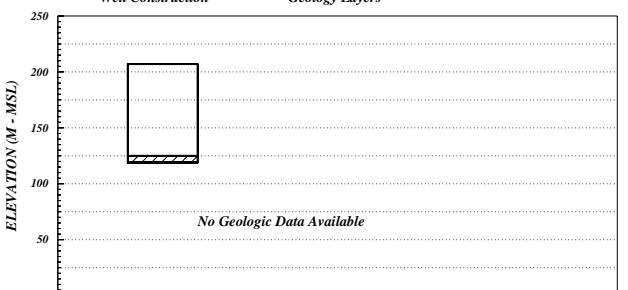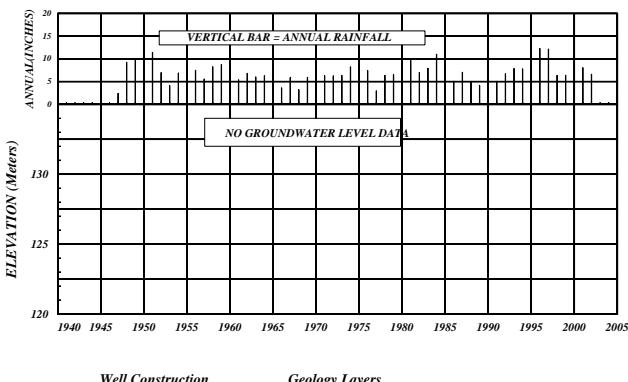


**WELLNAME=299-E25-50 WELLID=A6039**

Well Type=STANDARD Well purpose=GROUNDWATER  
Owner=DOE Contact=BHI Well Adm Compliance=COMPLIANT  
X\_coor= 576399.10 Y\_coor= 135681.60 Datum=NAD83(91) Date Survey= 6/30/1995  
Elevation= 207.007 Datum=NAVD88 Date Survey=04/06/95  
Ref\_Point\_Desc=TOP OF CASING Ref\_Point\_side=N Contractor=USACE(JECA)  
Well Comment= DTW=272.30' DTB=294.20' Decommissioned by subc  
Total Number of Screen Intervals=1  
Screen#=1 Screen\_diam= 4.00 in Top= 81.99 Bottom= 88.09 m Slot\_size= 0.01 in  
Screen\_material=Stainless Steel


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-E25-50

## METALS & PHYSICAL PARAMETERS

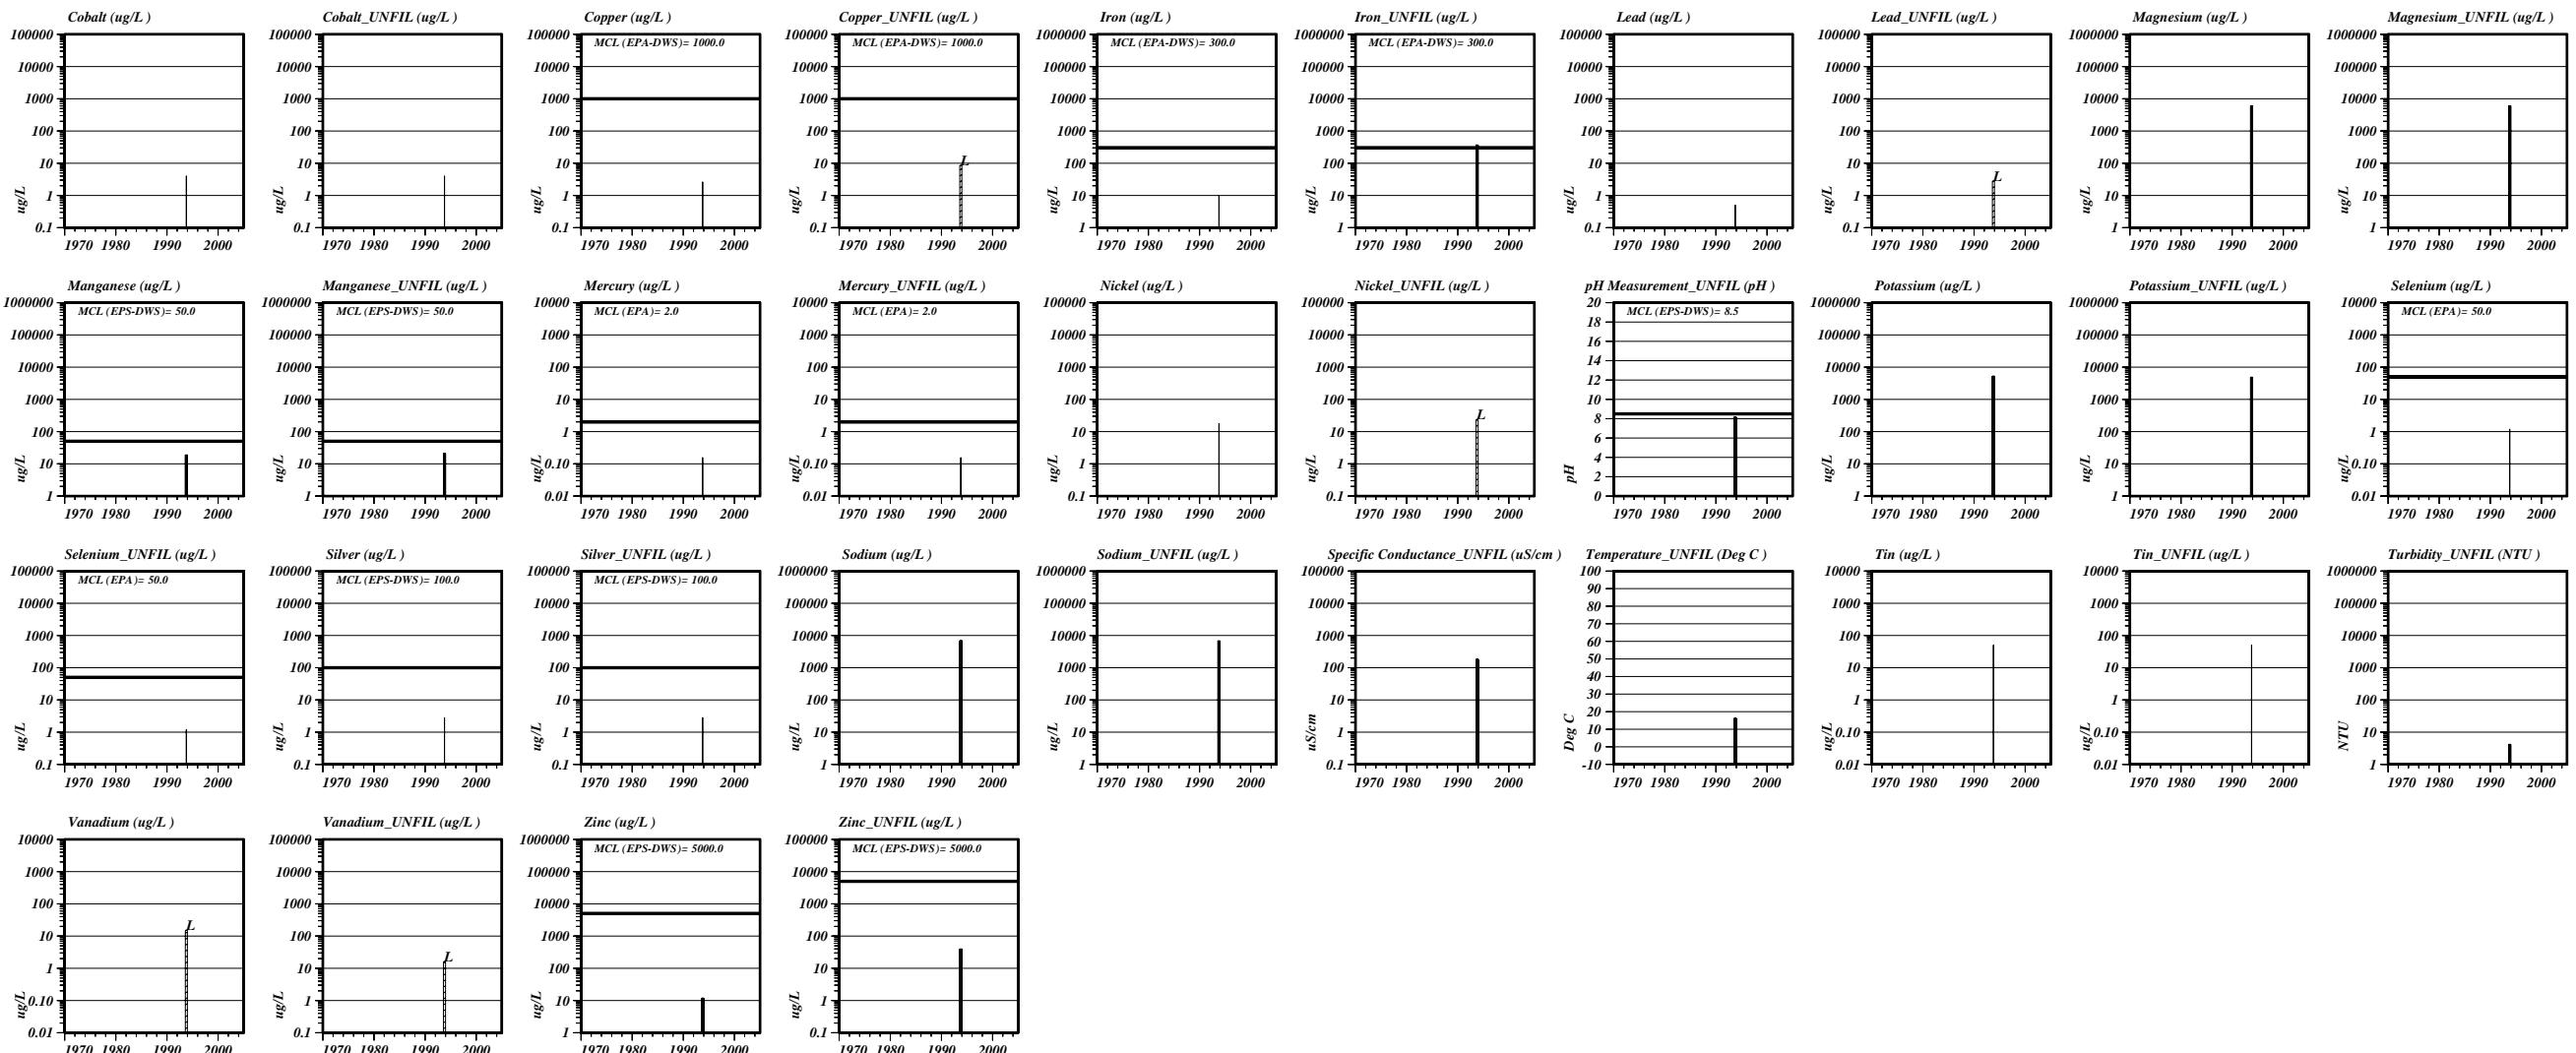

## PEST/PCB, HERB, & DIOXINS

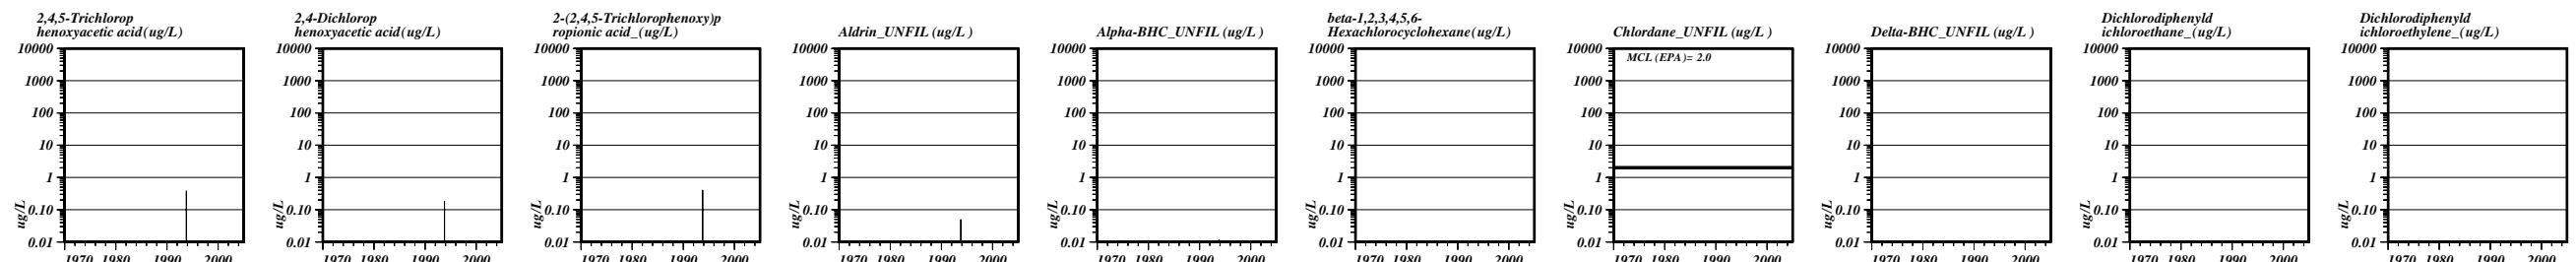













LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

**DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS**

**wellseries-200-299 WELL#=299-E25-50**

**PEST/PCB, HERB, & DIOXINS**

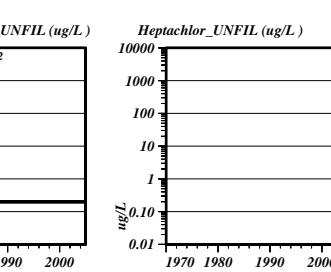

**GENCHEM & ORGANICS & GENORGANICS NO DATA AVAILABLE**

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag