

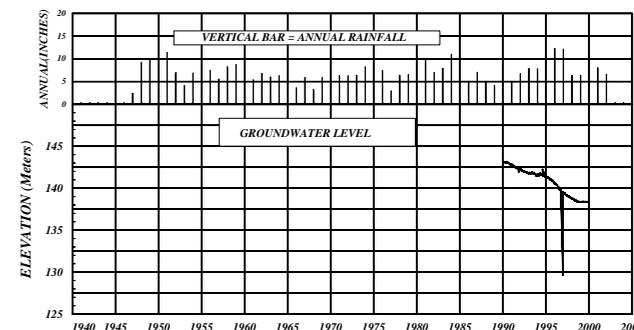
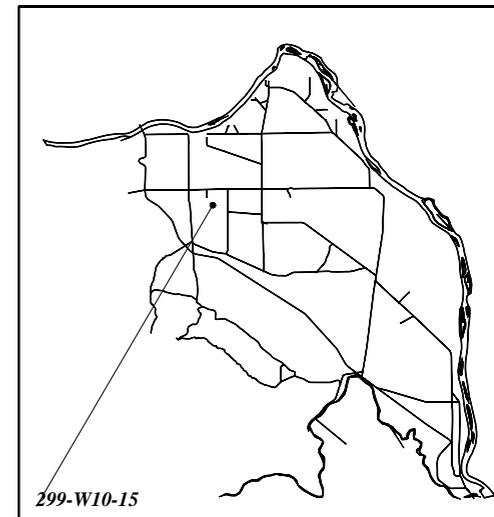
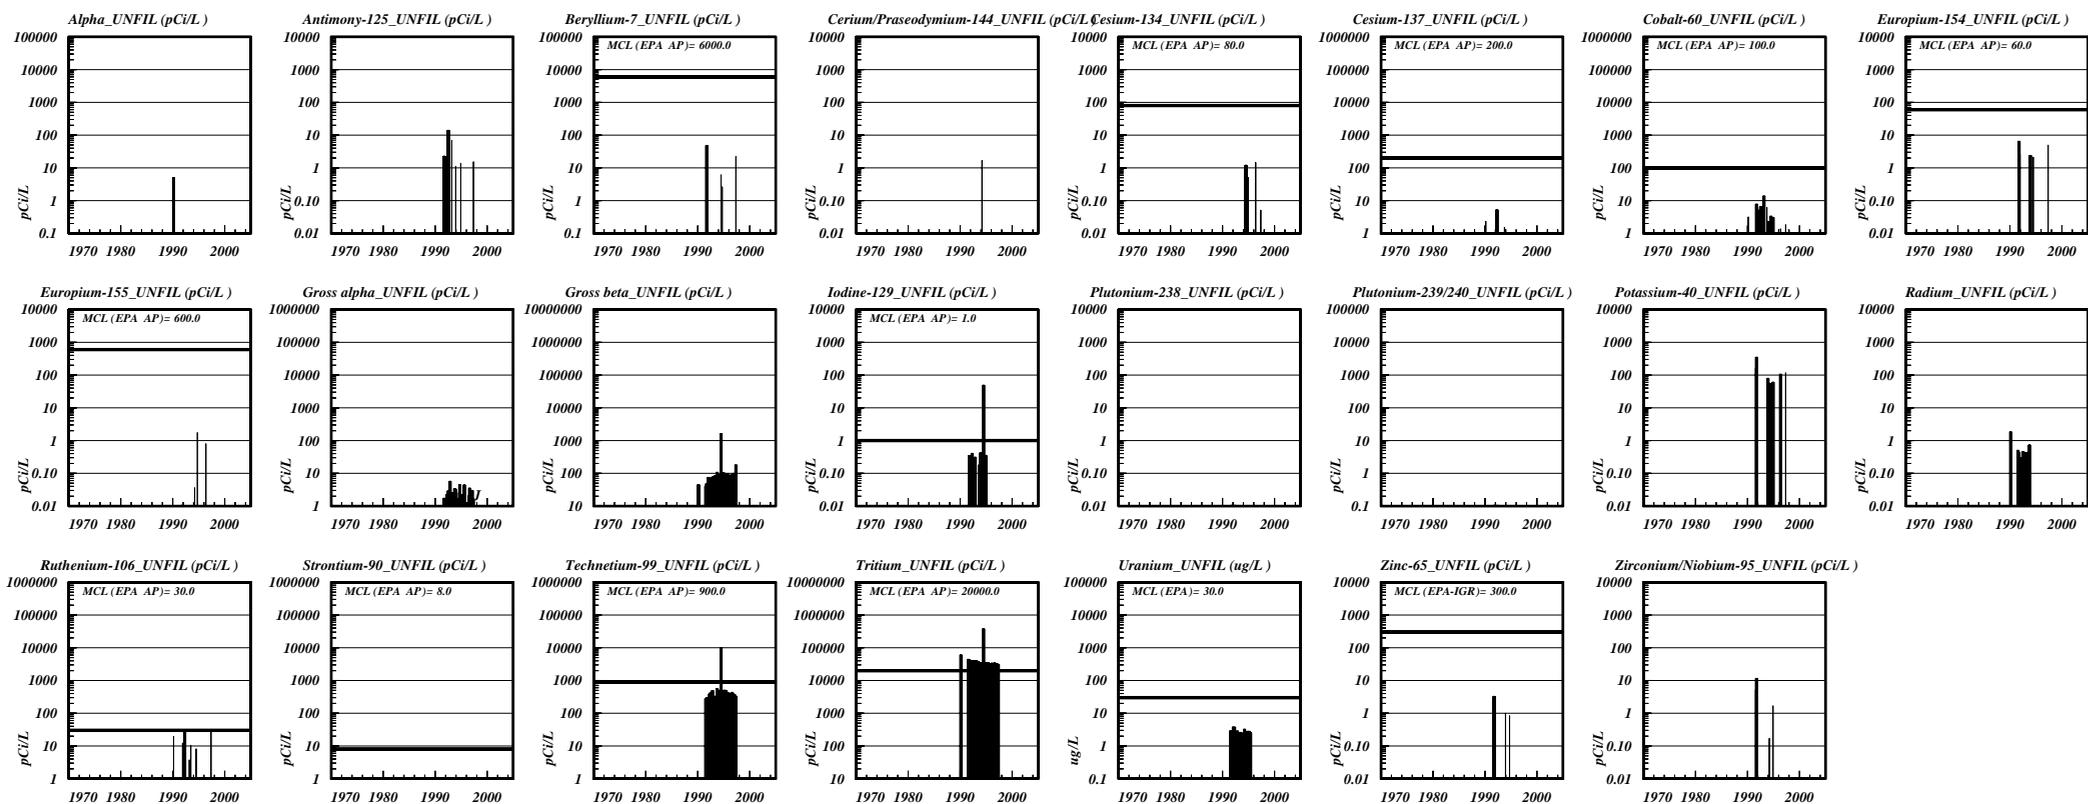


**RADIONUCLIDES**

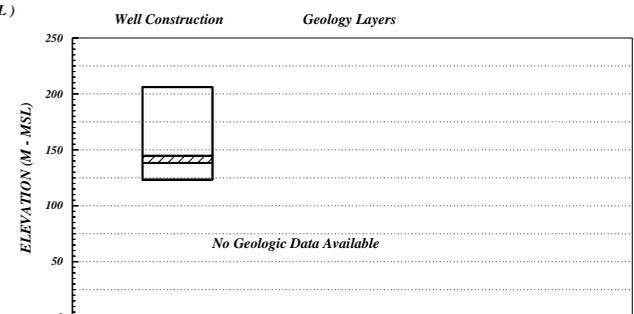

**VOLATILE ORGANIC COMPOUNDS**

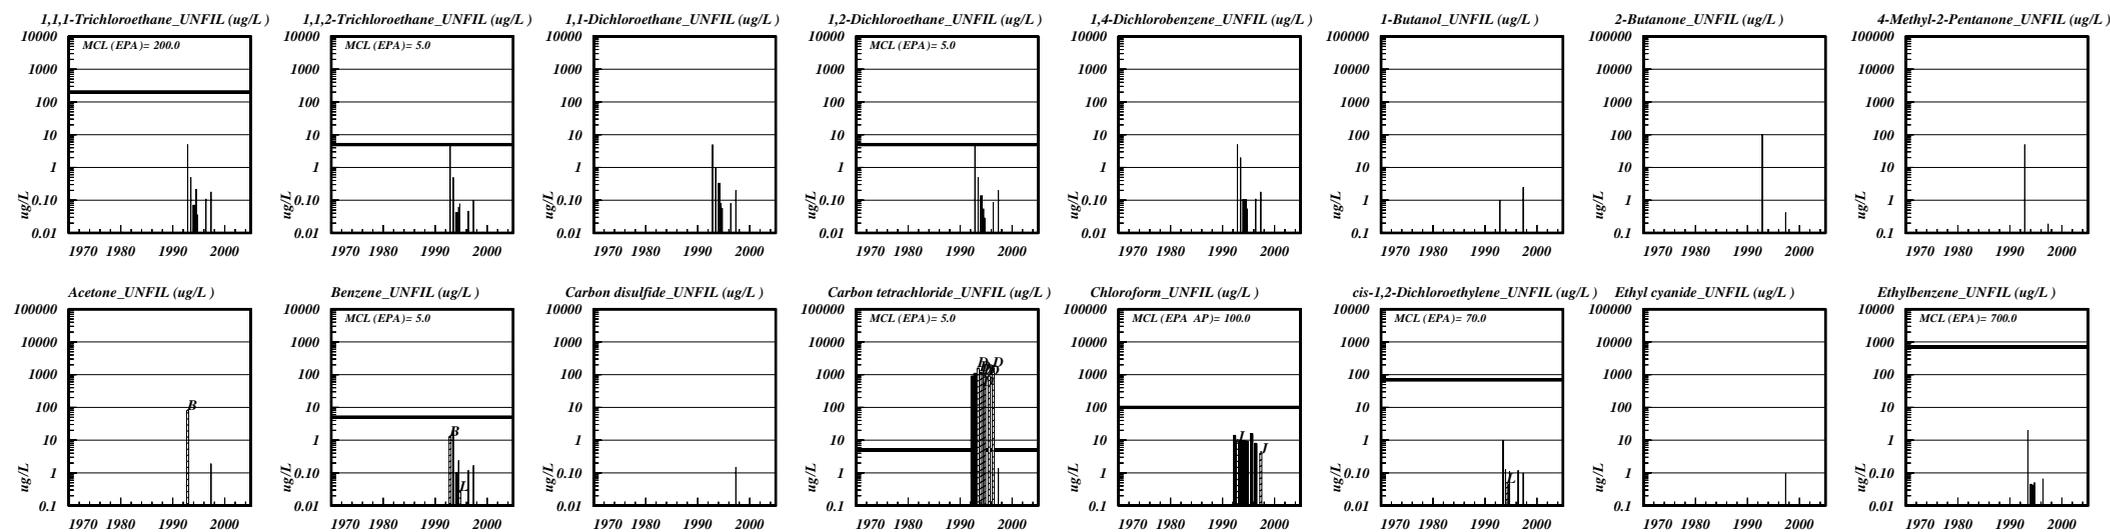


**WELLNAME=299-W10-15 WELLID=A4892**  
 Well Type=STANDARD Well purpose=GROUNDWATER  
 Owner=DOE Contact=BHI Well Adm Compliance=NON-COMPLIANT  
 X-coor= 566770.40 Y-coor= 136808.10 Datum=NAD83(91) Date Survey= 9/30/1994  
 Elevation= 206.00 Datum=NAVD88 Date Survey=06/22/94  
 Ref\_Point\_Desc=BRASS CAP Ref\_Point\_side=NONE Contractor=USACE(JECA)  
 Total Number of perforation Intervals=1  
 NPERF#=1 Perf\_top= 73.46 Bot= 82.60 m Cas\_size= 8.00in Perf\_cuts= 0.00 ft  
 Total Number of Screen Intervals=1  
 Screen#=1 Screen\_diam= 4.00 in Top= 61.25 Bottom= 67.65 m Slot\_size= 0.01 in  
 Screen\_material=Stainless Steel  
 Total Number of Seals=7  
 Seal#-1 Depth\_top=-0.15 Bottom= 0.61 m Material=Concrete  
 Seal#-2 Depth\_top= 0.61 Bottom= 5.97 m Material=Cement Grout  
 Seal#-3 Depth\_top= 5.97 Bottom= 22.04 m Material=Granular Bentonite  
 Seal#-4 Depth\_top= 22.04 Bottom= 42.92 m Material=Bentonite Slurry  
 More Information is at <http://www.envirodataaccess.com/wellfiles/299-W10-15.htm>


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


**VOLATILE ORGANIC COMPOUNDS**

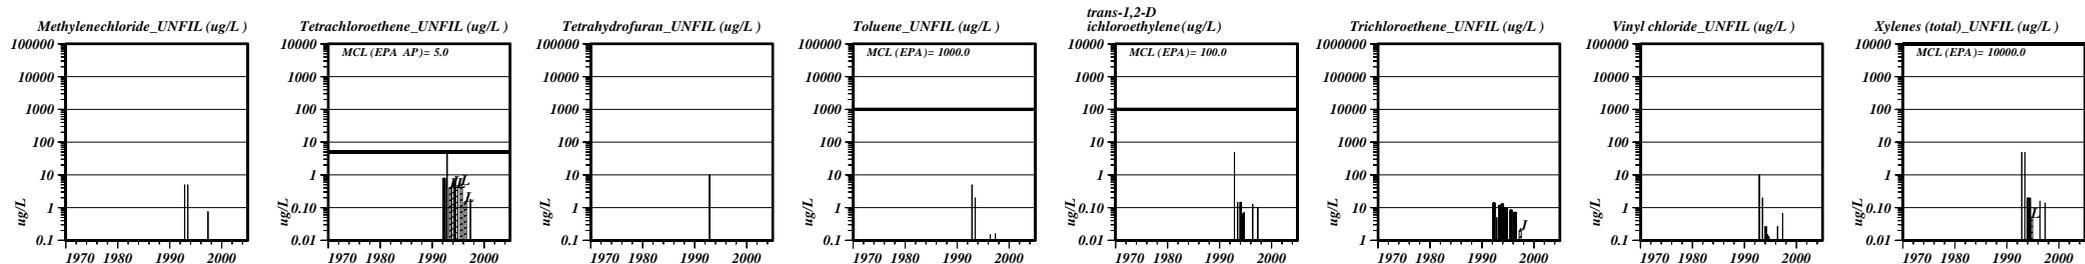

**SEMI-VOLATILE ORGANIC COMPOUNDS**

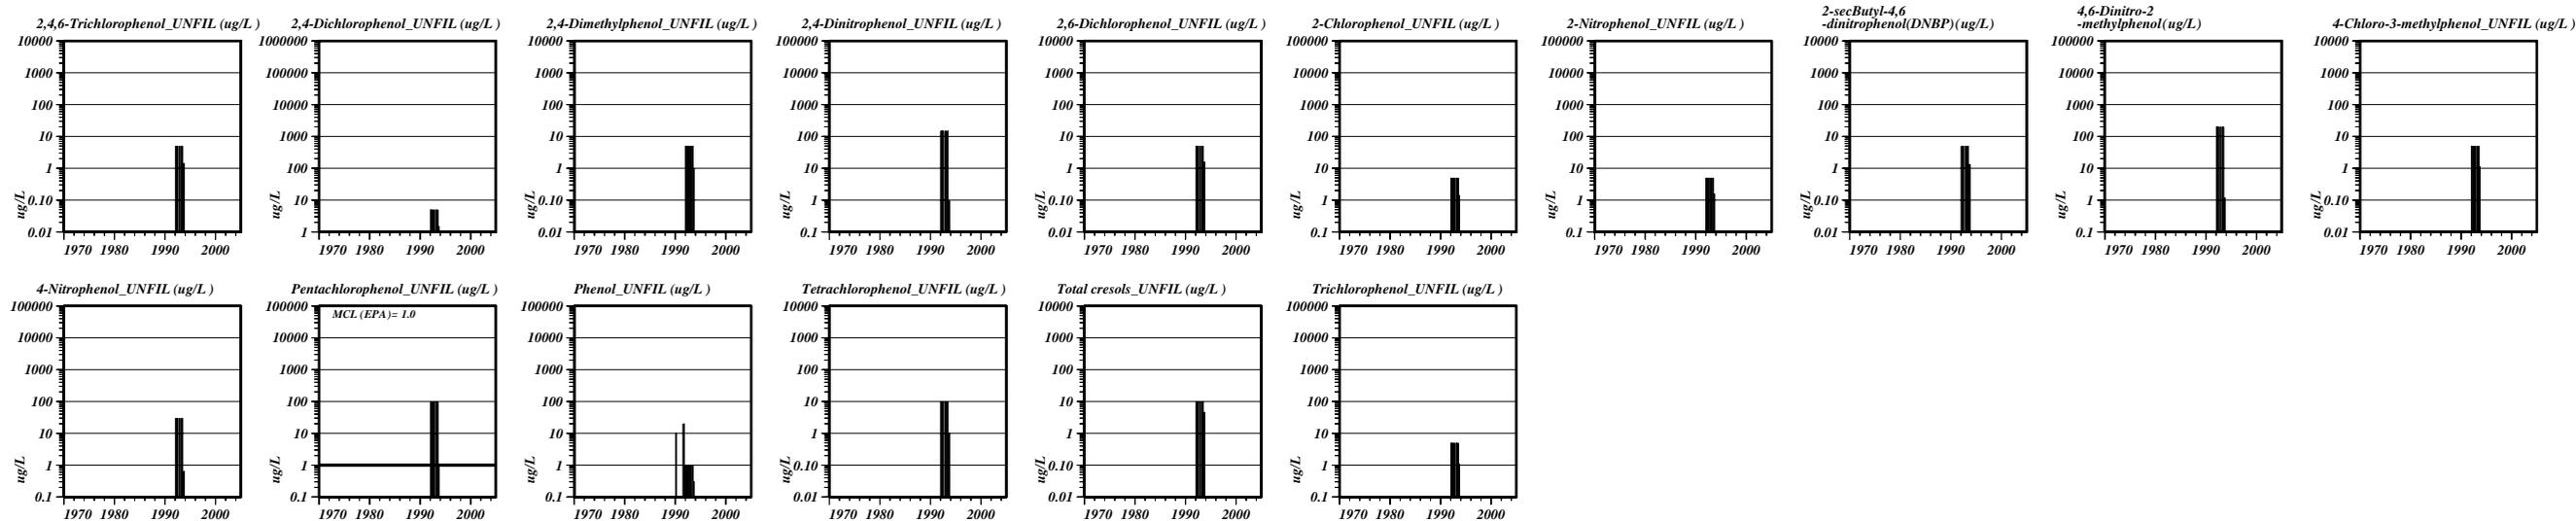


**METALS & PHYSICAL PARAMETERS**

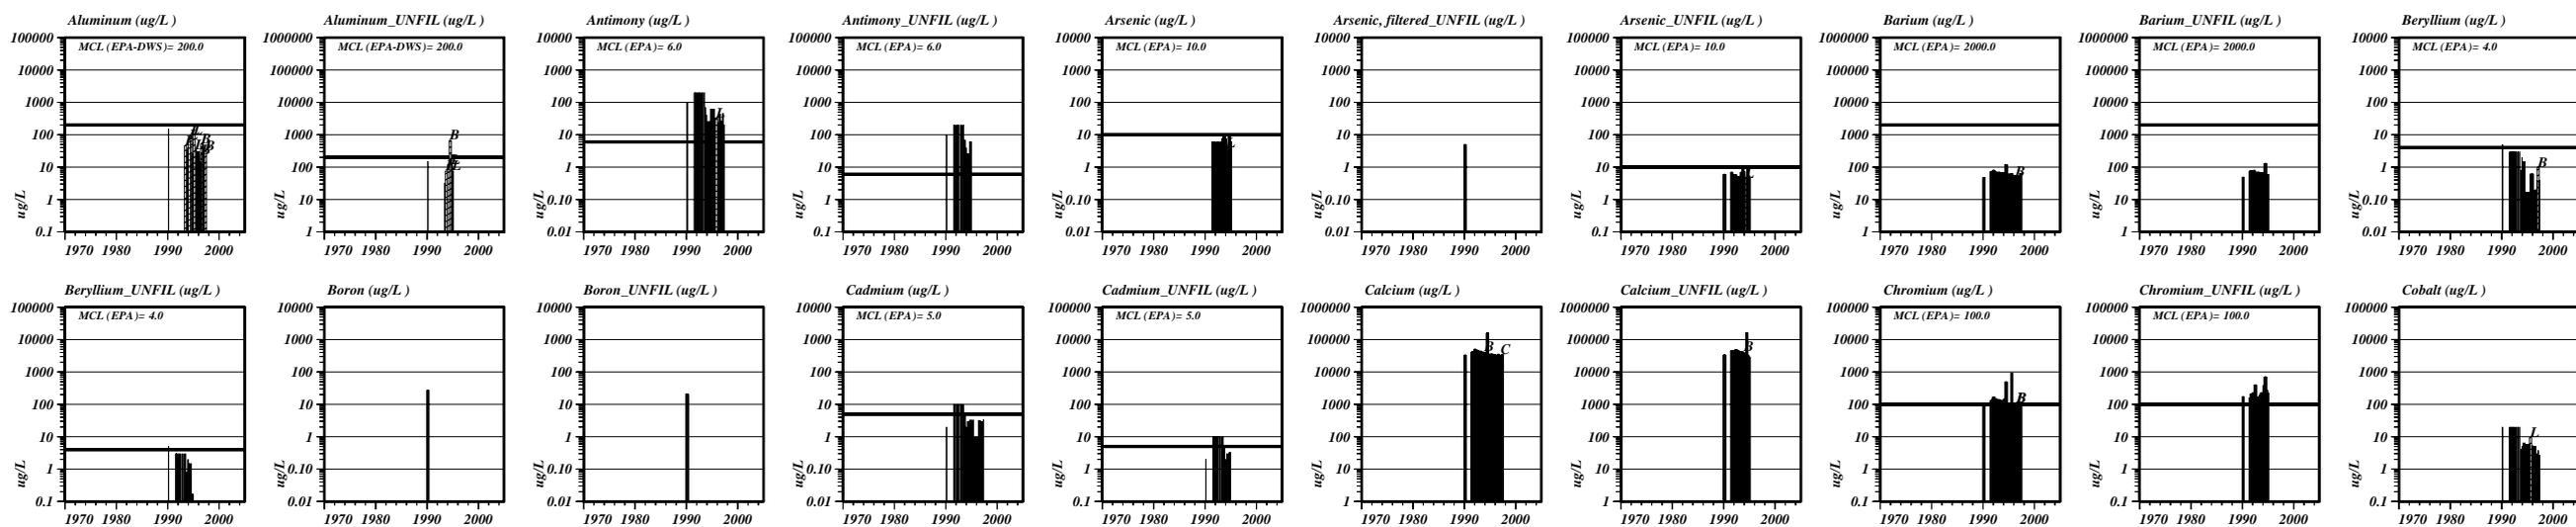

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

METALS & PHYSICAL PARAMETERS

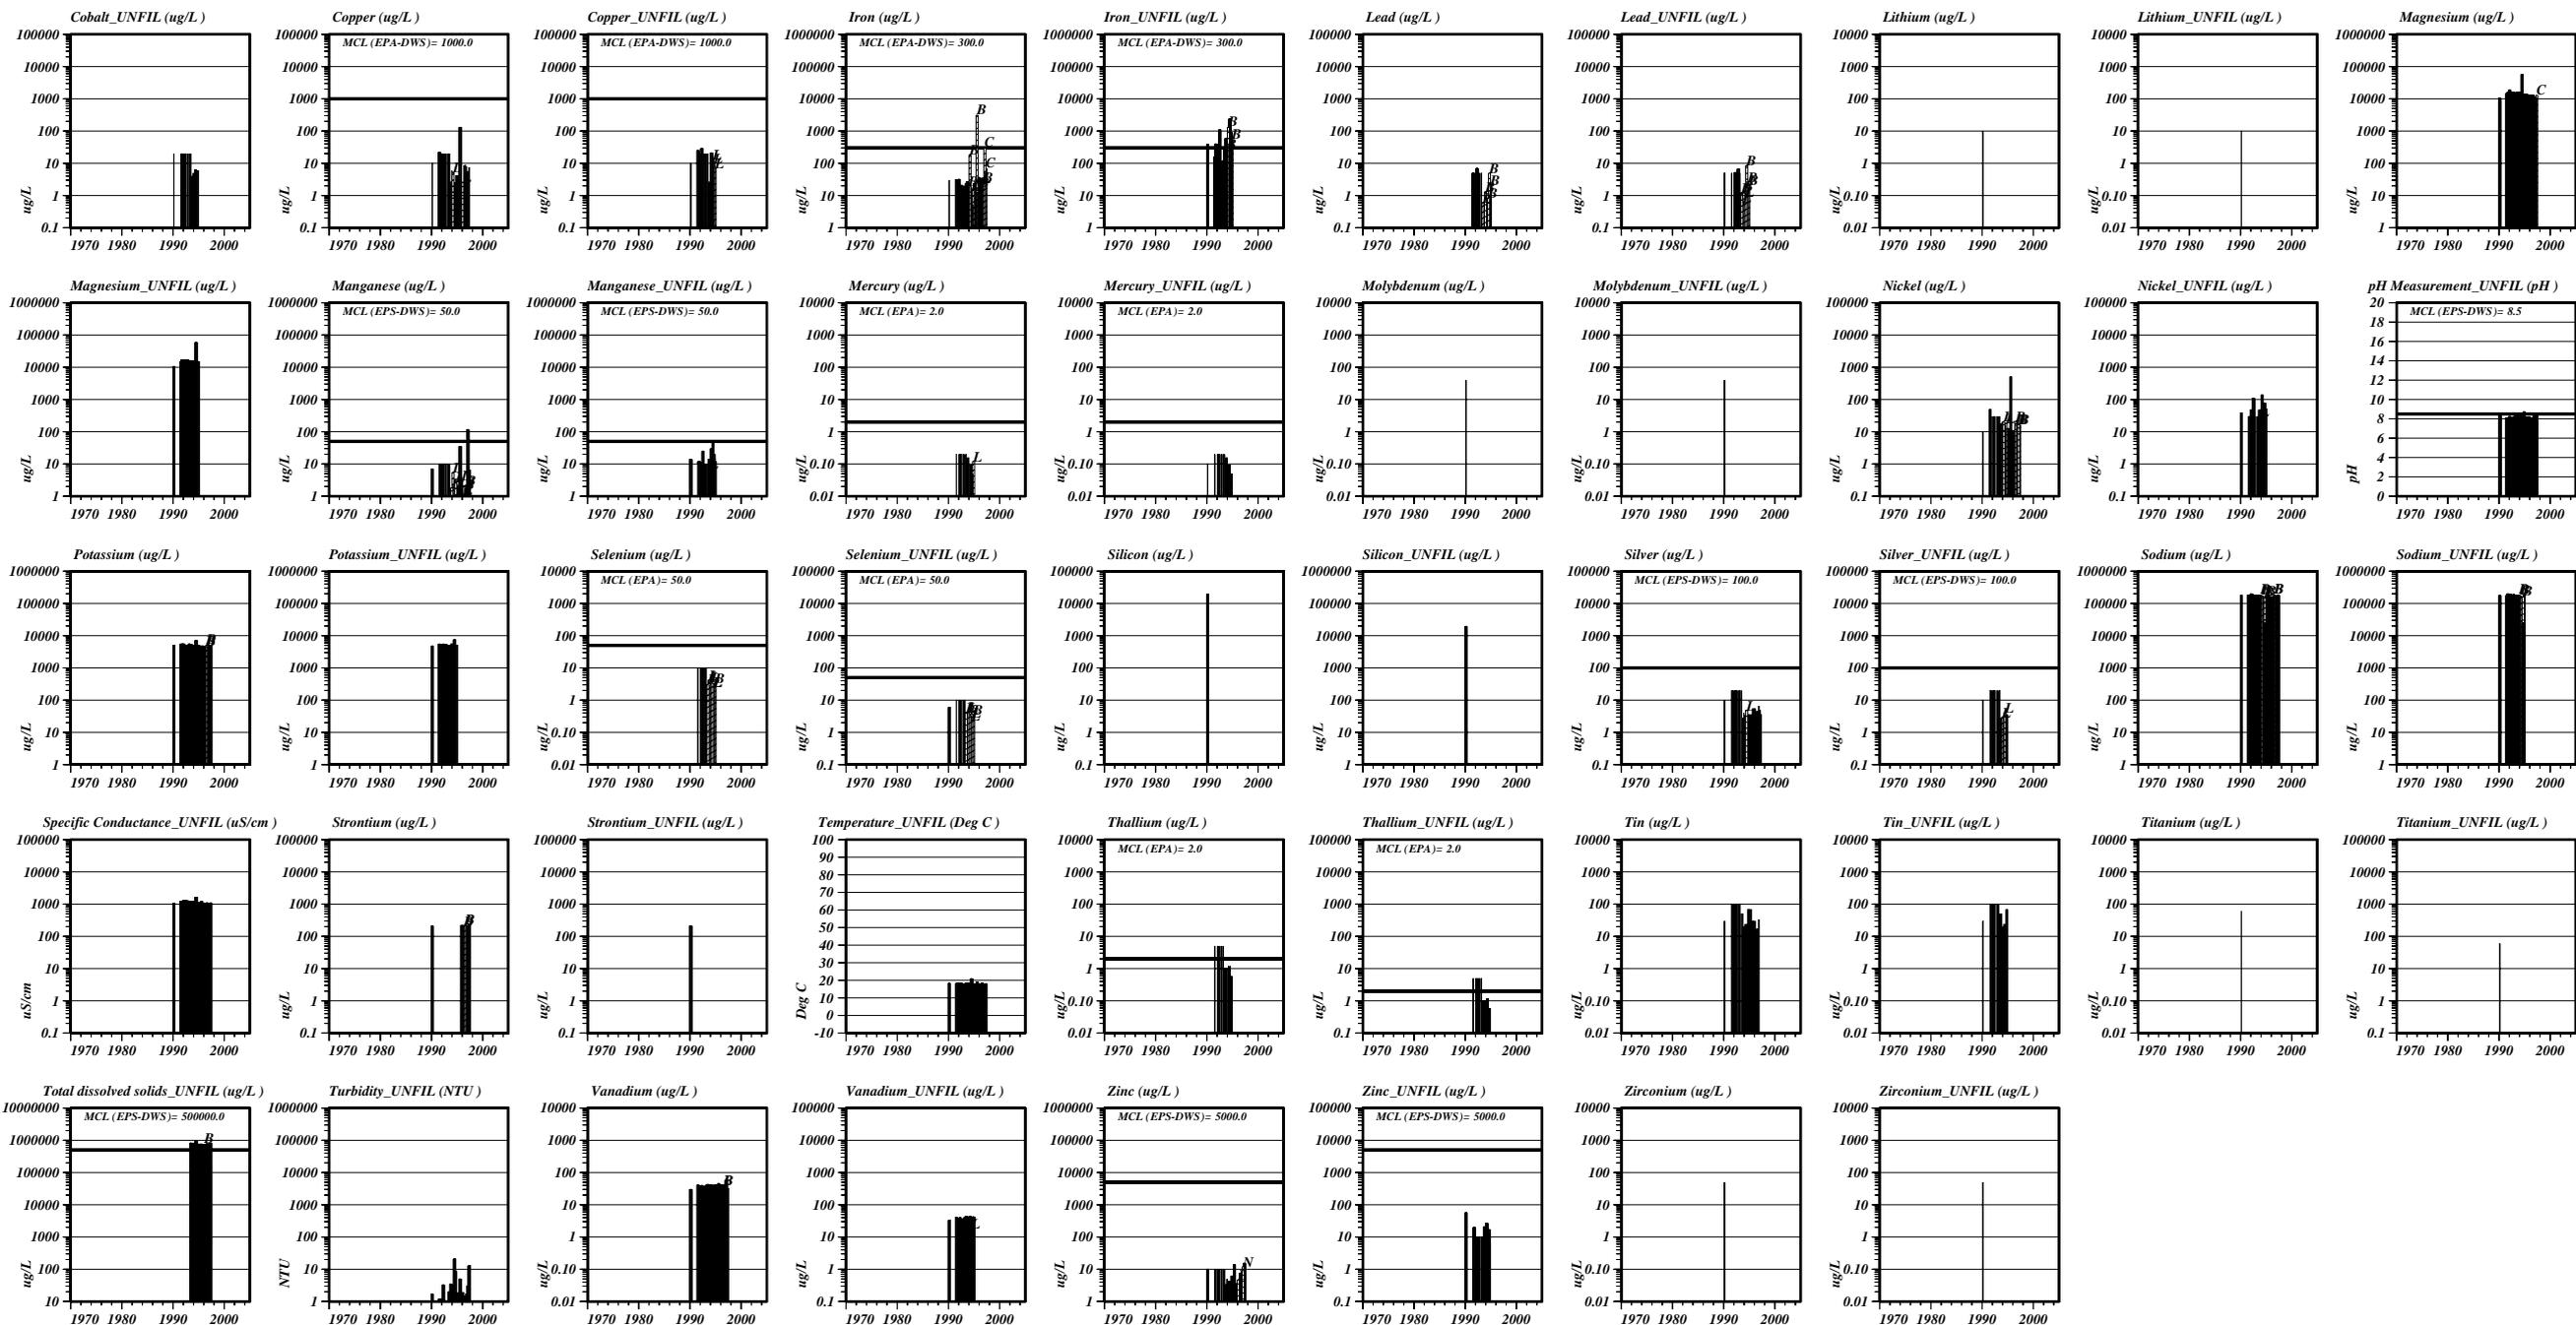


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;


EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

PEST/PCB, HERB, & DIOXINS

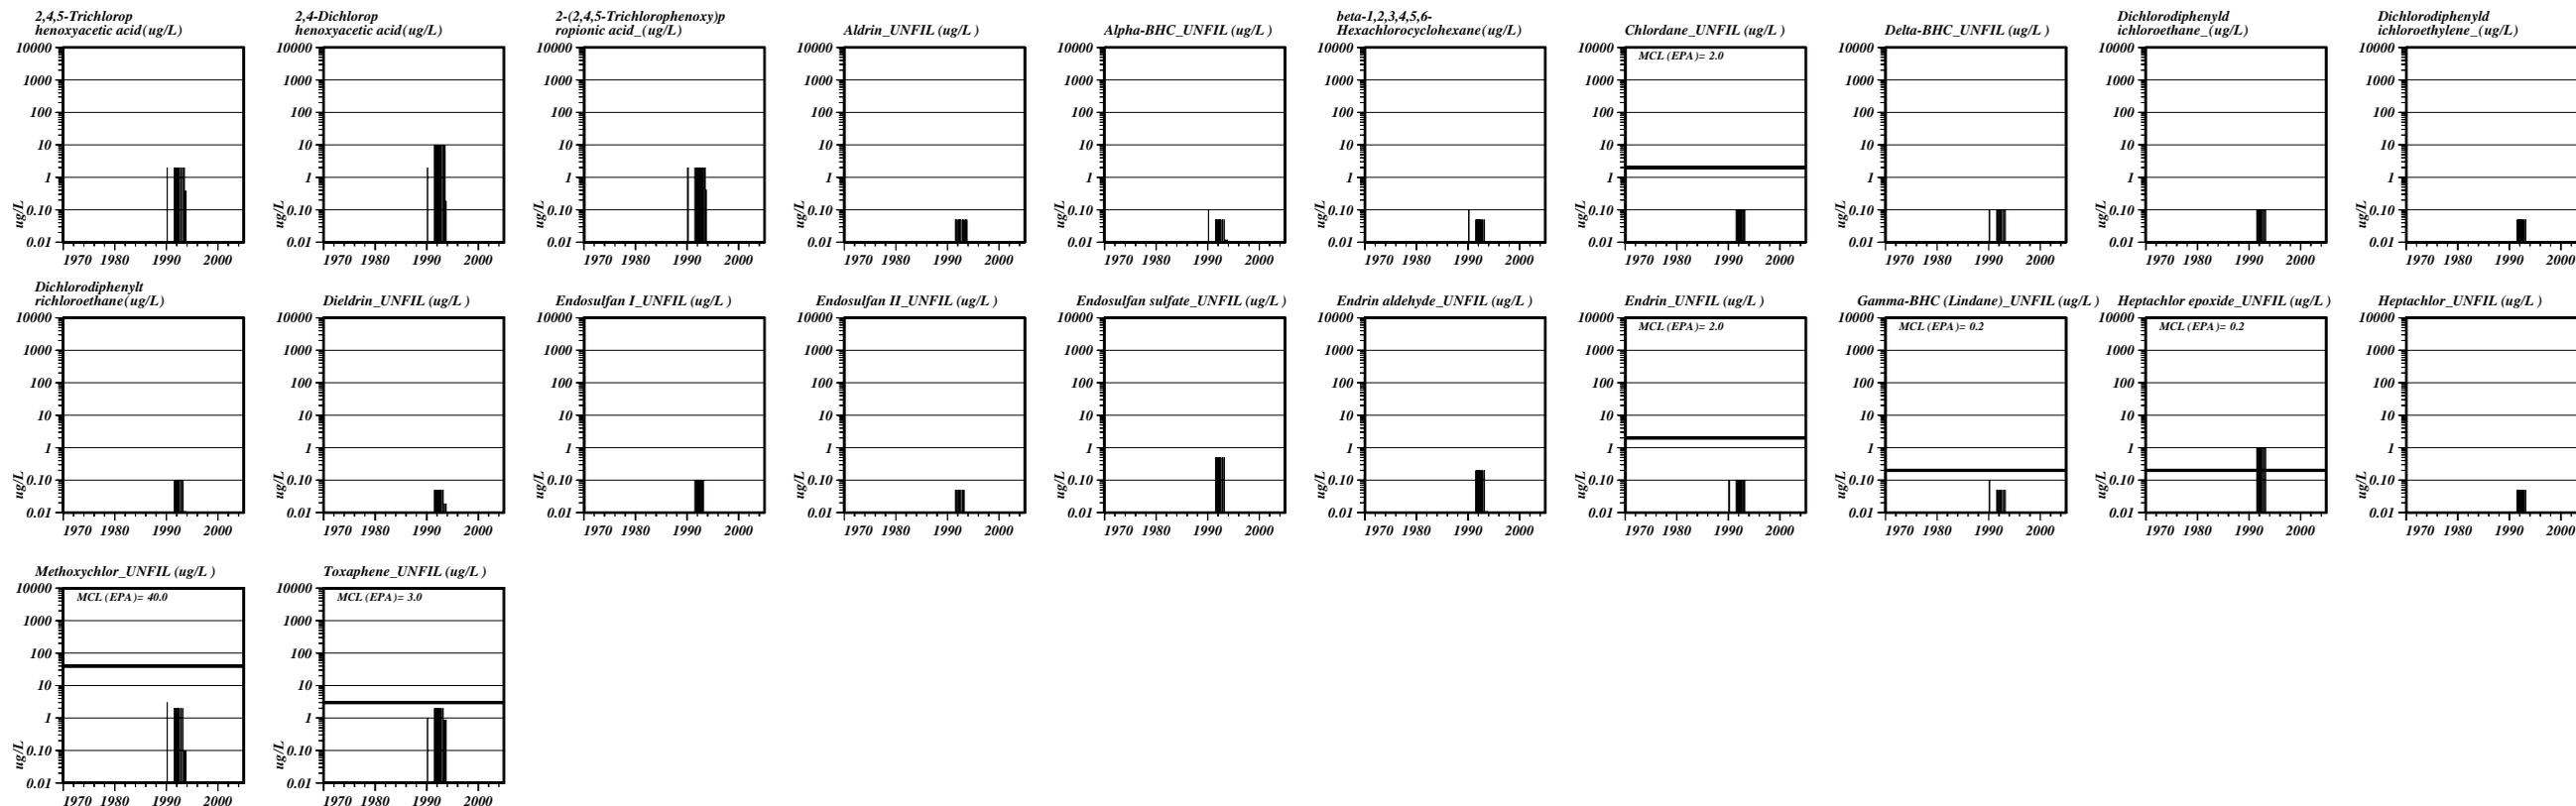

GENCHEM & ORGANICS & GENORGANICS



LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag