DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS wellseries-200-299 WELL#=299-W18-25

RADIONUCLIDES

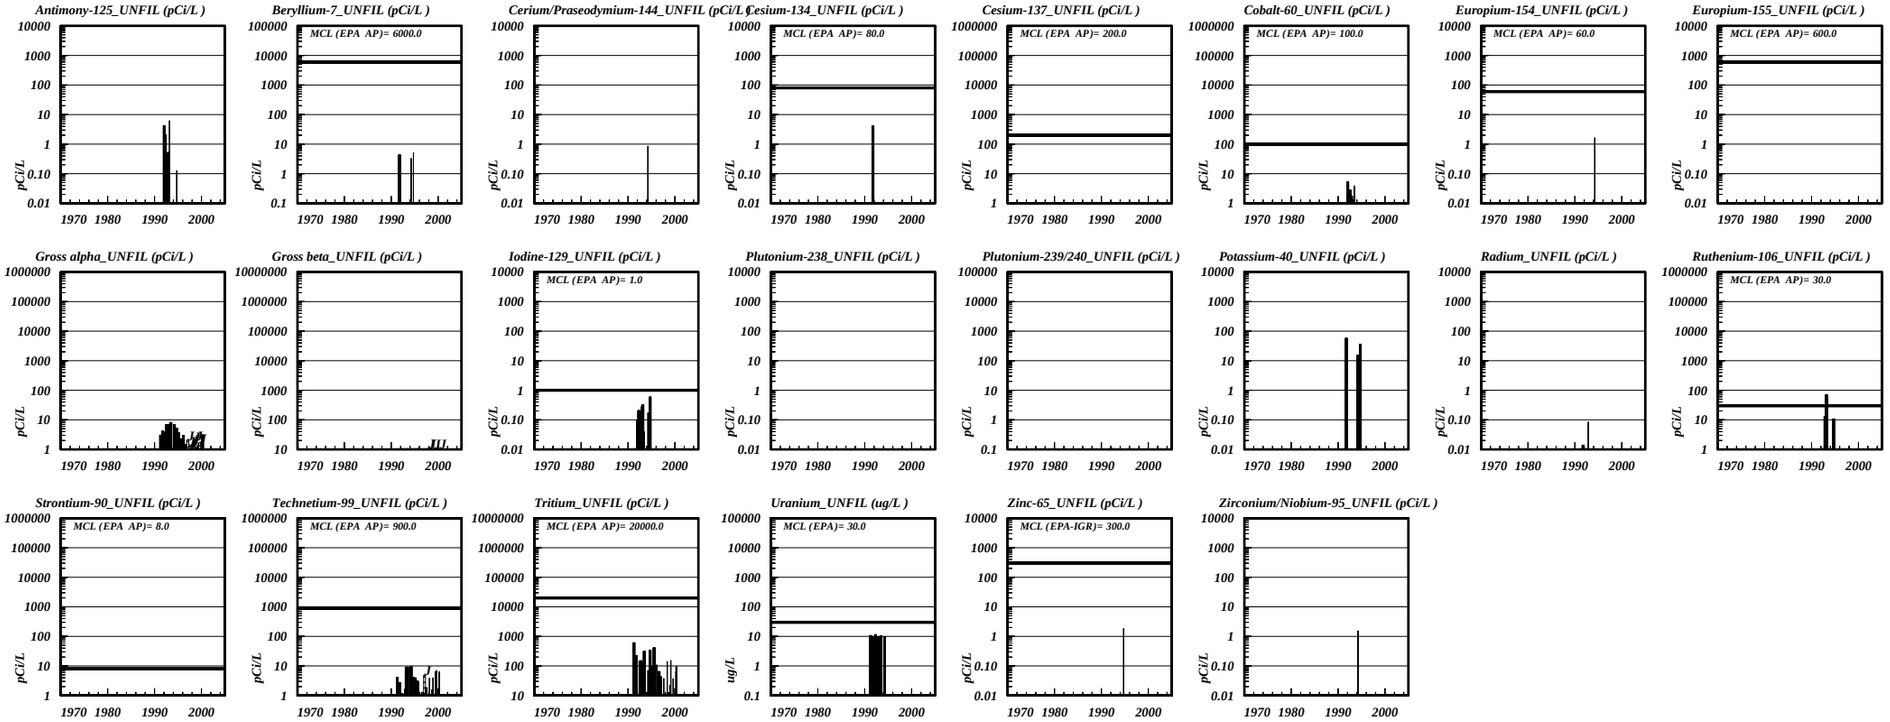

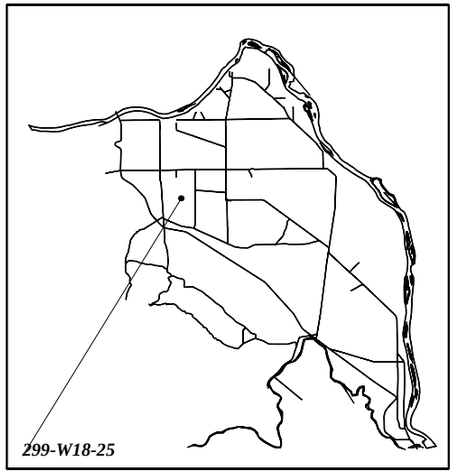

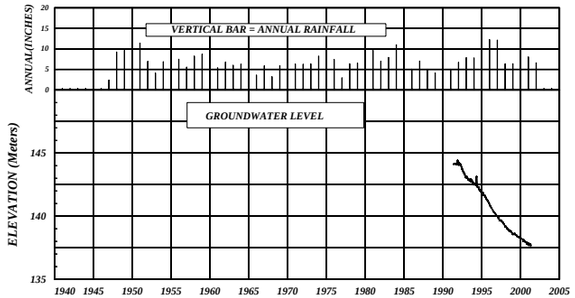

VOLATILE ORGANIC COMPOUNDS

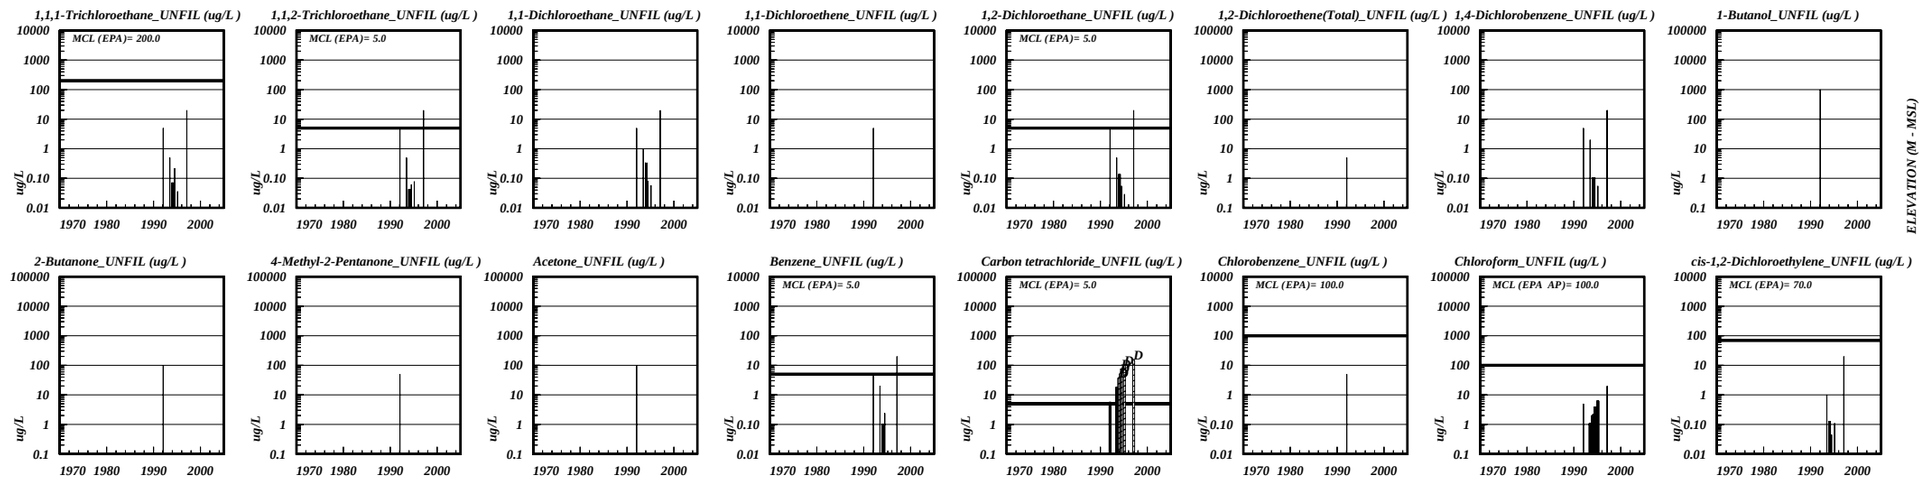

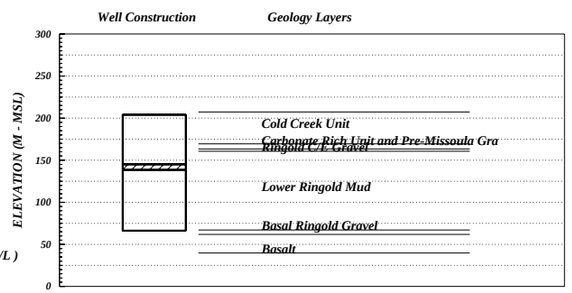

WELLNAME=299-W18-25 WELLID=A4937

Well Type=STANDARD Well purpose=GROUNDWATER
Owner=DOE ContactBHI Well Adm Compliance=NON-COMPLIANT
X_coor= 566721.50 Y-coor= 134978.20 Datum=NAD83 Date Survey= 4/1/1991
Elevation= 204.001 Datum=NGVD29 Date Survey=04/01/91
Ref_Point_Desc=TOP OF PLATE Ref_Point_side=N Contractor=KEH
Total Number of perforation Intervals=1
NPERF#=1 Perf_top= 144.03 Bot= 137.63 MCas_size= 0.00 Perf_cuts= 0.00
Total Number of Screen Intervals=1
Screen#=1 Screen_diam= 4.00 in Top= 58.98 Bottom= 65.47 m Slot_size= 0.01 in
Screen_material=Stainless Steel
Total Number of Seals=8
Seal#=1 Depth_top=-0.09 Bottom= 0.67 m Material=Concrete
Seal#=2 Depth_top= 0.67 Bottom= 6.07 m Material=Cement Grout
Seal#=3 Depth_top= 6.07 Bottom= 38.98 m Material=Granular Bentonite
Seal#=4 Depth_top= 38.98 Bottom= 43.59 m Material=Hole Plug Bentonite
More Information is at http://www.envirodataaccess.com/wellfiles/299-W18-25.htm

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

U.S. DOE Richland Office. Data Processed by Consultants For Environmental System Technologies (CFEST Inc.) Copyright 2003 Thu Jul 3 19:12:13 2003 WELL PAGE#=1

DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS wellseries-200-299 WELL#=299-W18-25

VOLATILE ORGANIC COMPOUNDS

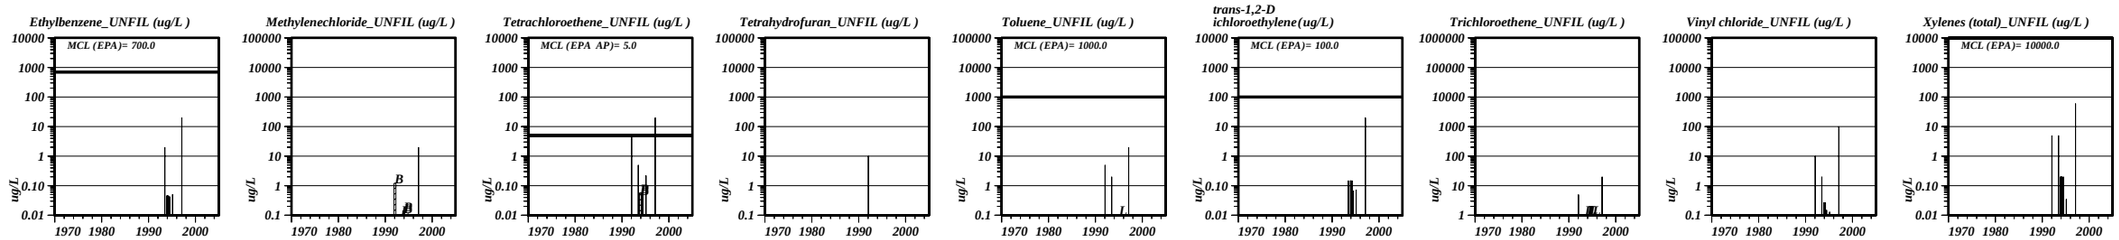

SEMI-VOLATILE ORGANIC COMPOUNDS

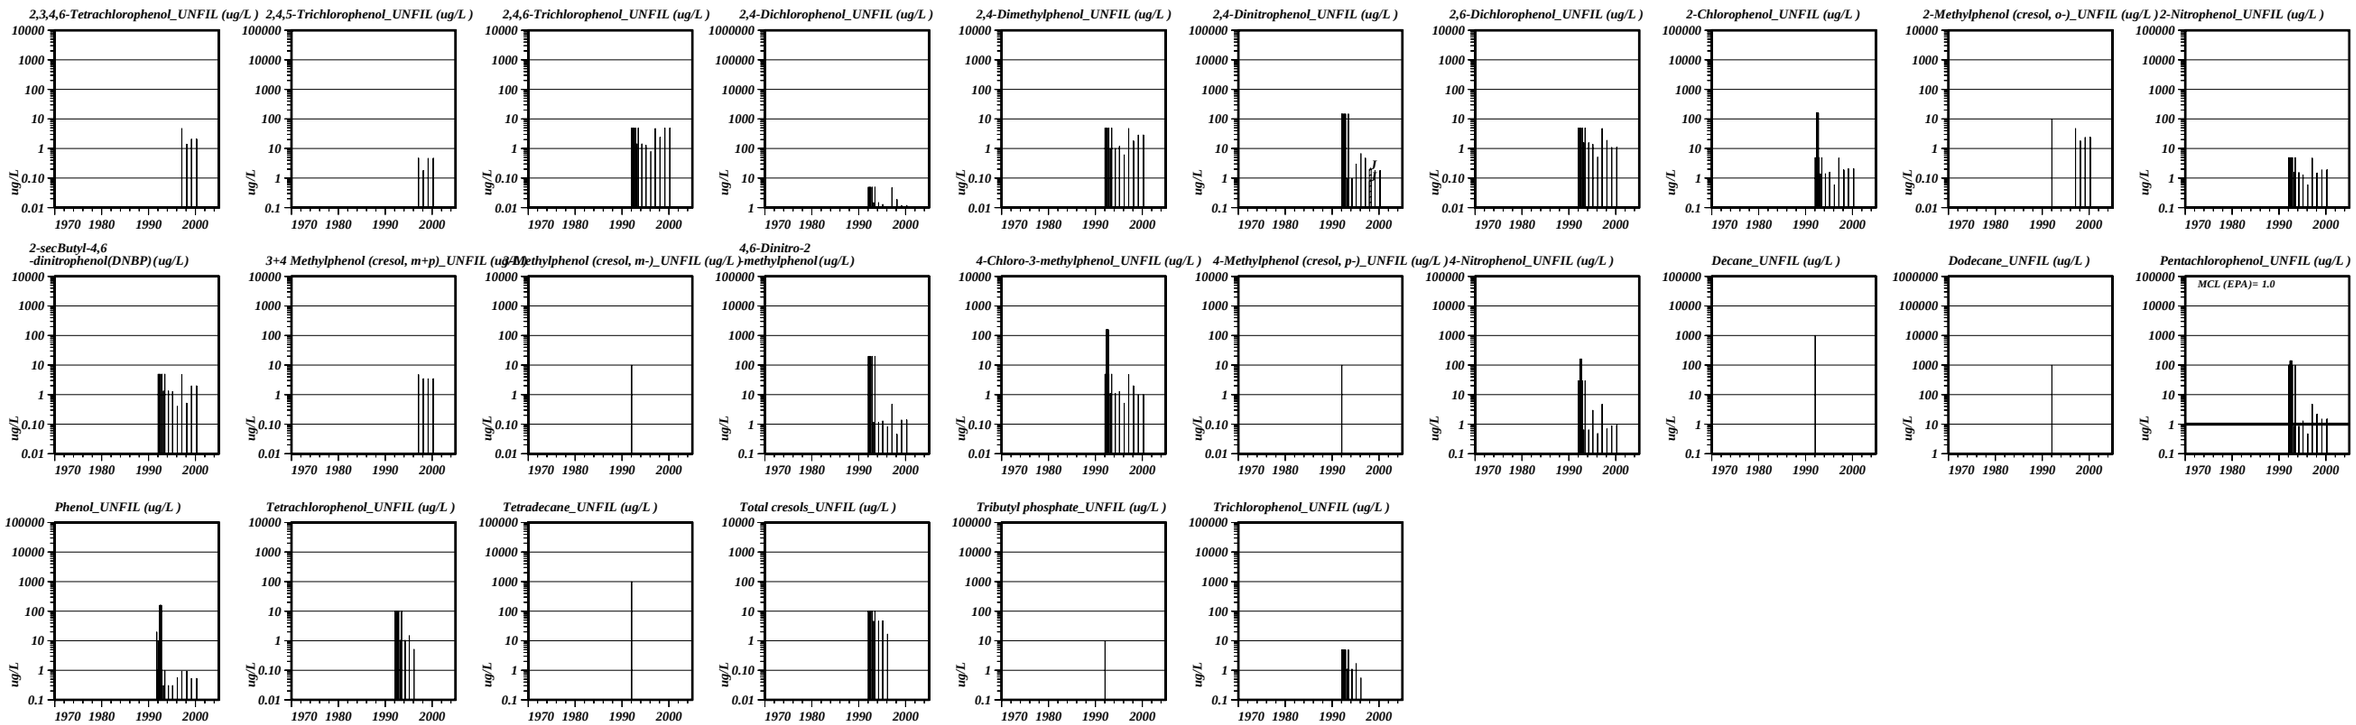

METALS & PHYSICAL PARAMETERS

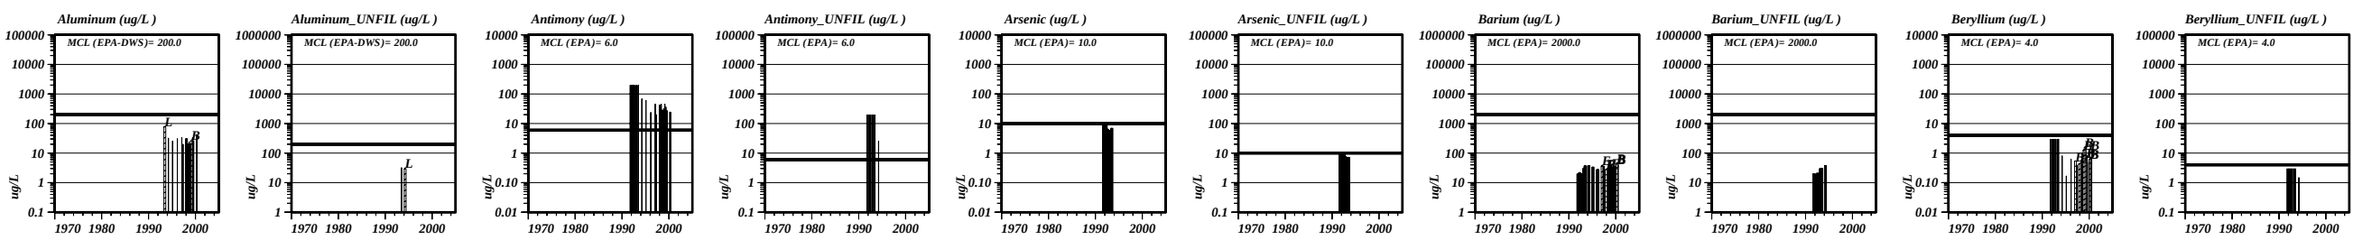

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

U.S. DOE Richland Office. Data Processed by Consultants For Environmental System Technologies (CFEST Inc.) Copyright 2003 Thu Jul 3 19:12:14 2003 WELL PAGE#= 2

DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS wellseries-200-299 WELL#=299-W18-25

METALS & PHYSICAL PARAMETERS

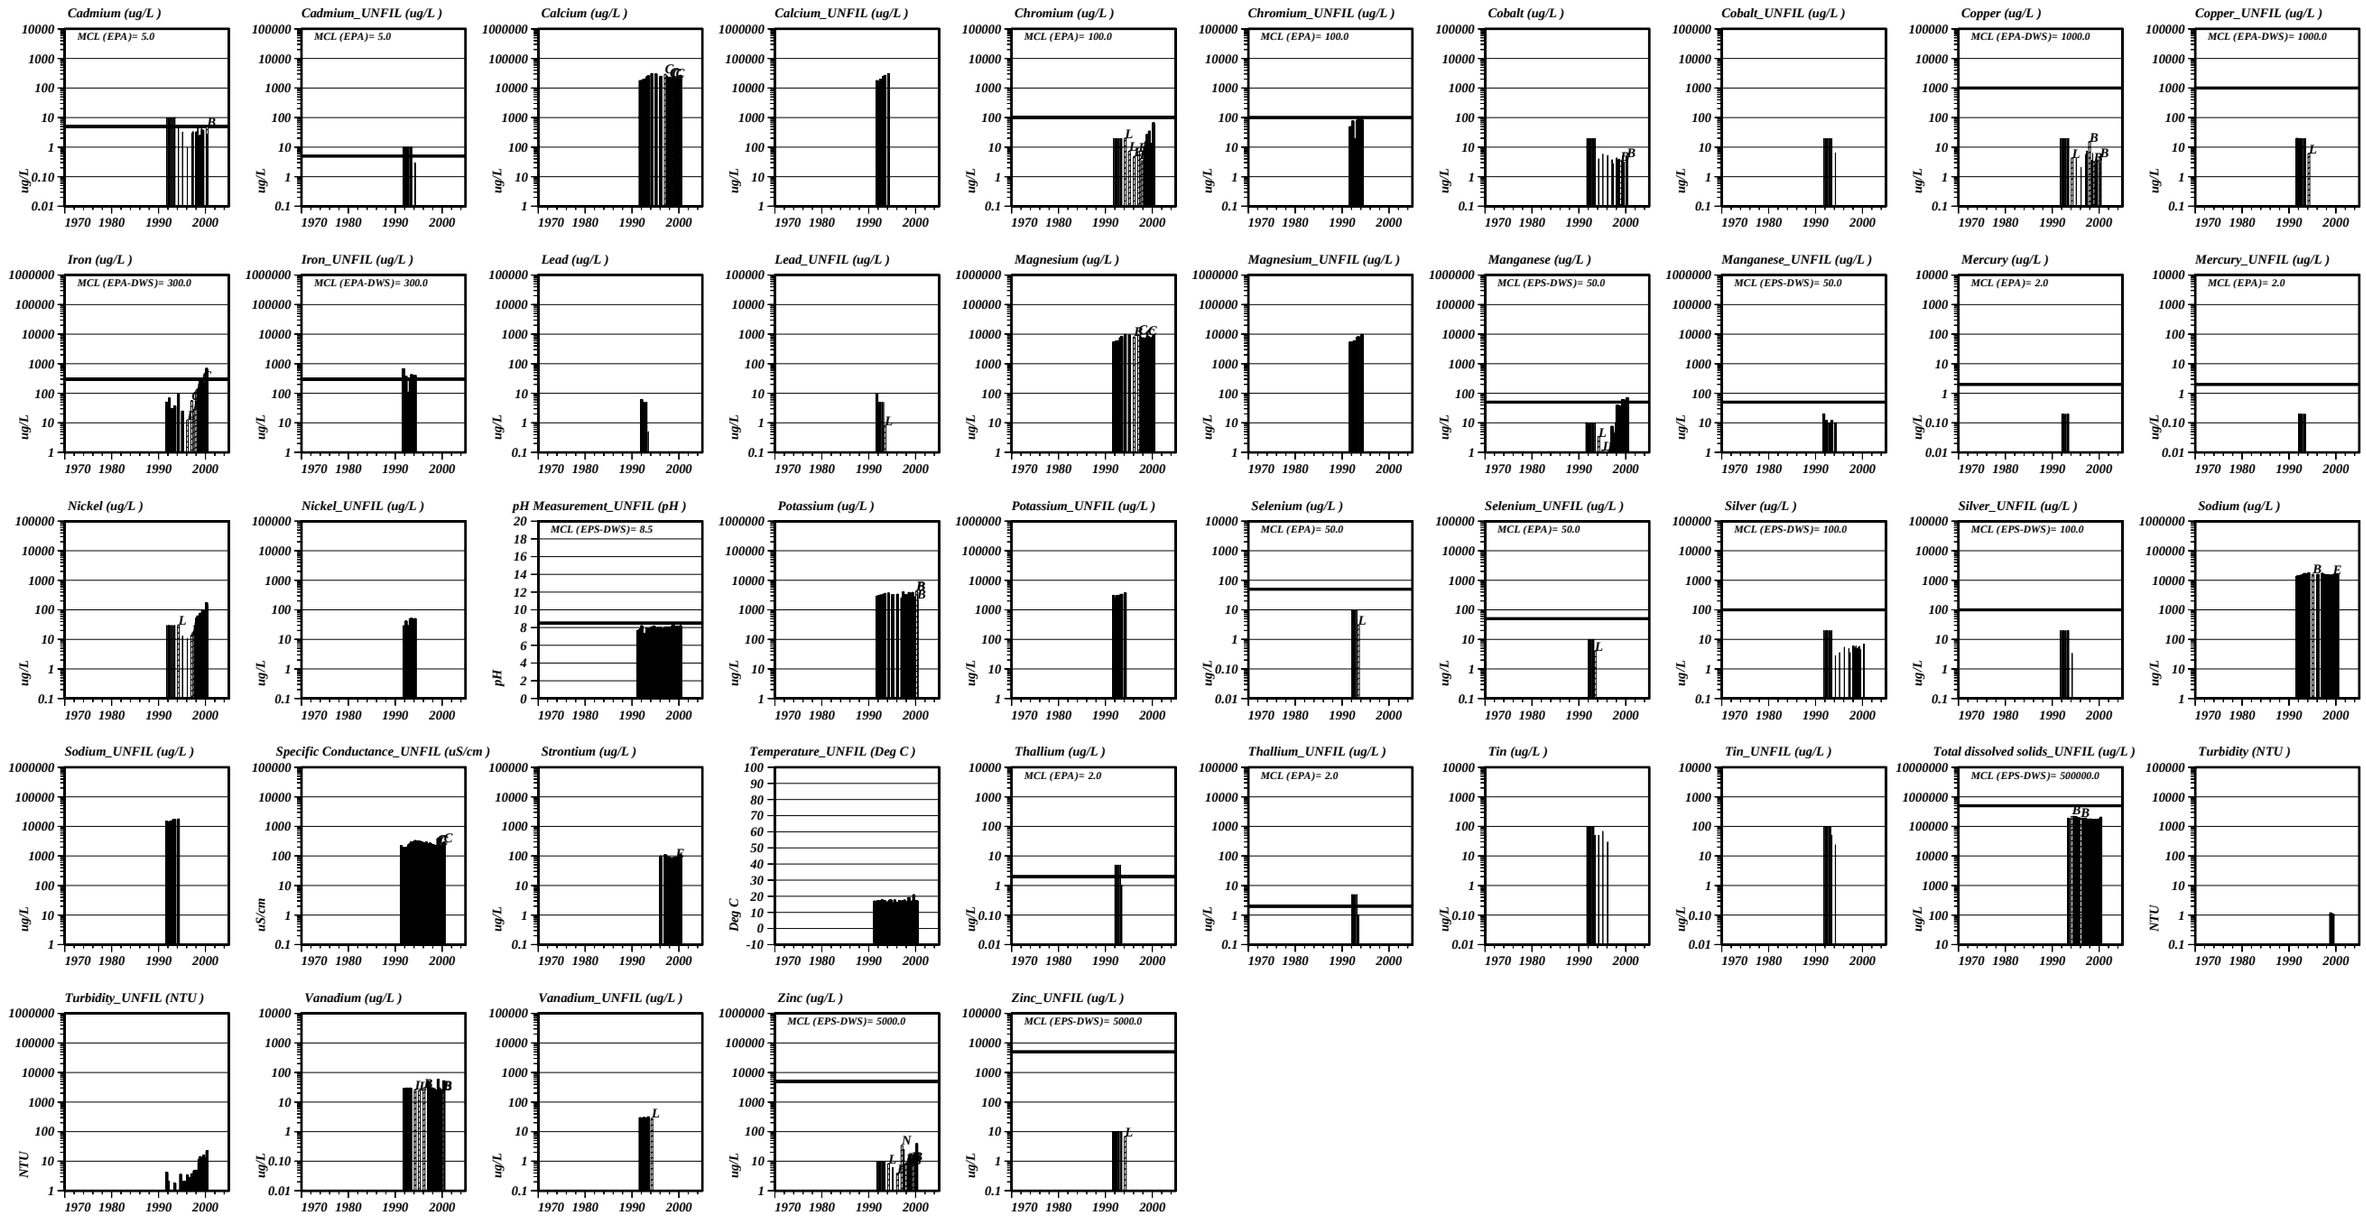

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

U.S. DOE Richland Office. Data Processed by Consultants For Environmental System Technologies (CFEST Inc.) Copyright 2003. Thu Jul 3 19:12:17 2003. WELL PAGE#= 3

DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS wellseries-200-299 WELL#=299-W18-25

PEST/PCB, HERB, & DIOXINS

2,4,5-Trichlorop henoxyacetic acid(ug/L)



2,4-Dichlorop henoxyacetic acid(ug/L)



2-(2,4,5-Trichlorophenoxy)p ropionic acid_(ug/L)



Aldrin_UNFIL (ug/L)



Alpha-BHC_UNFIL (ug/L)



beta-1,2,3,4,5,6- Hexachlorocyclohexane(ug/L)



Chlordane_UNFIL (ug/L)



Delta-BHC_UNFIL (ug/L)



Dichlorodiphenyld ichloroethane_(ug/L)



Dichlorodiphenyld ichloroethylene_(ug/L)



Dichlorodiphenylt richloroethane(ug/L)



Dieldrin_UNFIL (ug/L)



Endosulfan I_UNFIL (ug/L)



Endosulfan II_UNFIL (ug/L)



Endosulfan sulfate_UNFIL (ug/L)



Endrin aldehyde_UNFIL (ug/L)



Endrin_UNFIL (ug/L)



Gamma-BHC (Lindane)_UNFIL (ug/L)



Heptachlor epoxide_UNFIL (ug/L)



Heptachlor_UNFIL (ug/L)



Methoxychlor_UNFIL (ug/L)



Toxaphene_UNFIL (ug/L)



GENCHEM & ORGANICS & GENORGANICS

Alkalinity (ug/L)



LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

U.S. DOE Richland Office. Data Processed by Consultants For Environmental System Technologies (CFEST Inc.) Copyright 2003 Thu Jul 3 19:12:18 2003 WELL PAGE#=4