
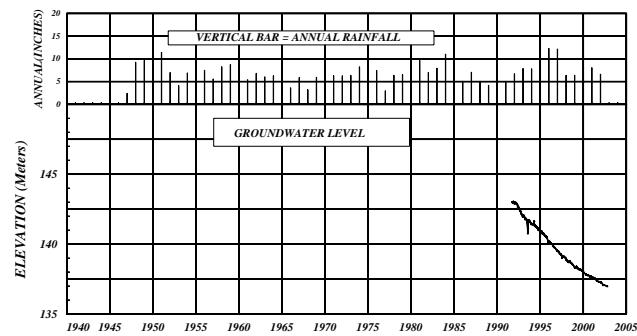
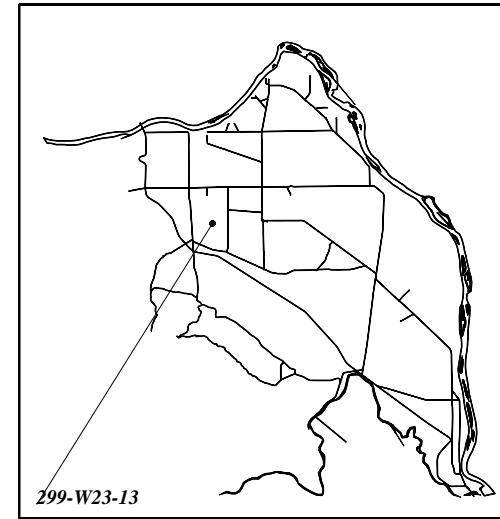




DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-W23-13

RADIONUCLIDES

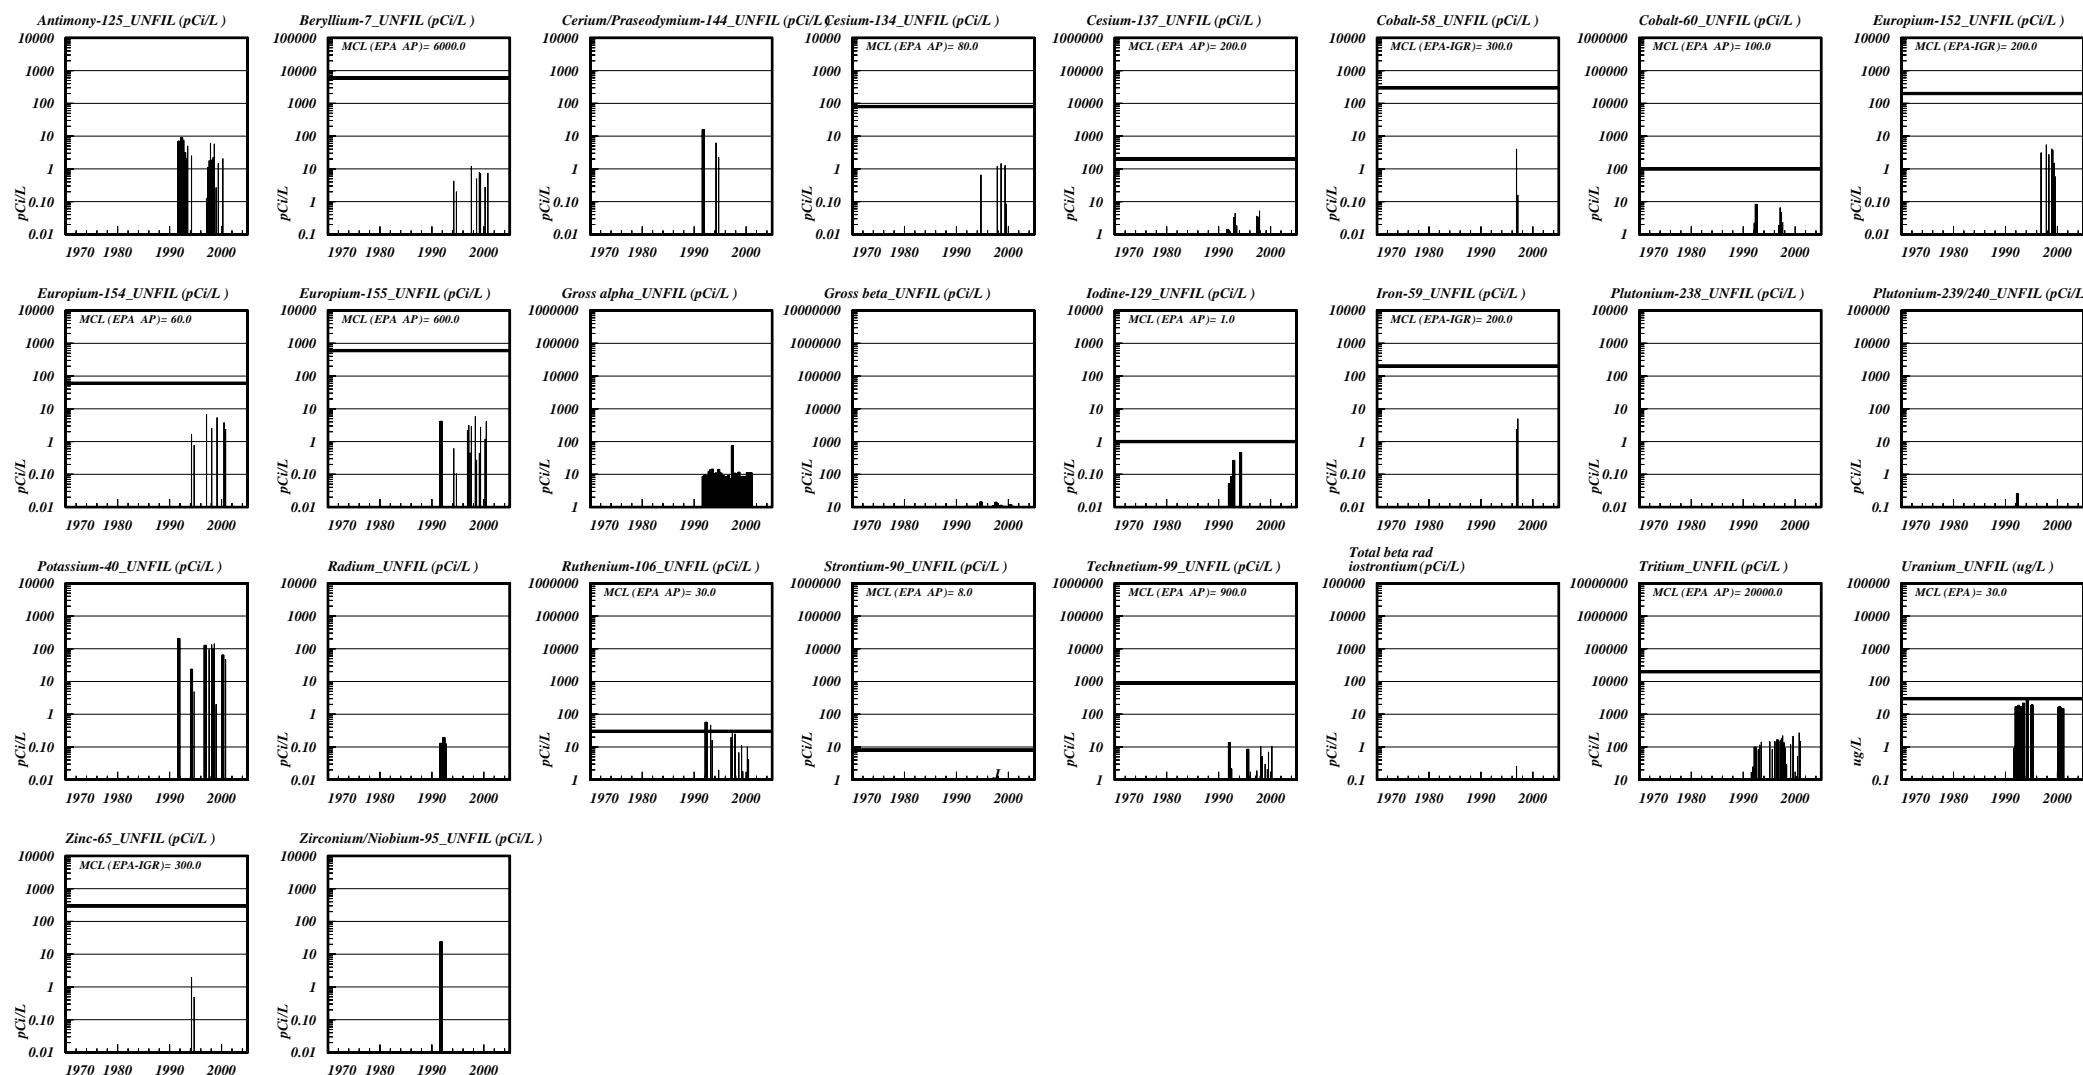

VOLATILE ORGANIC COMPOUNDS

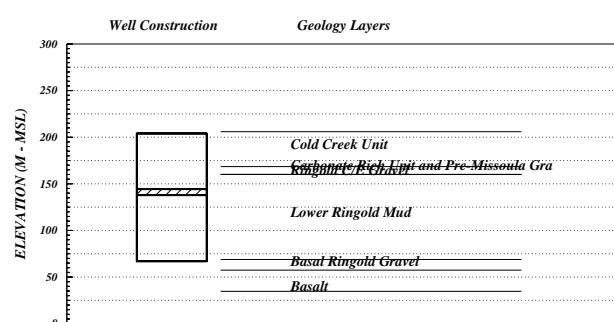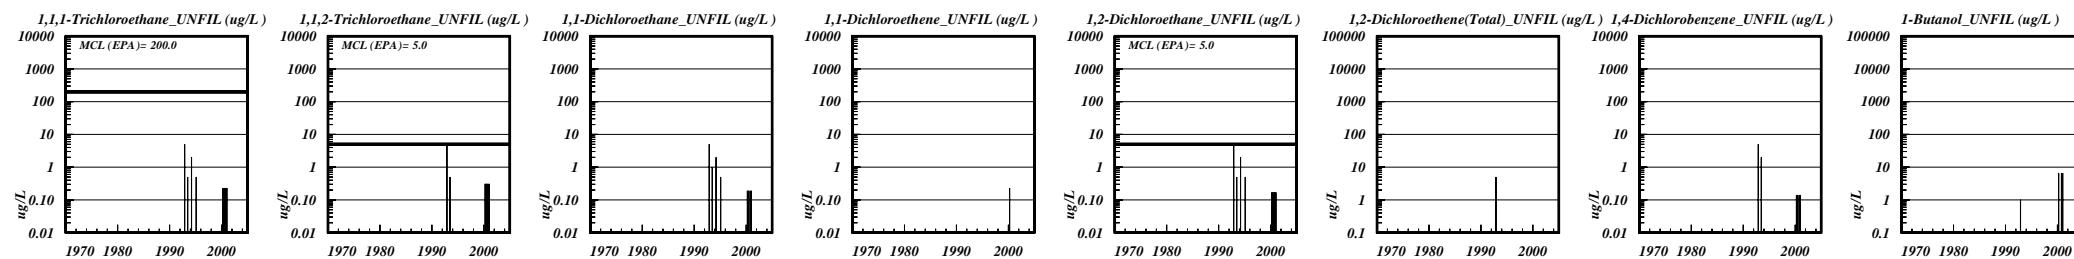

WELLNAME=299-W23-13 WELLID=A4982

Well Type=STANDARD Well purpose=GROUNDWATER
 Owner=DOE Contact=BHI Well Adm Compliance=NON-COMPLIANT
 X_coor= 566712.80 Y_coor= 134445.90 Datum=NAD83 Date Survey= 4/1/1991
 Elevation= 204.003 Datum=NGVD29 Date Survey=04/01/91
 Ref_Point_Desc=TOP OF PLATE Ref_Point_side=N Contractor=KEH
 Total Number of perforation Intervals=1
 NPERF#=1 Perf_top= 143.51 Bot= 137.11 MCas_size= 0.00 Perf_cuts= 0.00
 Total Number of Screen Intervals=1
 Screen#=1 Screen_diam= 4.00 in Top= 59.71 Bottom= 66.19 m Slot_size= 0.01 in
 Screen_material=Stainless Steel
 Total Number of Seals=5
 Seal#=1 Depth_top=-0.09 Bottom= 0.82 m Material=Concrete
 Seal#=2 Depth_top= 0.82 Bottom= 5.64 m Material=Cement Grout
 Seal#=3 Depth_top= 5.64 Bottom= 56.88 m Material=Granular Bentonite
 Seal#=4 Depth_top= 56.88 Bottom= 58.03 m Material=Bentonite Pellets
 More Information is at <http://www.envirodataaccess.com/wellfiles/299-W23-13.htm>


LABORATORY QUALIFIER FLAGS in HEIS are *; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
 EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-W23-13

VOLATILE ORGANIC COMPOUNDS

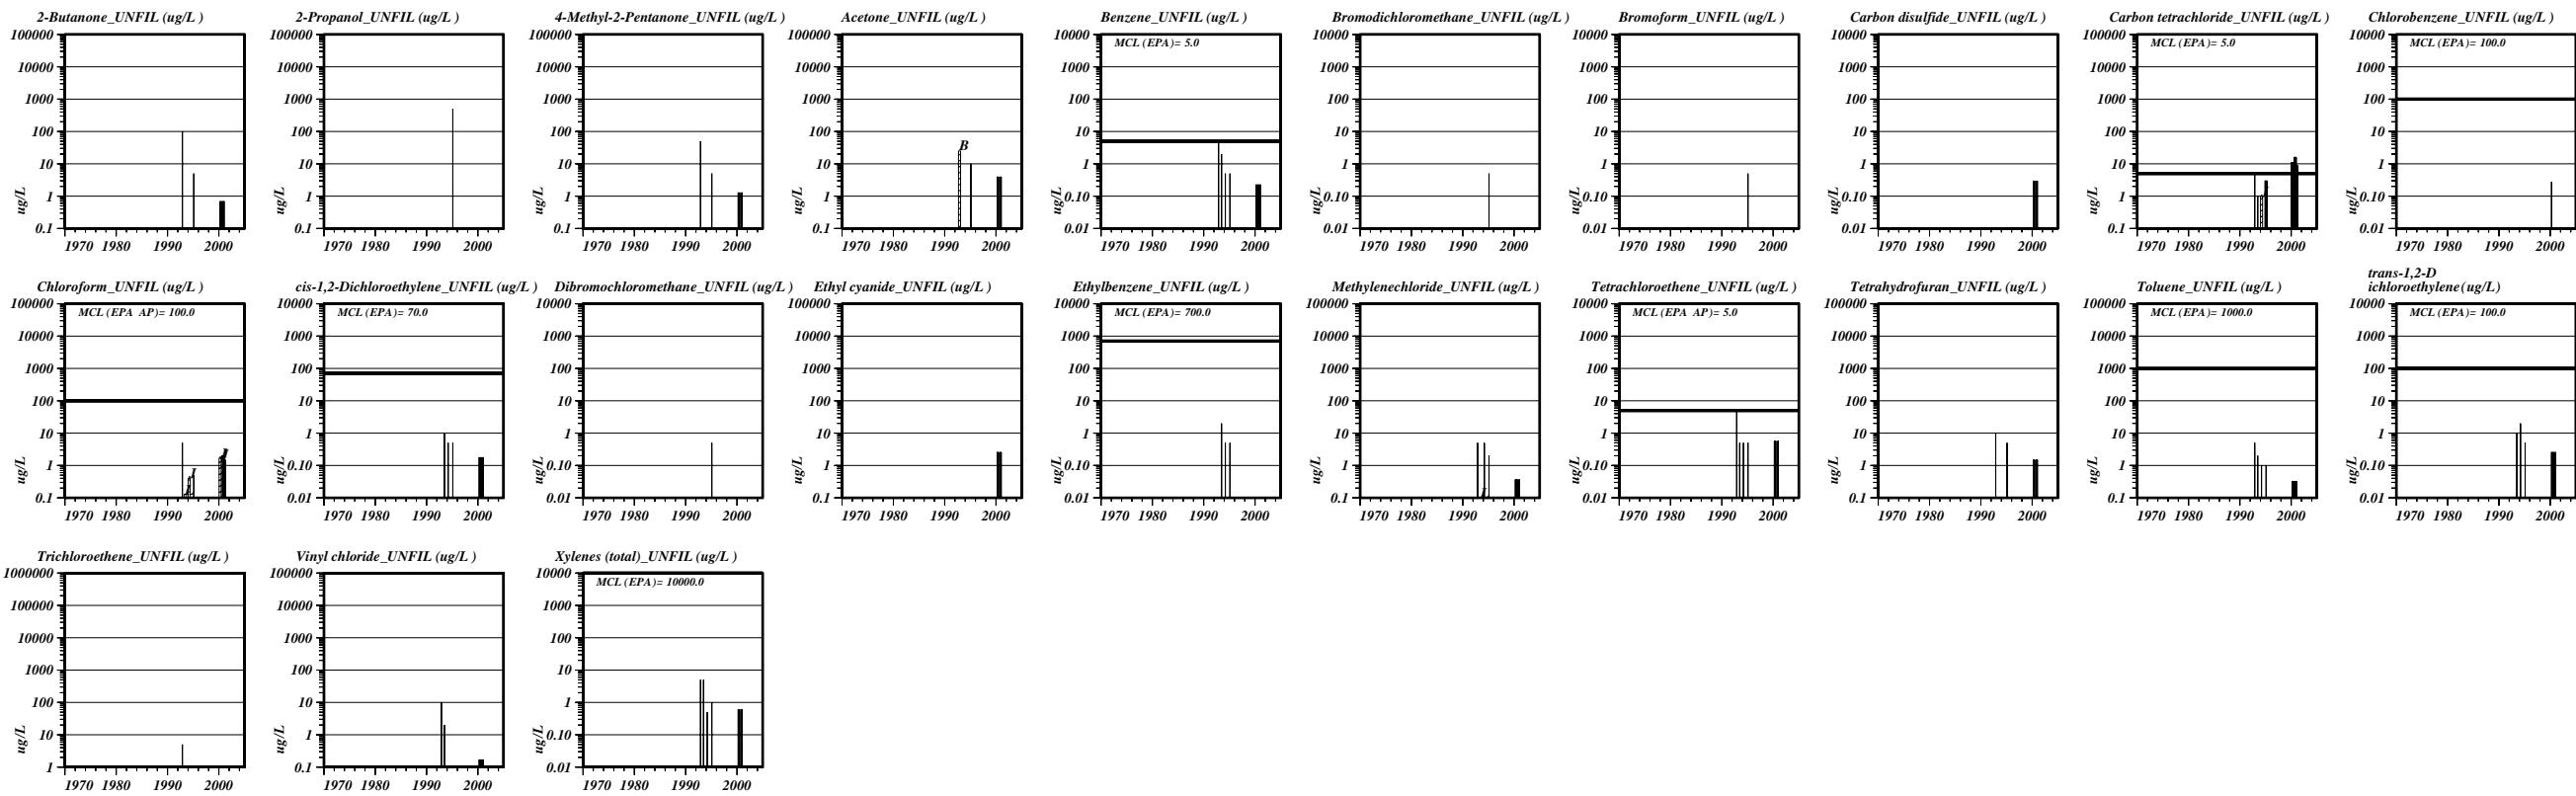

SEMI-VOLATILE ORGANIC COMPOUNDS

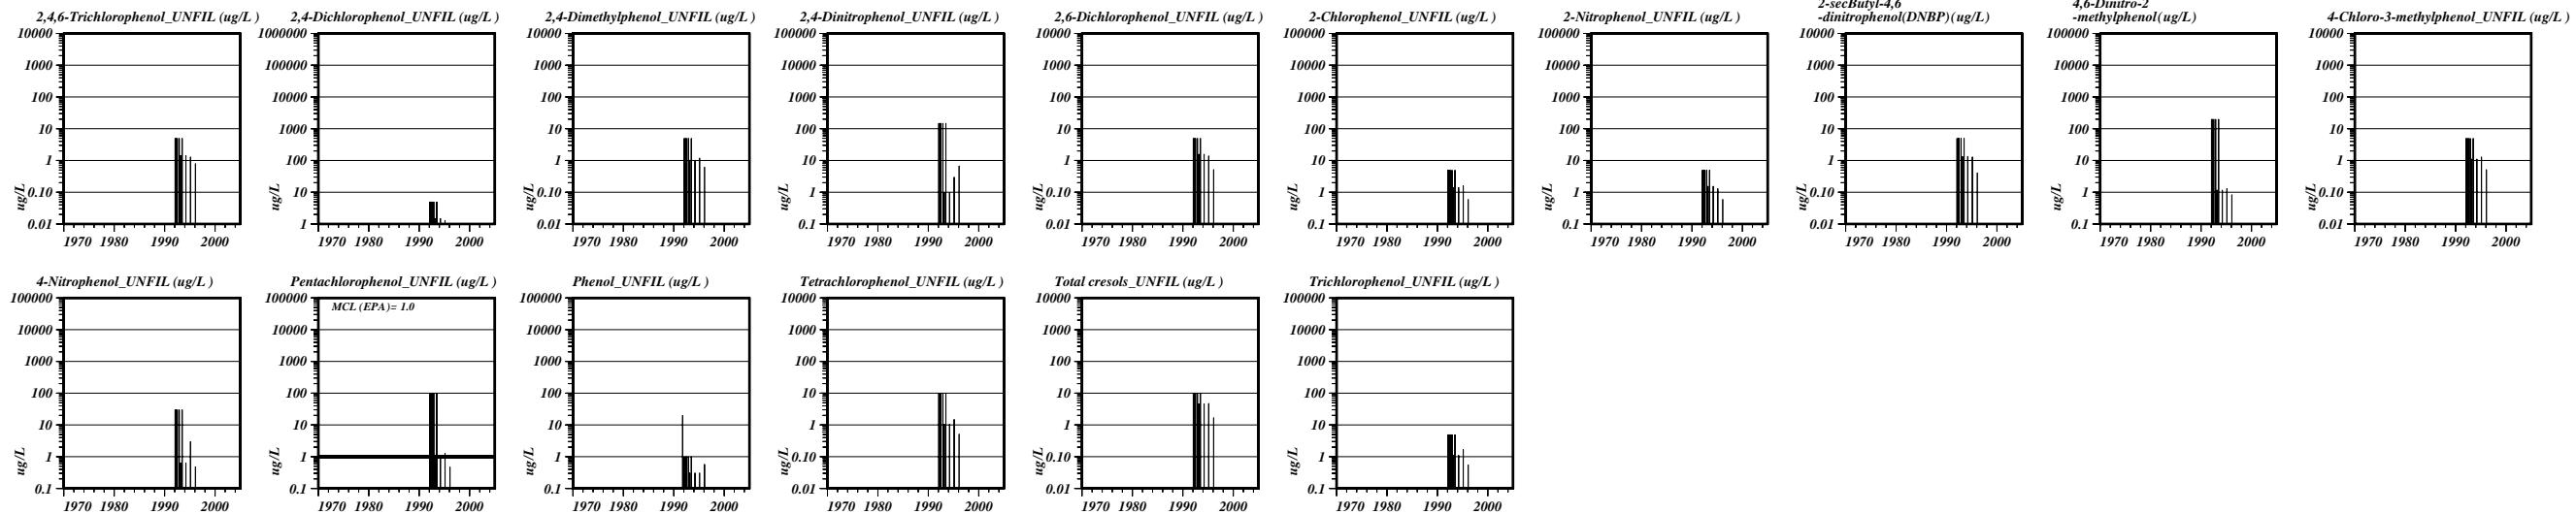


LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-W23-13

METALS & PHYSICAL PARAMETERS

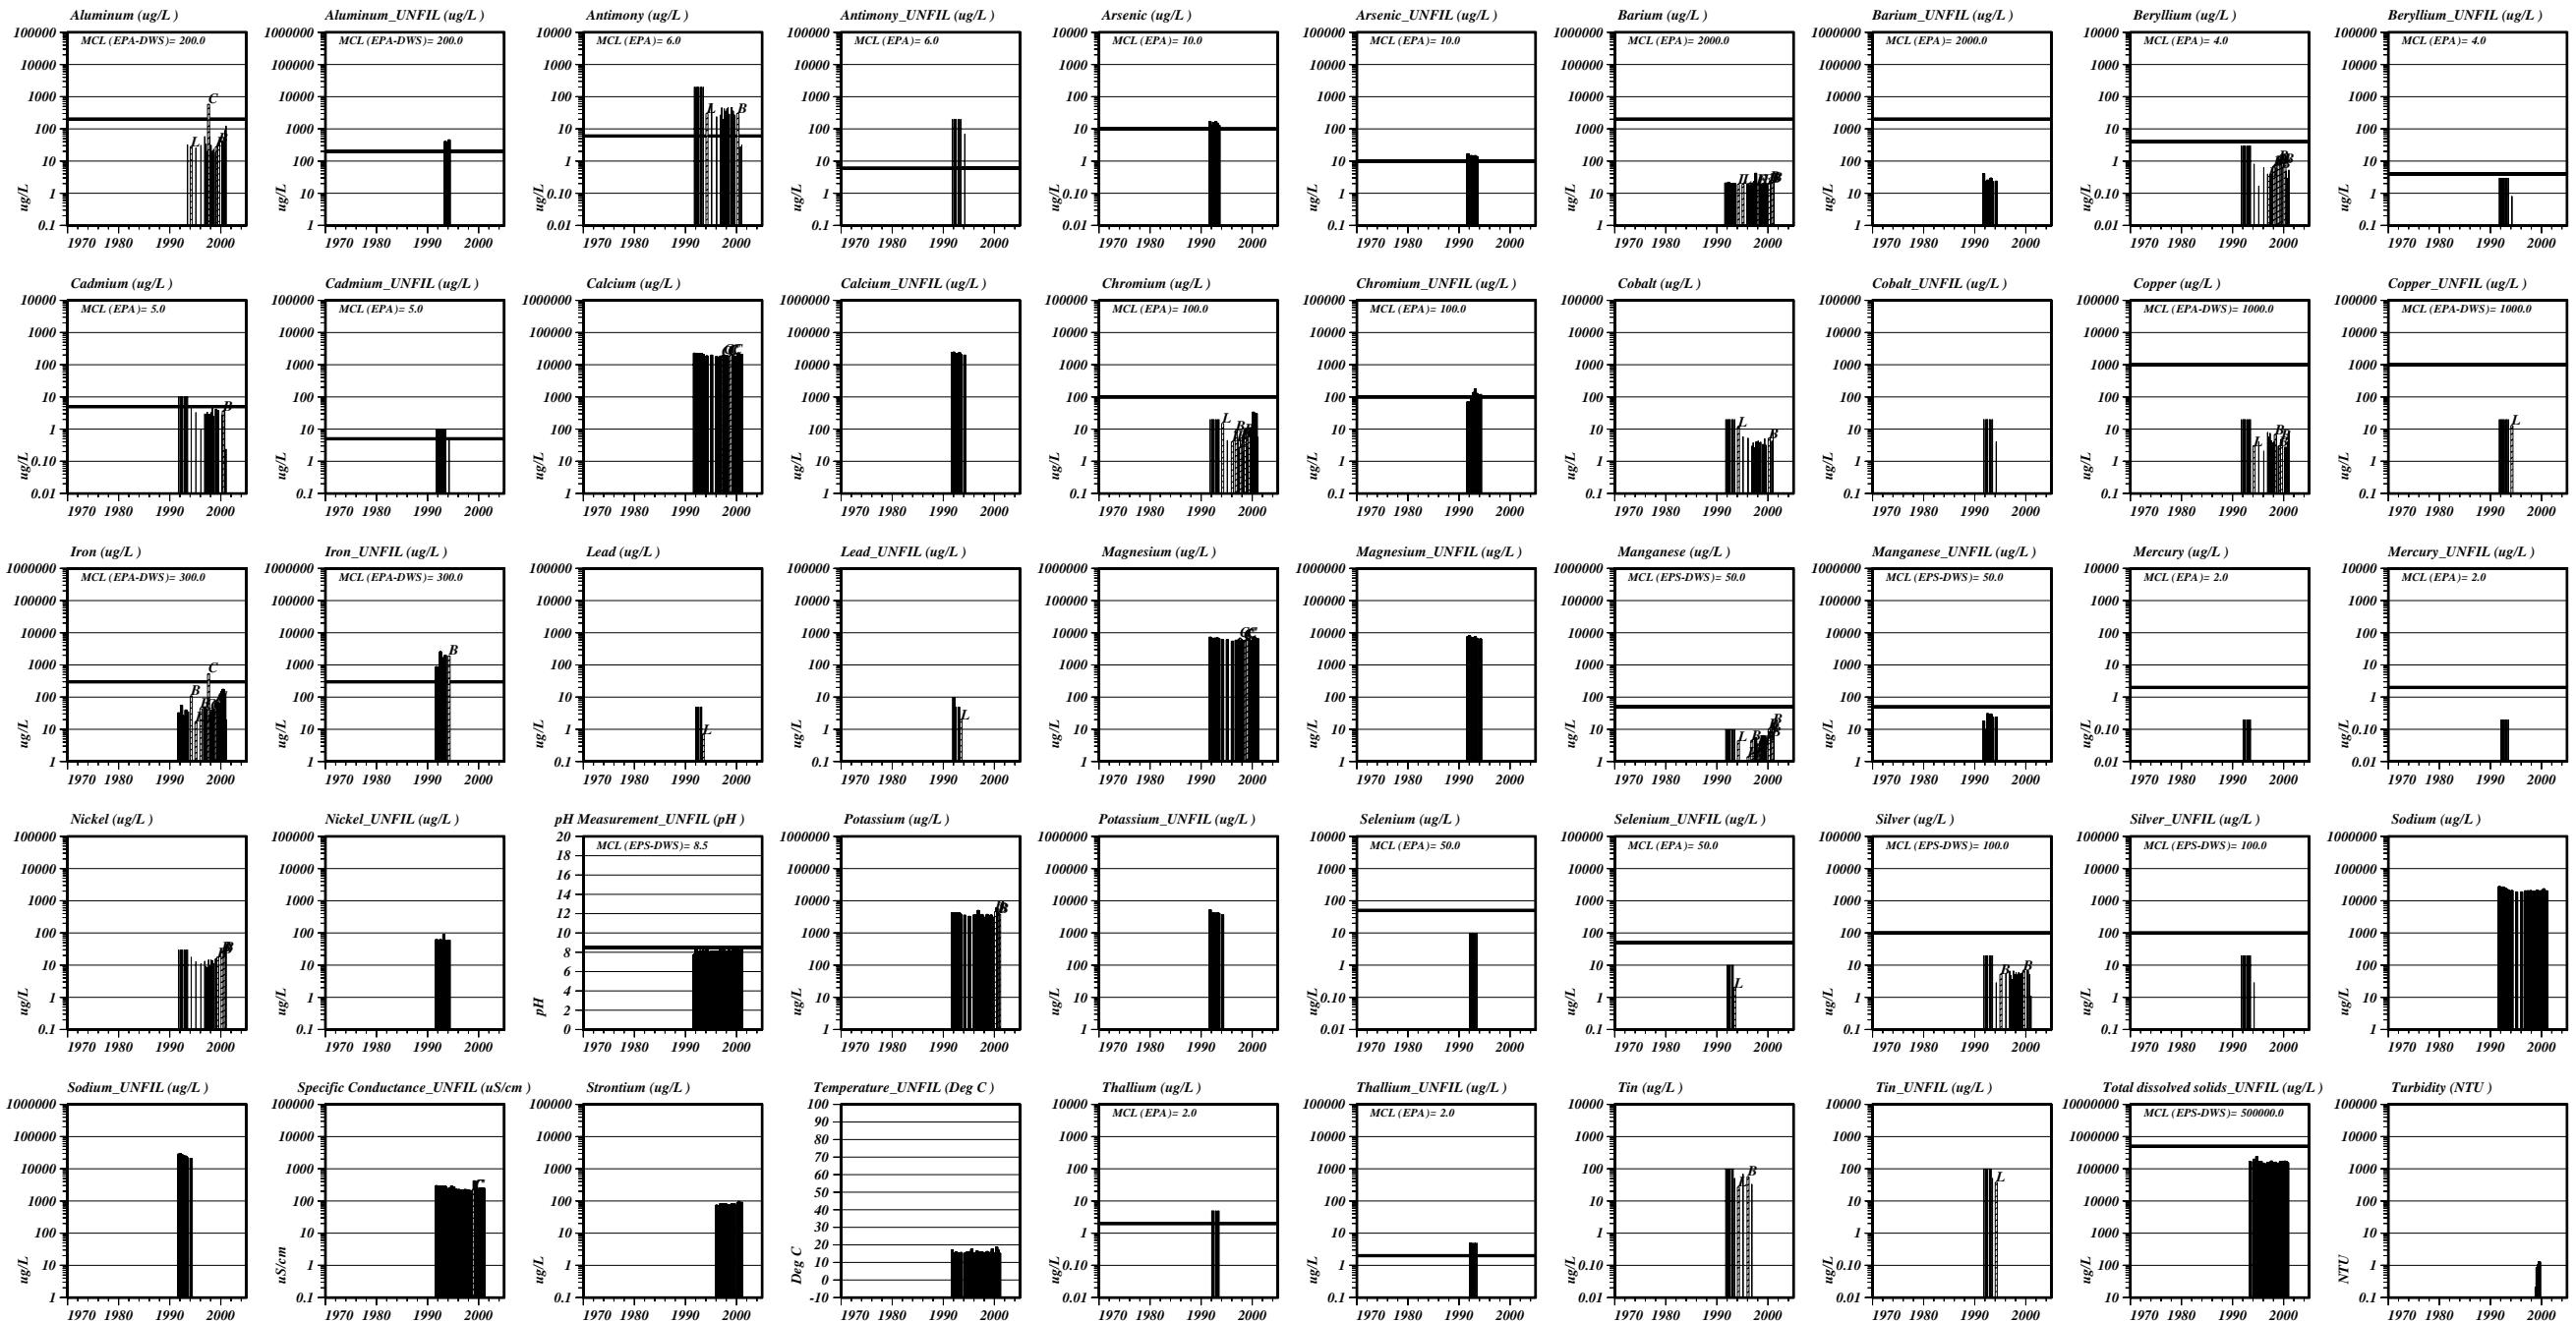


LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-W23-13


METALS & PHYSICAL PARAMETERS

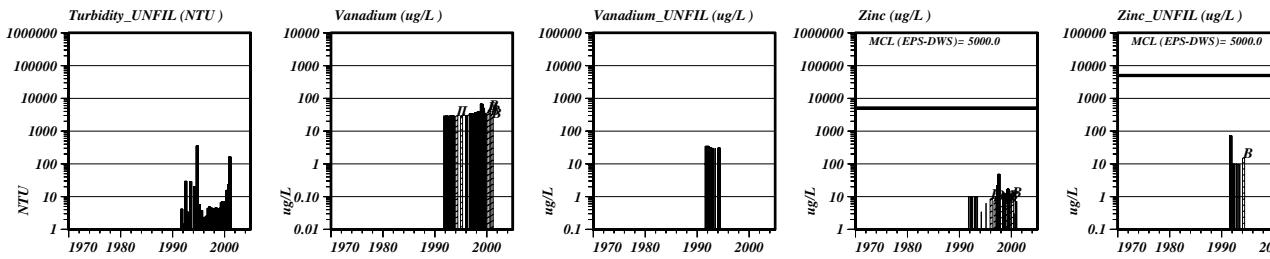

PEST/PCB, HERB, & DIOXINS

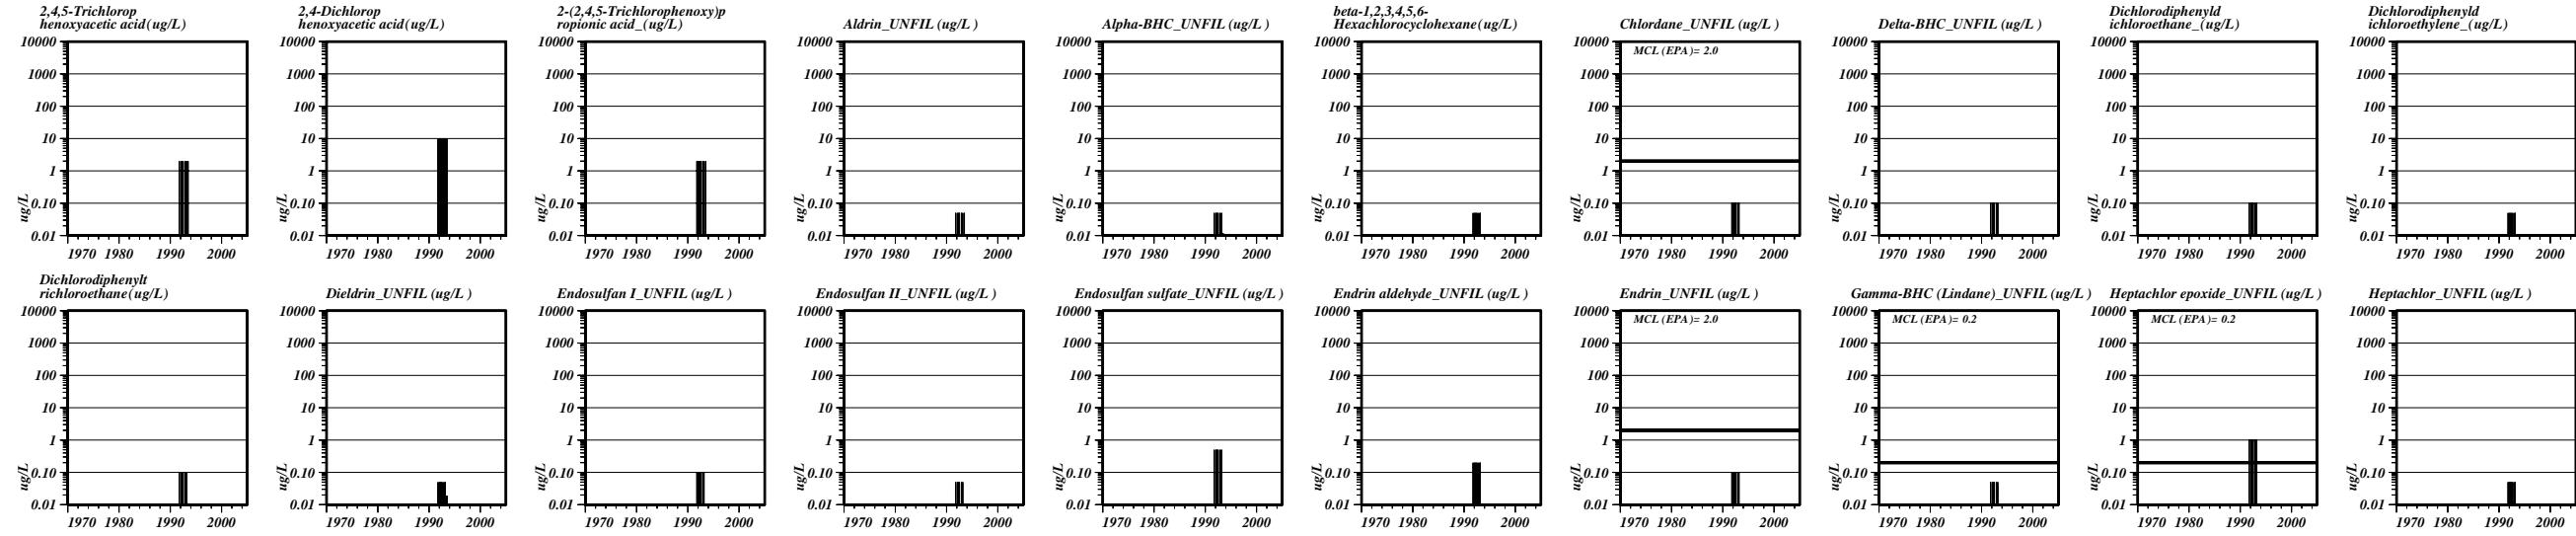

GENCHEM & ORGANICS & GENORGANICS



LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag