
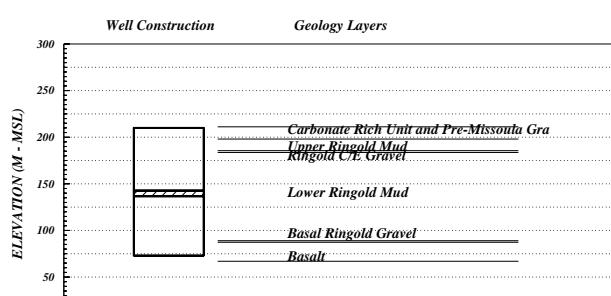
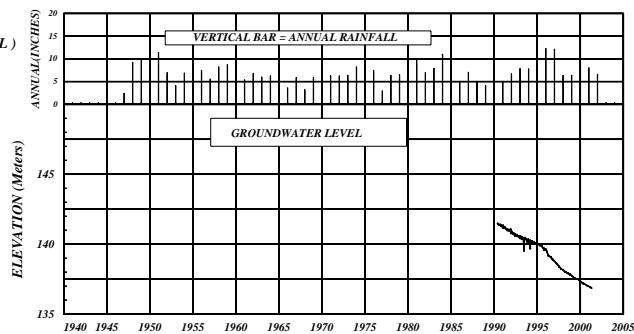
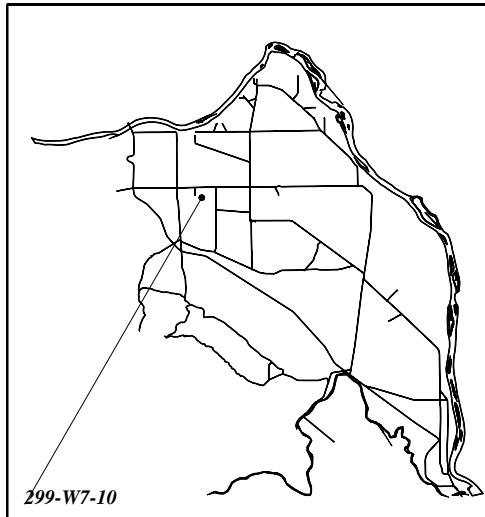


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-W7-10

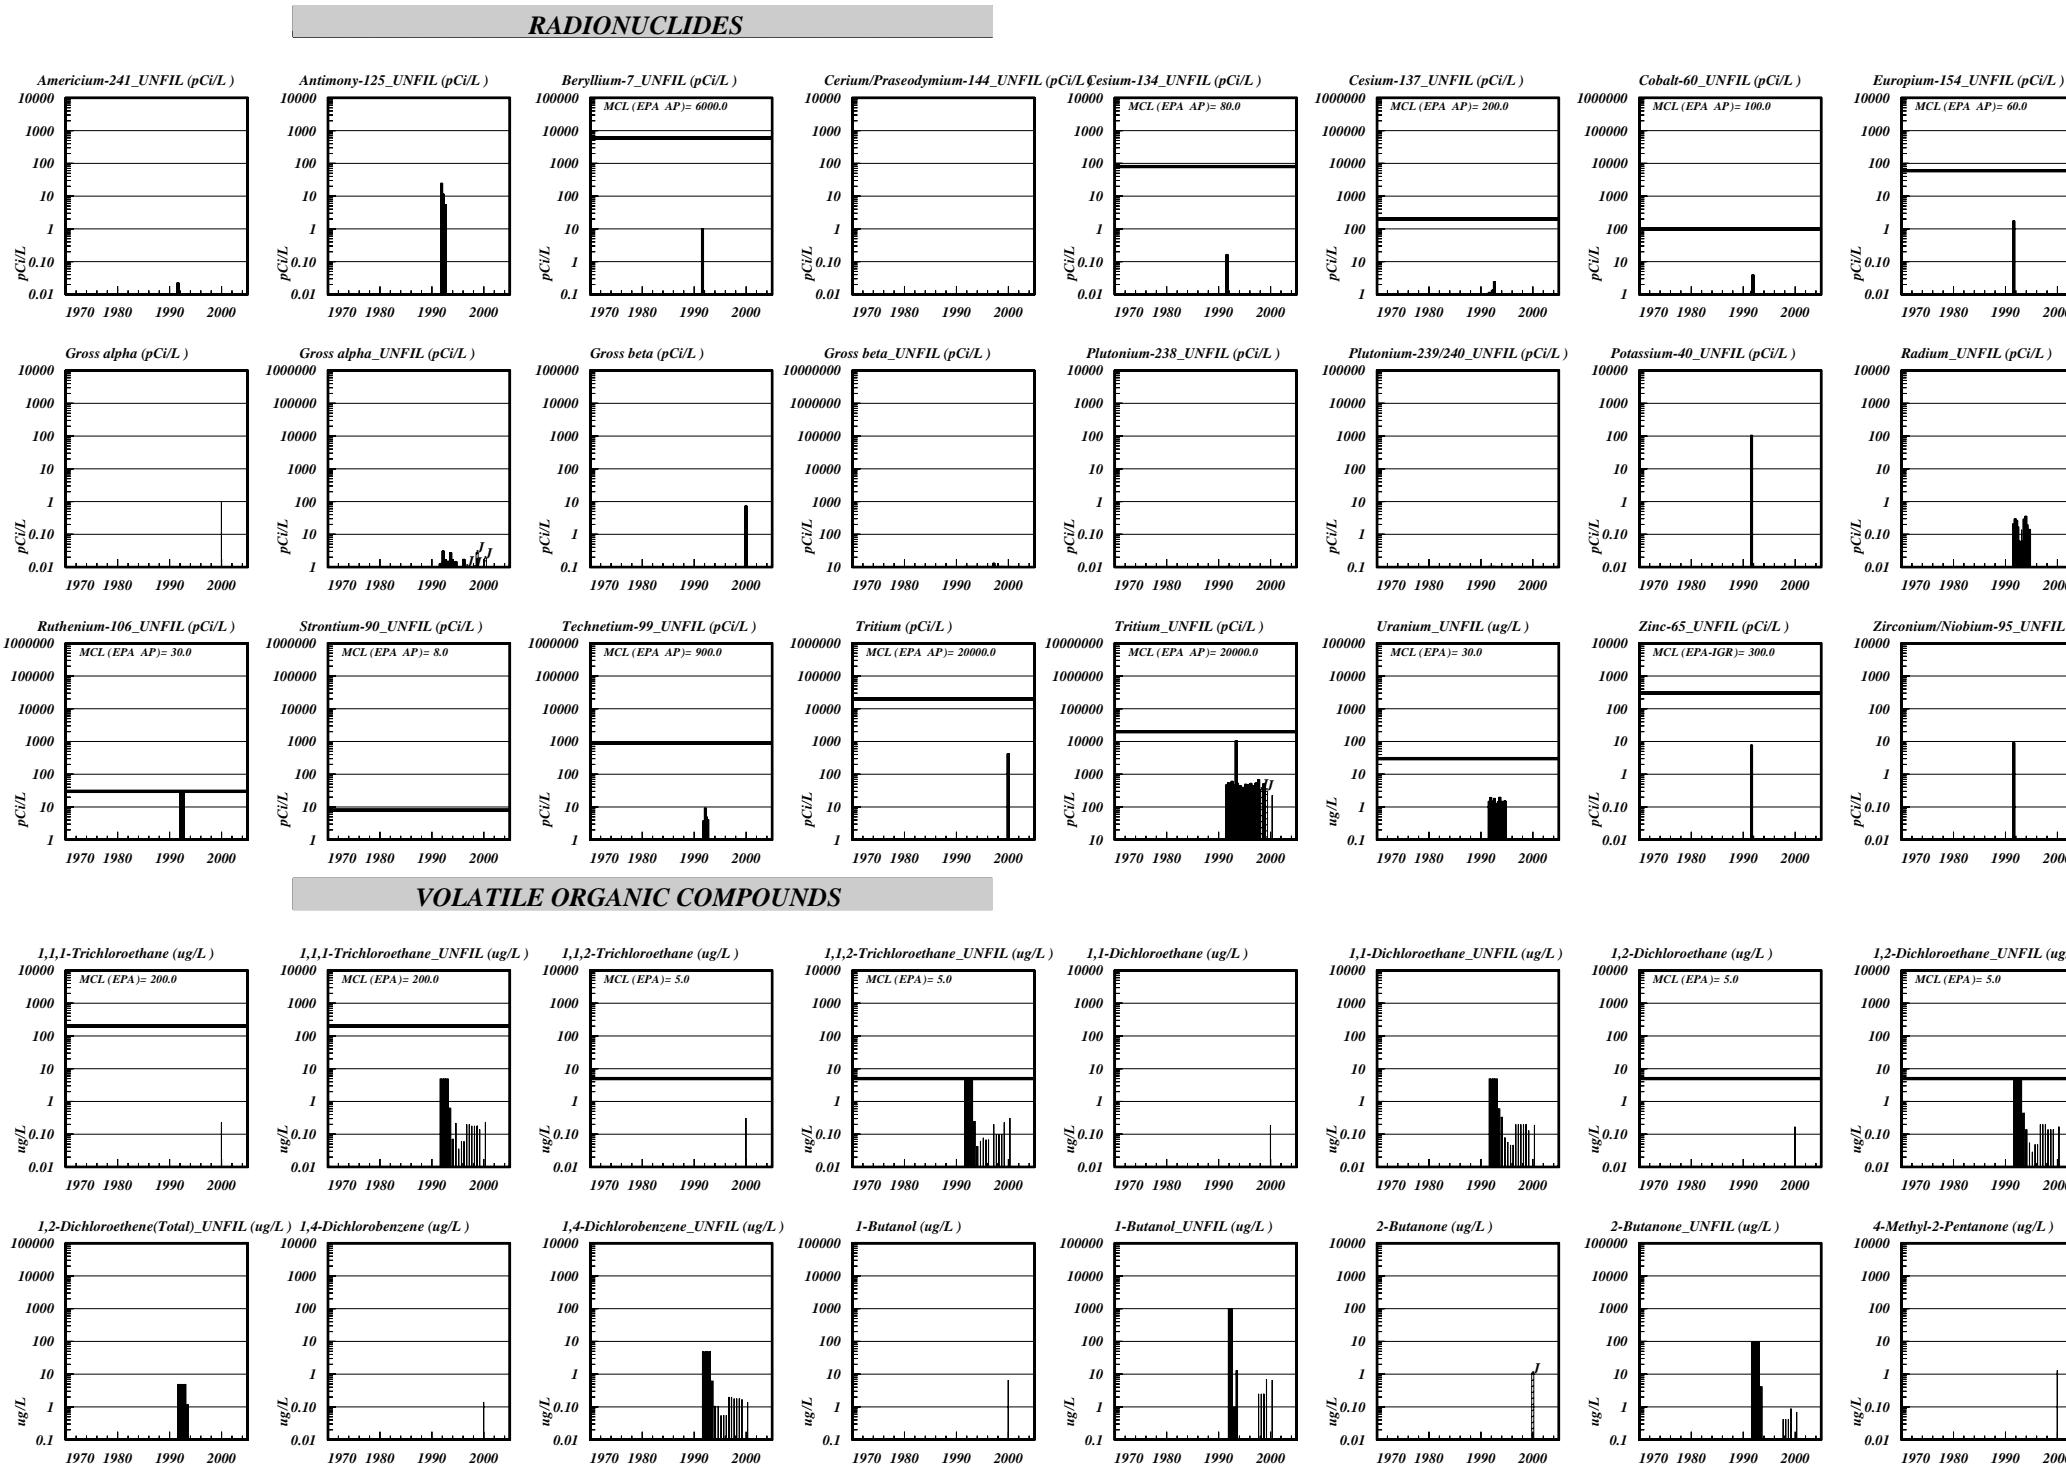

WELLNAME=299-W7-10 WELLID=A5005

Well Type=STANDARD Well purpose=GROUNDWATER
Owner=DOE Contact=BHI Well Admin=Compliance=NON-COMPLIANT
X_coor= 566858.20 Y_coor= 137457.50 Datum=NAD83(91) Date Survey= 6/24/1994
Elevation= 210.000 Datum=NAVD88 Date Survey=06/24/94
Ref_Point_Desc=BRASS CAP Ref_Point_side=NONE Contractor=USACE(JECA)
Well Comment= Pump pulled, not enough water to sample 11/7/00
Total Number of perforation Intervals=1
NPERf#=1 Perf_top= 143.07 Bot= 136.97 MCas_size= 0.00 Perf_cuts= 0.00
Total Number of Screen Intervals=1
Screen#=1 Screen_diam= 4.00 in Top= 67.21 Bottom= 73.41 m Slot_size= 0.01 in
Screen_material=Stainless Steel
Total Number of Seals=6
Seal#=1 Depth_top= 0.15 Bottom= 0.73 m Material=Cement
Seal#=2 Depth_top= 0.73 Bottom= 5.64 m Material=Cement Grout
Seal#=3 Depth_top= 5.64 Bottom= 65.26 m Material=Granular Bentonite
More Information is at <http://www.envirodataaccess.com/wellfiles/299-W7-10.htm>


LABORATORY QUALIFIER FLAGS in HEIS are *; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-W7-10

VOLATILE ORGANIC COMPOUNDS


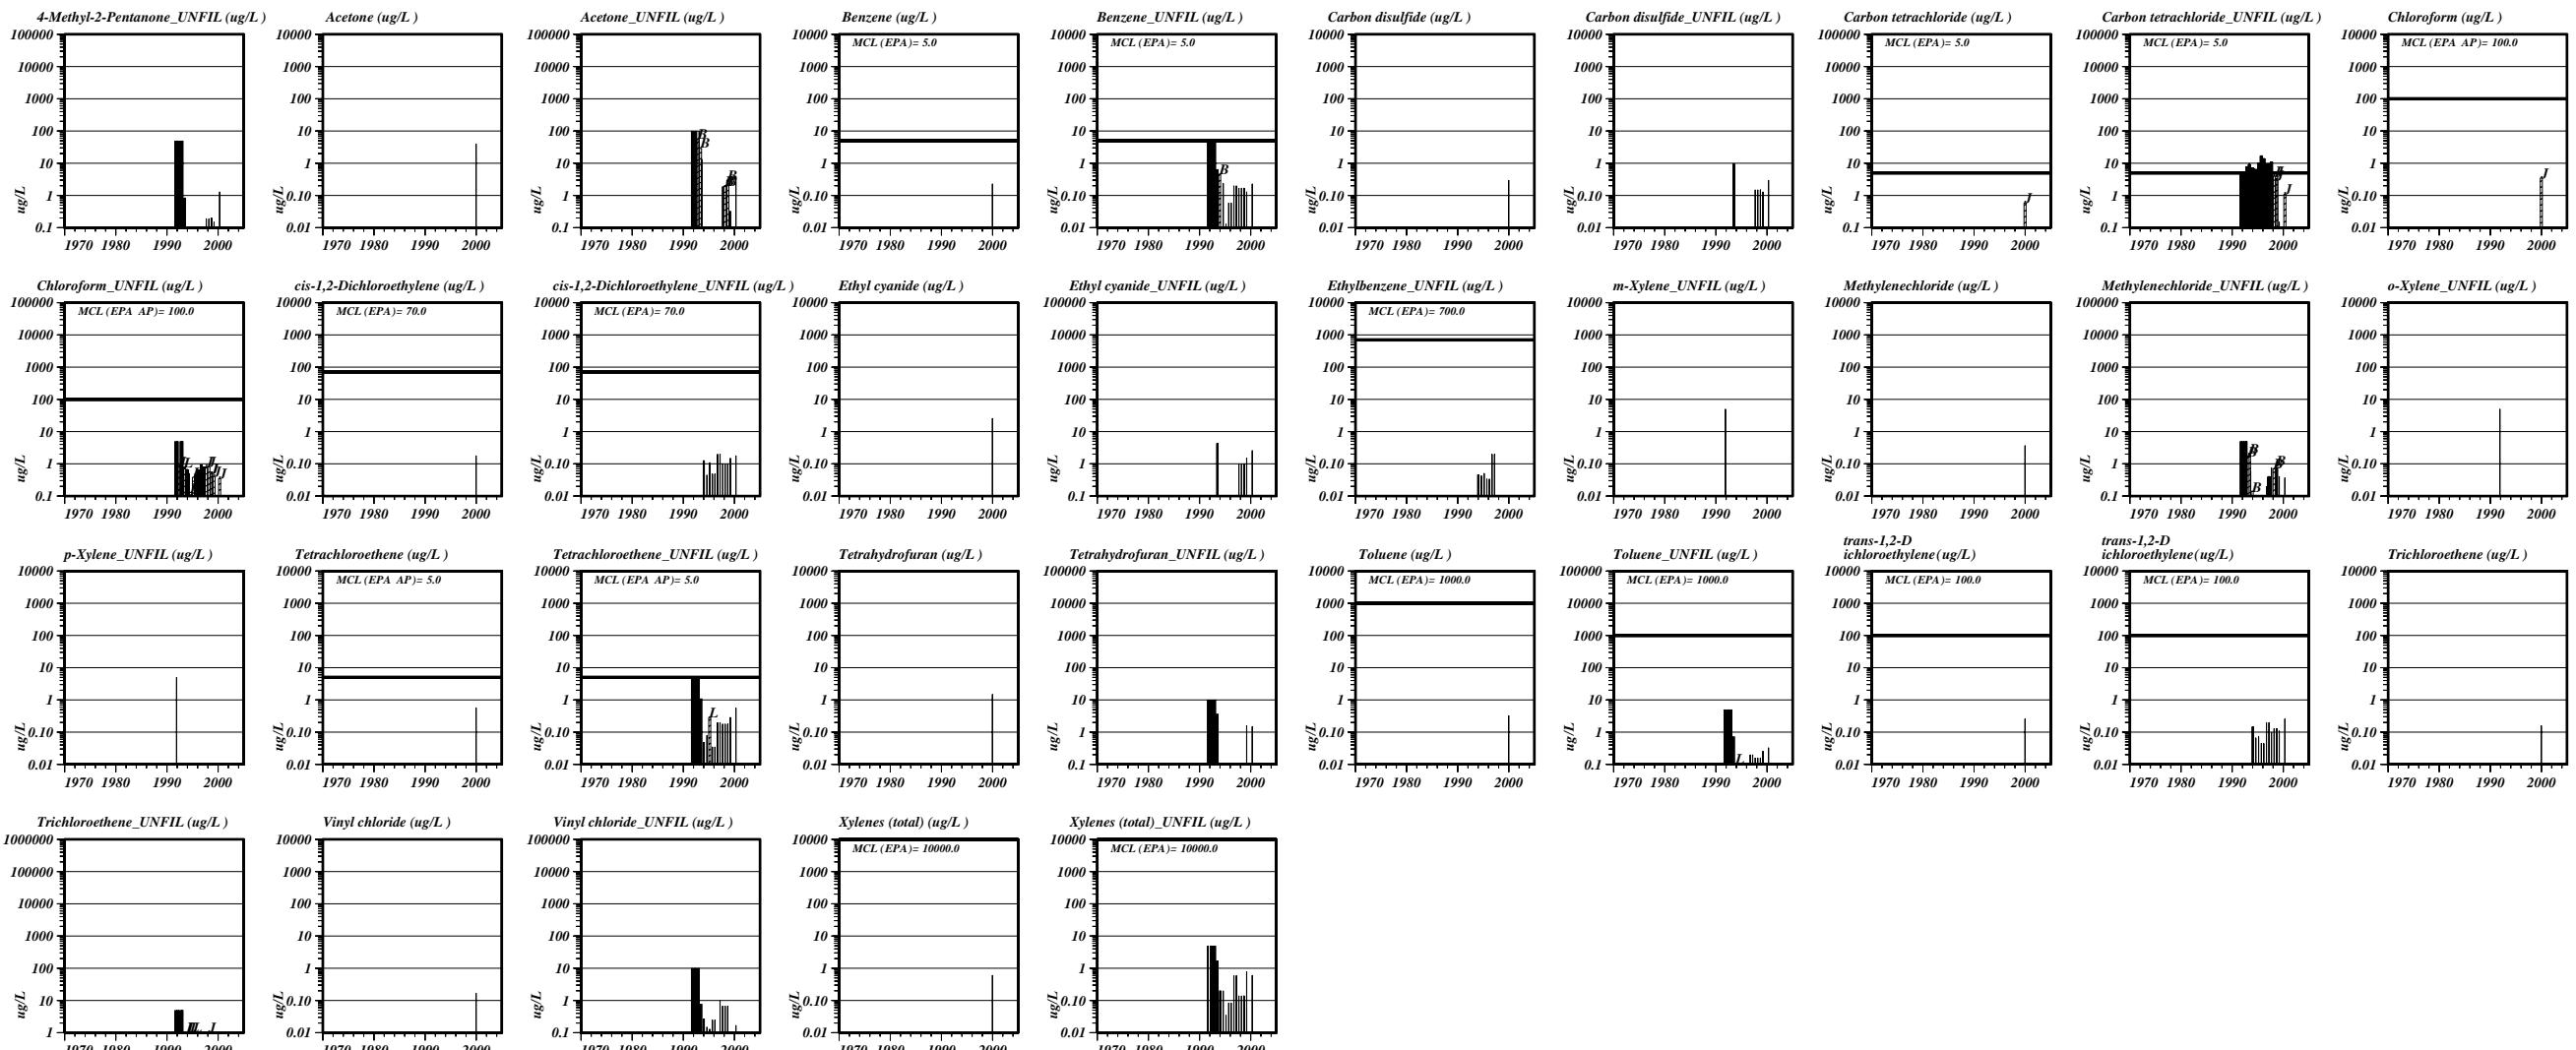


SEMI-VOLATILE ORGANIC COMPOUNDS

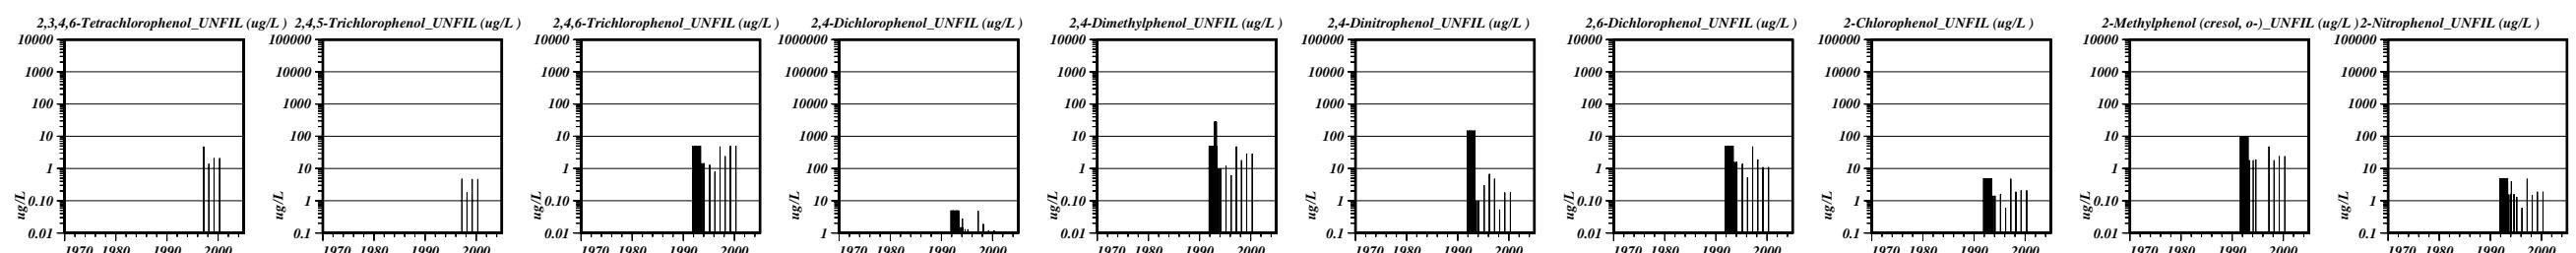

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:


EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

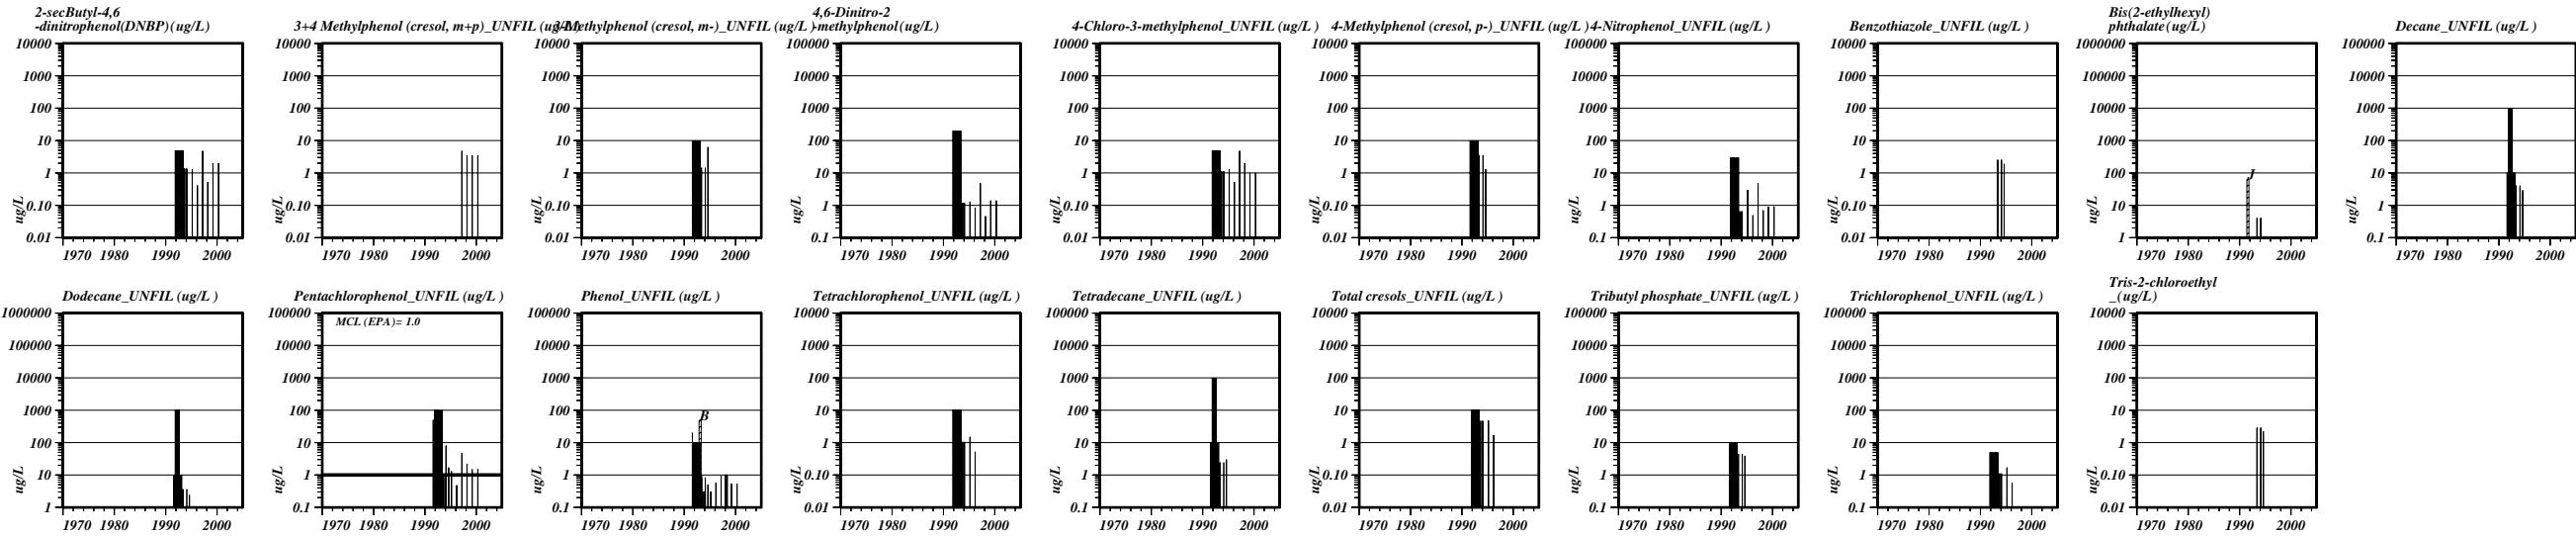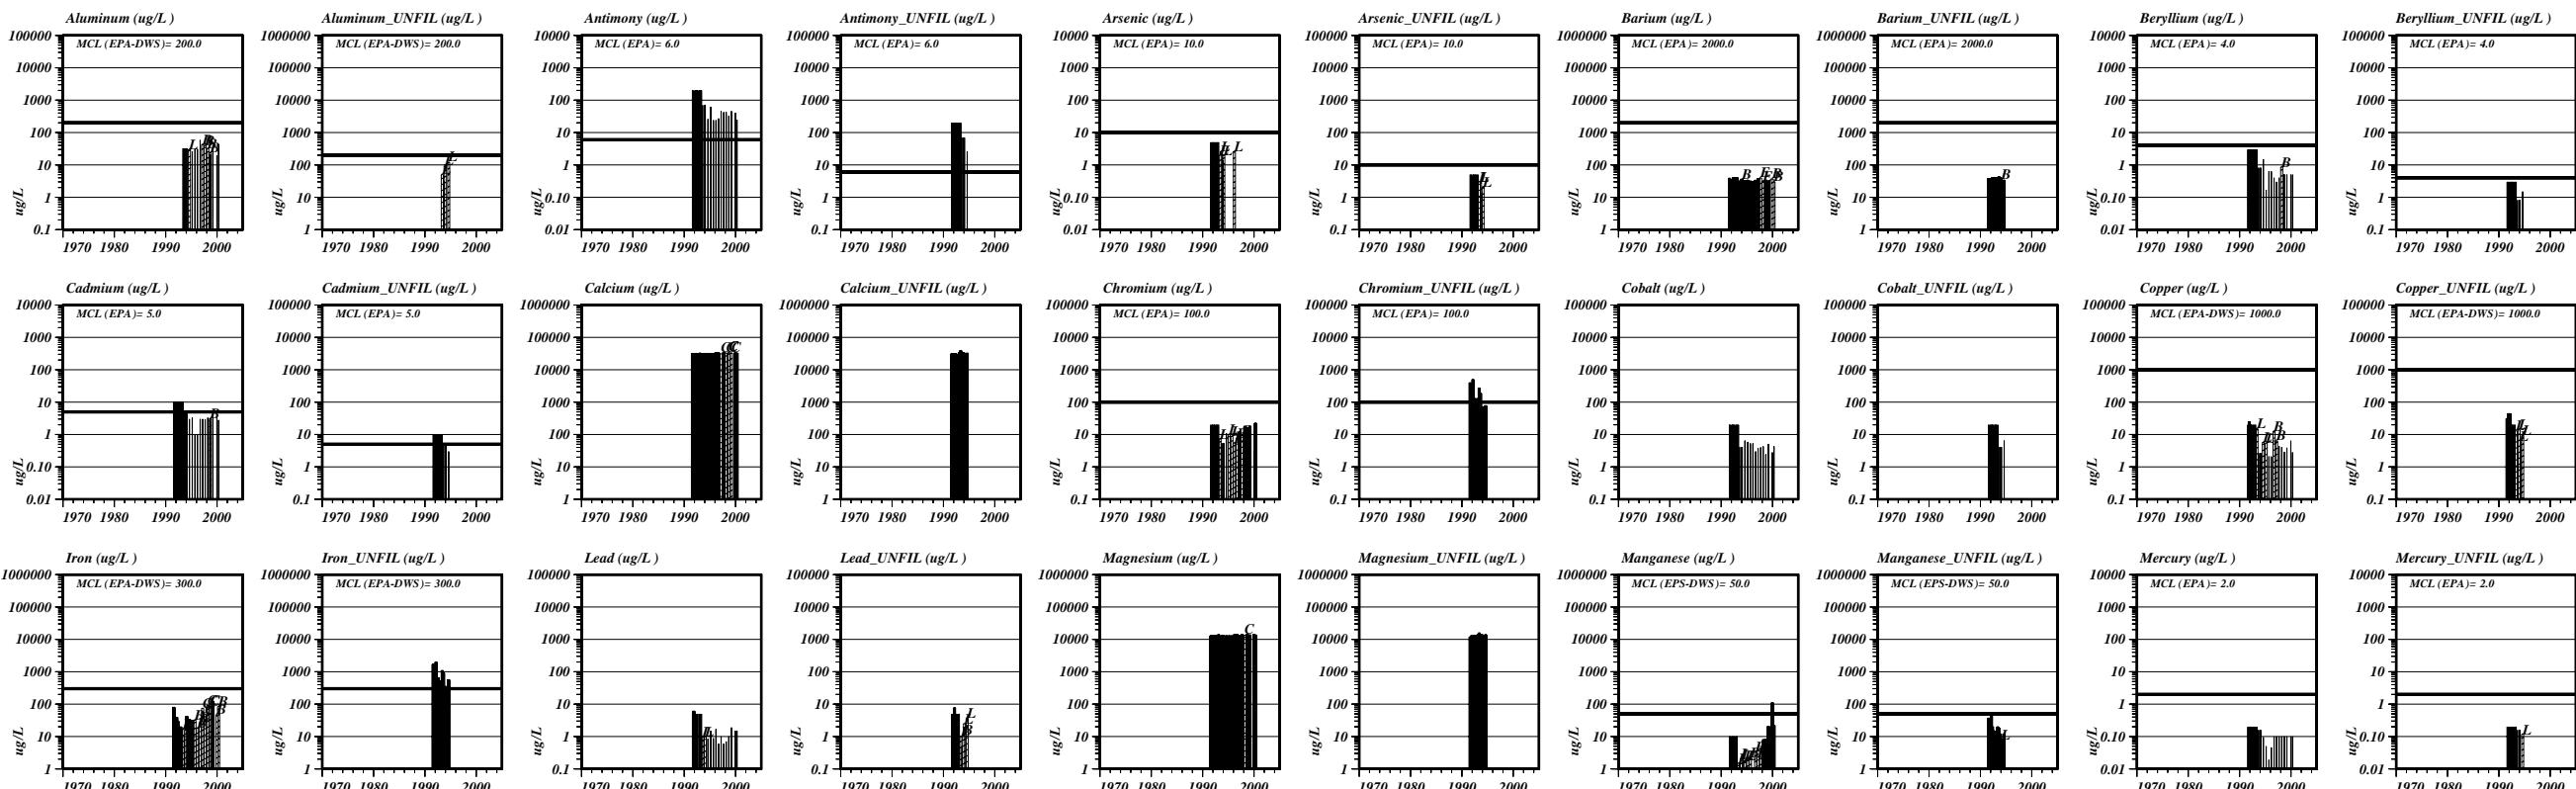SEMI-VOLATILE ORGANIC COMPOUNDS**METALS & PHYSICAL PARAMETERS**


LABORATORY QUALIFIER FLAGS in HEIS are * , >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

METALS & PHYSICAL PARAMETERS

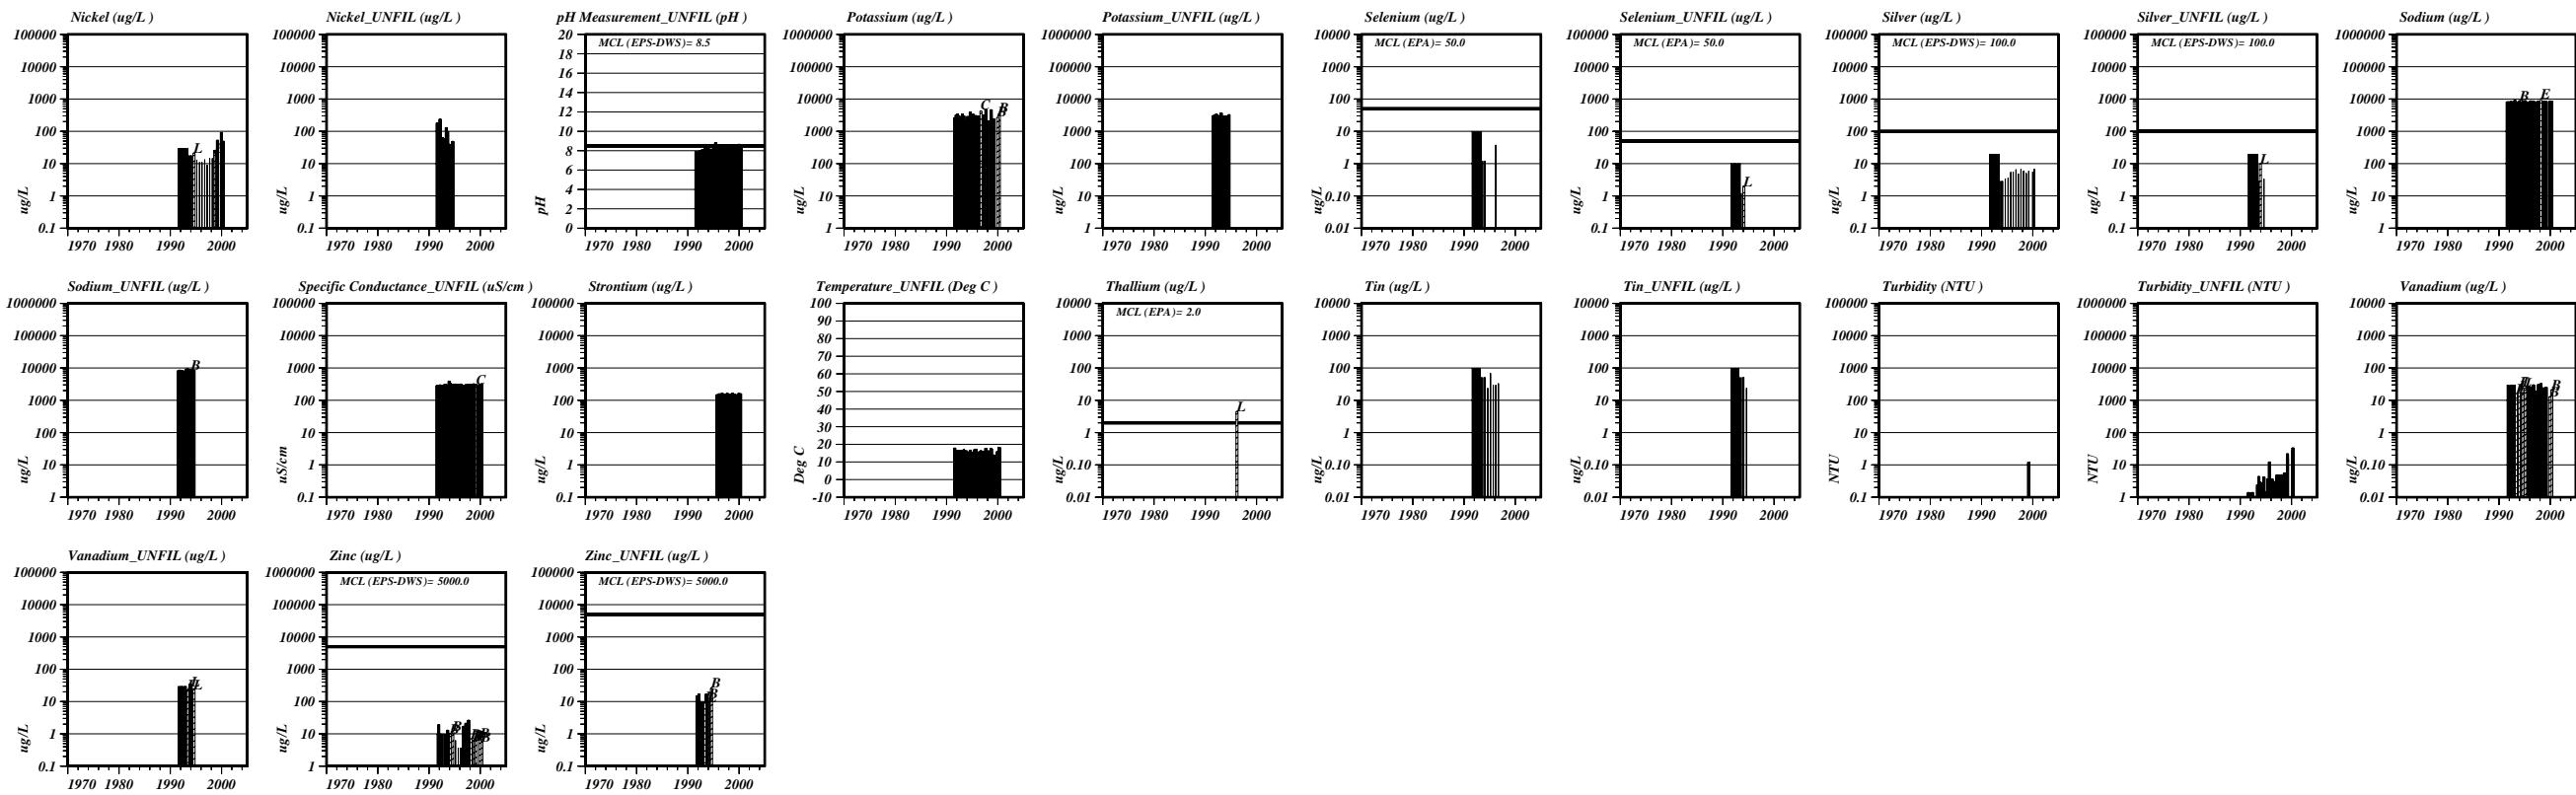



PEST/PCB, HERB, & DIOXINS

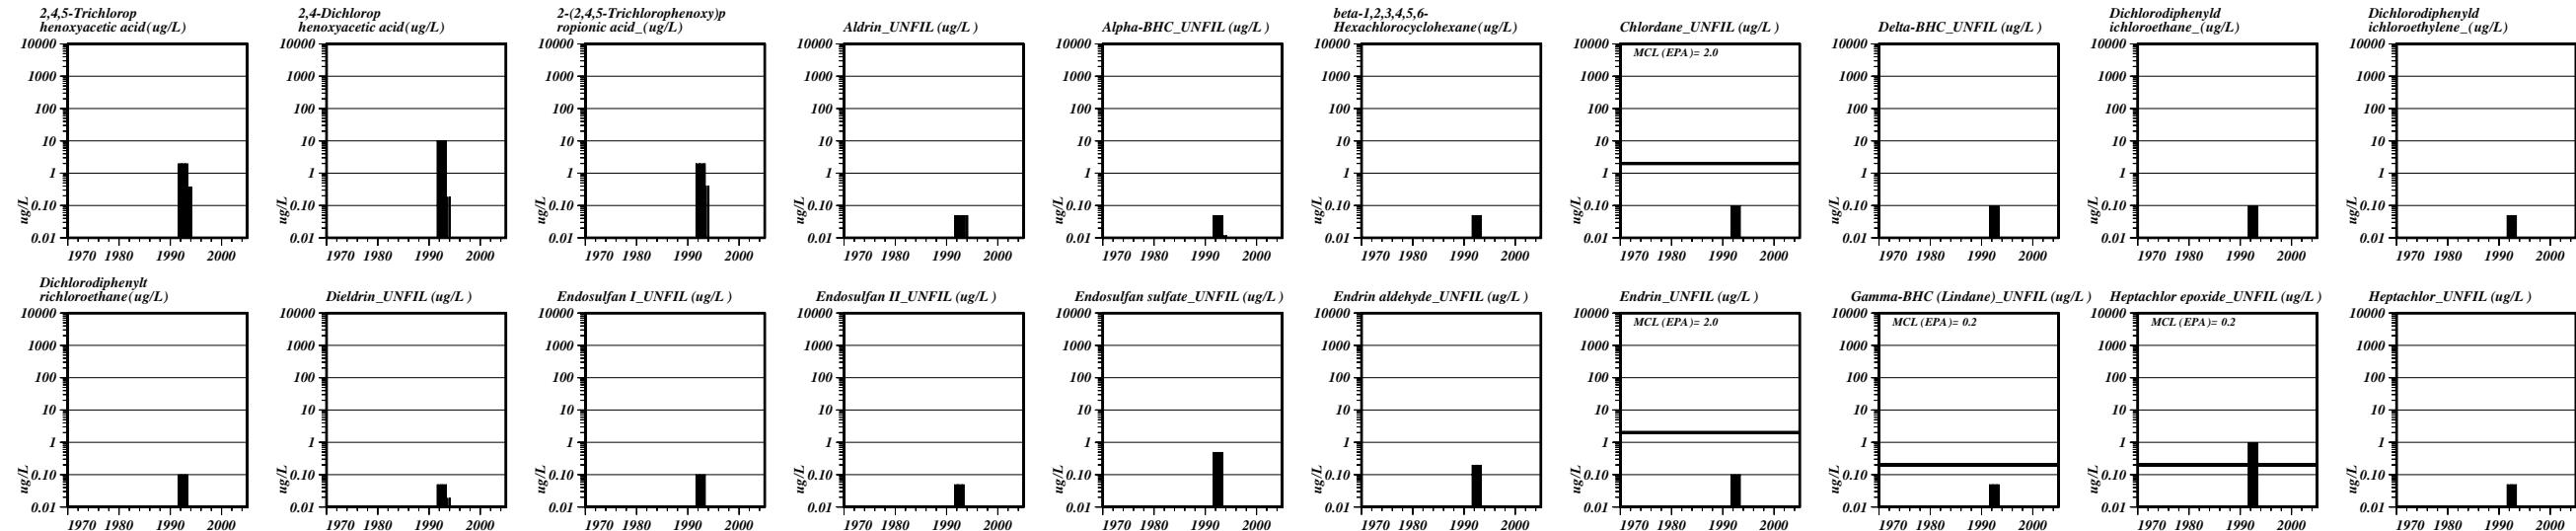





LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

PEST/PCB, HERB, & DIOXINS

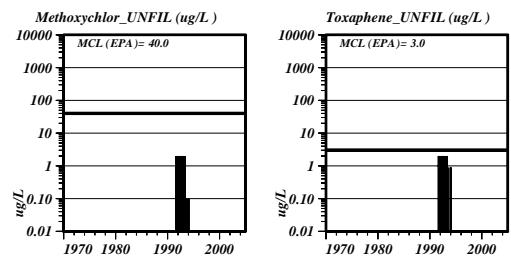

GENCHEM & ORGANICS & GENORGANICS



LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag