

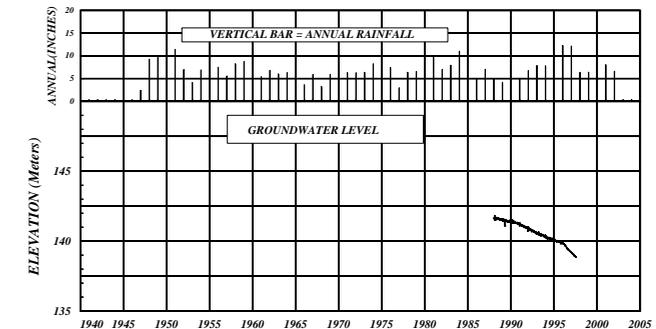
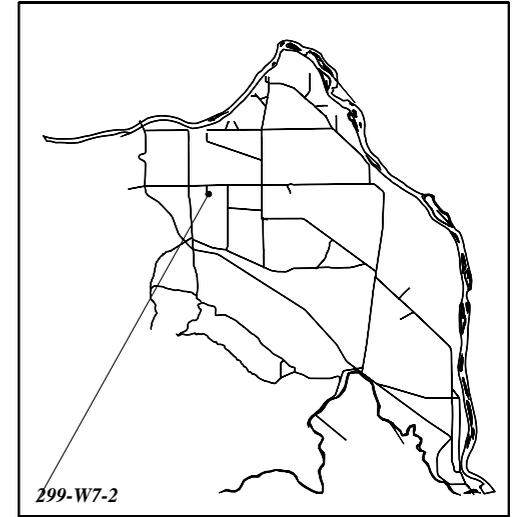
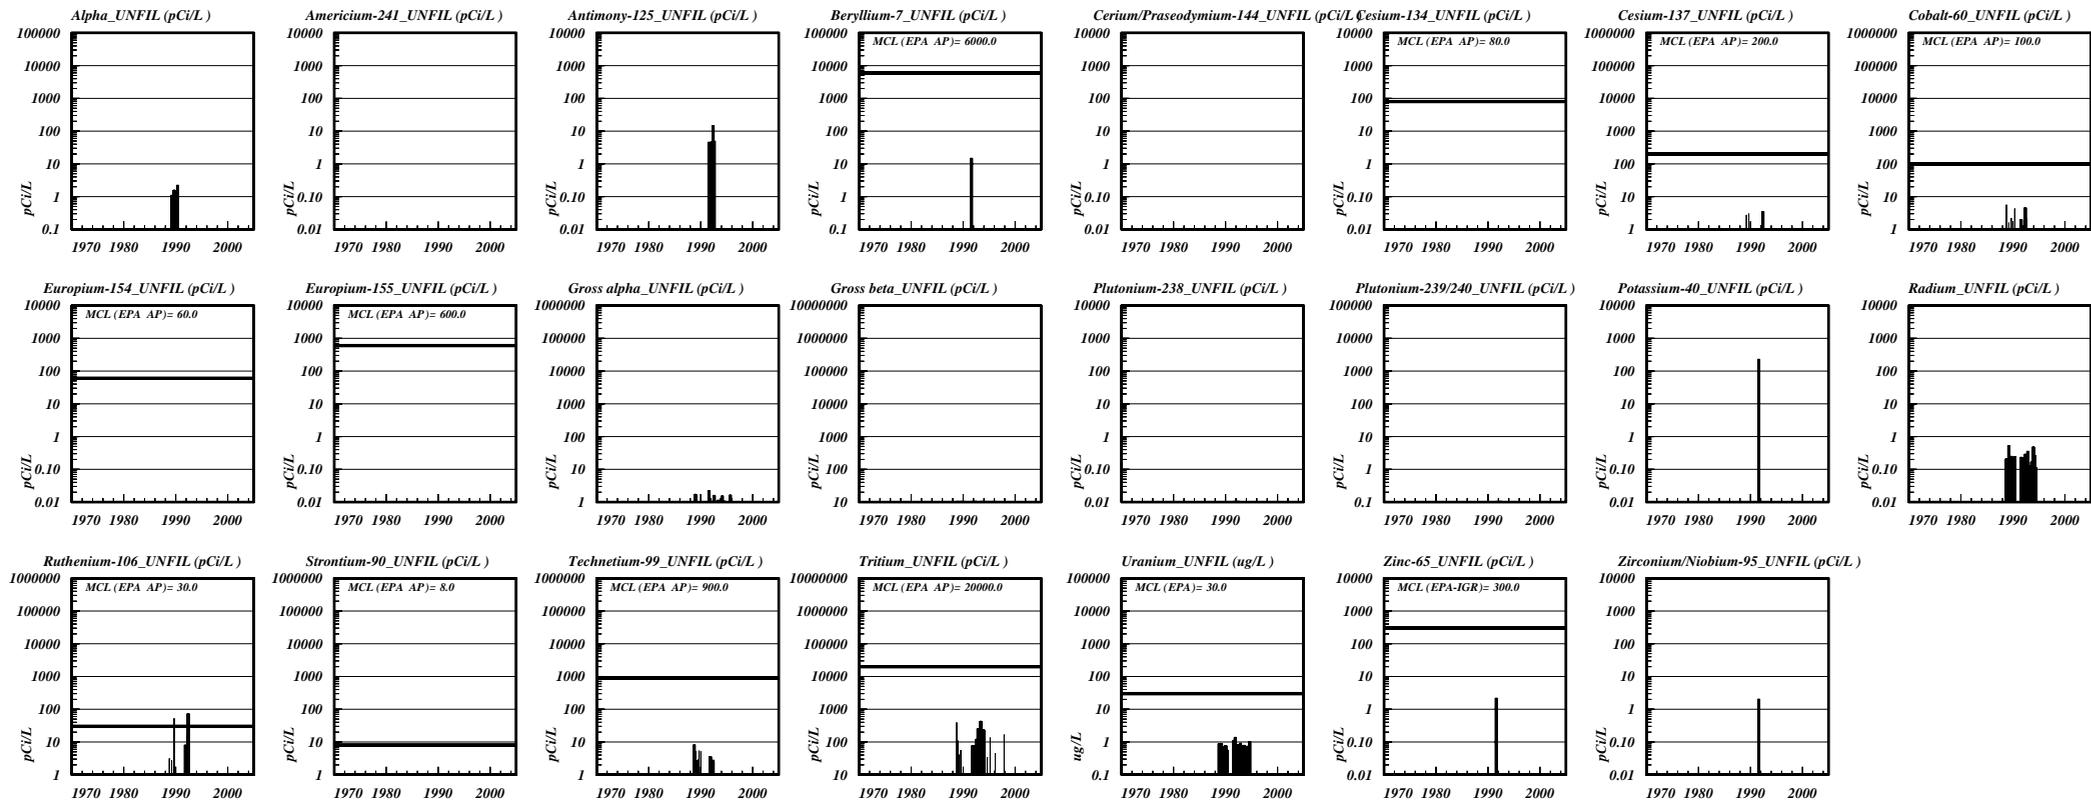


**RADIONUCLIDES**

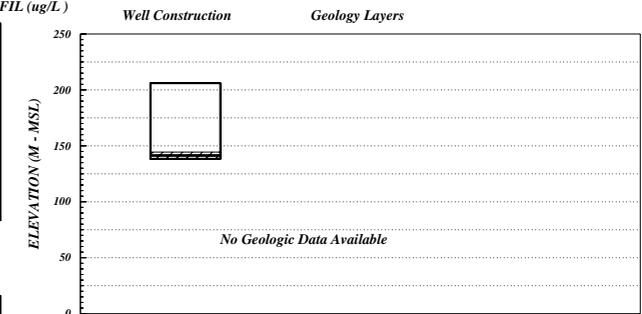

**VOLATILE ORGANIC COMPOUNDS**

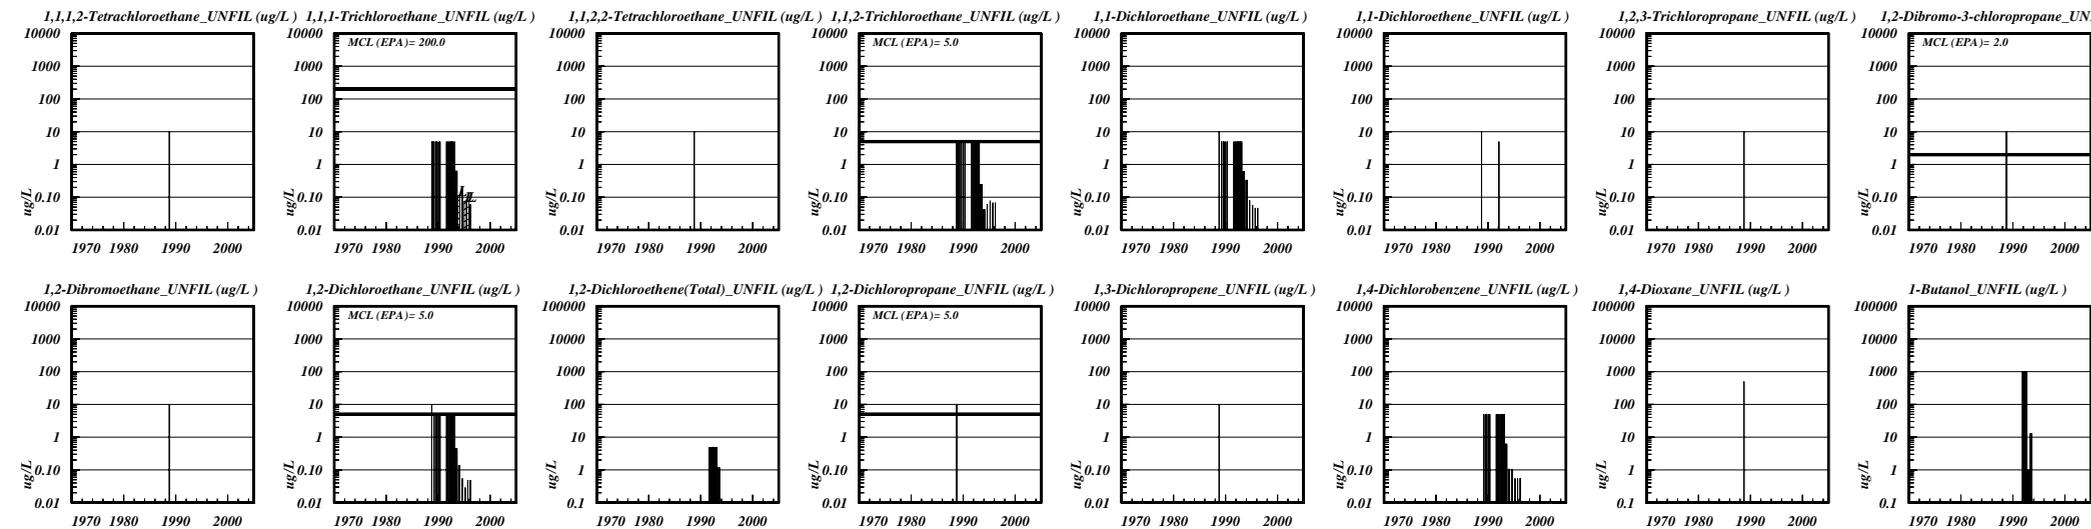


**WELLNAME=299-W7-2 WELLID=A5008**  
 Well Type=STANDARD Well purpose=GROUNDWATER  
 Owner=DOE Contact=BHI Well Adm Compliance=NON-COMPLIANT  
 X\_coord= 566302.80 Y\_coord= 137638.50 Datum=NAD83(91) Date Survey= 9/30/1994  
 Elevation= 206.00 Datum=NAVD88 Date Survey=06/27/94  
 Ref\_Point\_Desc=BRASS CAP Ref\_Point\_side=NONE Contractor=USACE(JECA)  
 Total Number of Screen Intervals=2  
 Screen#=1 Screen\_diam= 8.00 in Top= 64.62 Bottom= 67.67 m Slot\_size= 0.03 in  
 Screen\_material=Stainless Steel  
 Screen#=2 Screen\_diam= 4.00 in Top= 61.57 Bottom= 67.67 m Slot\_size= 0.03 in  
 Screen\_material=Stainless Steel  
 Total Number of Seals=4  
 Seal#=1 Depth\_top= 0.00 Bottom= 1.22 m Material=Concrete  
 Seal#=2 Depth\_top= 1.22 Bottom= 59.22 m Material=Bentonite Slurry  
 Seal#=3 Depth\_top= 59.22 Bottom= 60.44 m Material=Bentonite Pellets  
 Seal#=4 Depth\_top= 60.44 Bottom= 71.93 m Material=Sand Pack  
 More Information is at <http://www.envirodataaccess.com/wellfiles/299-W7-2.htm>

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


VOLATILE ORGANIC COMPOUNDS

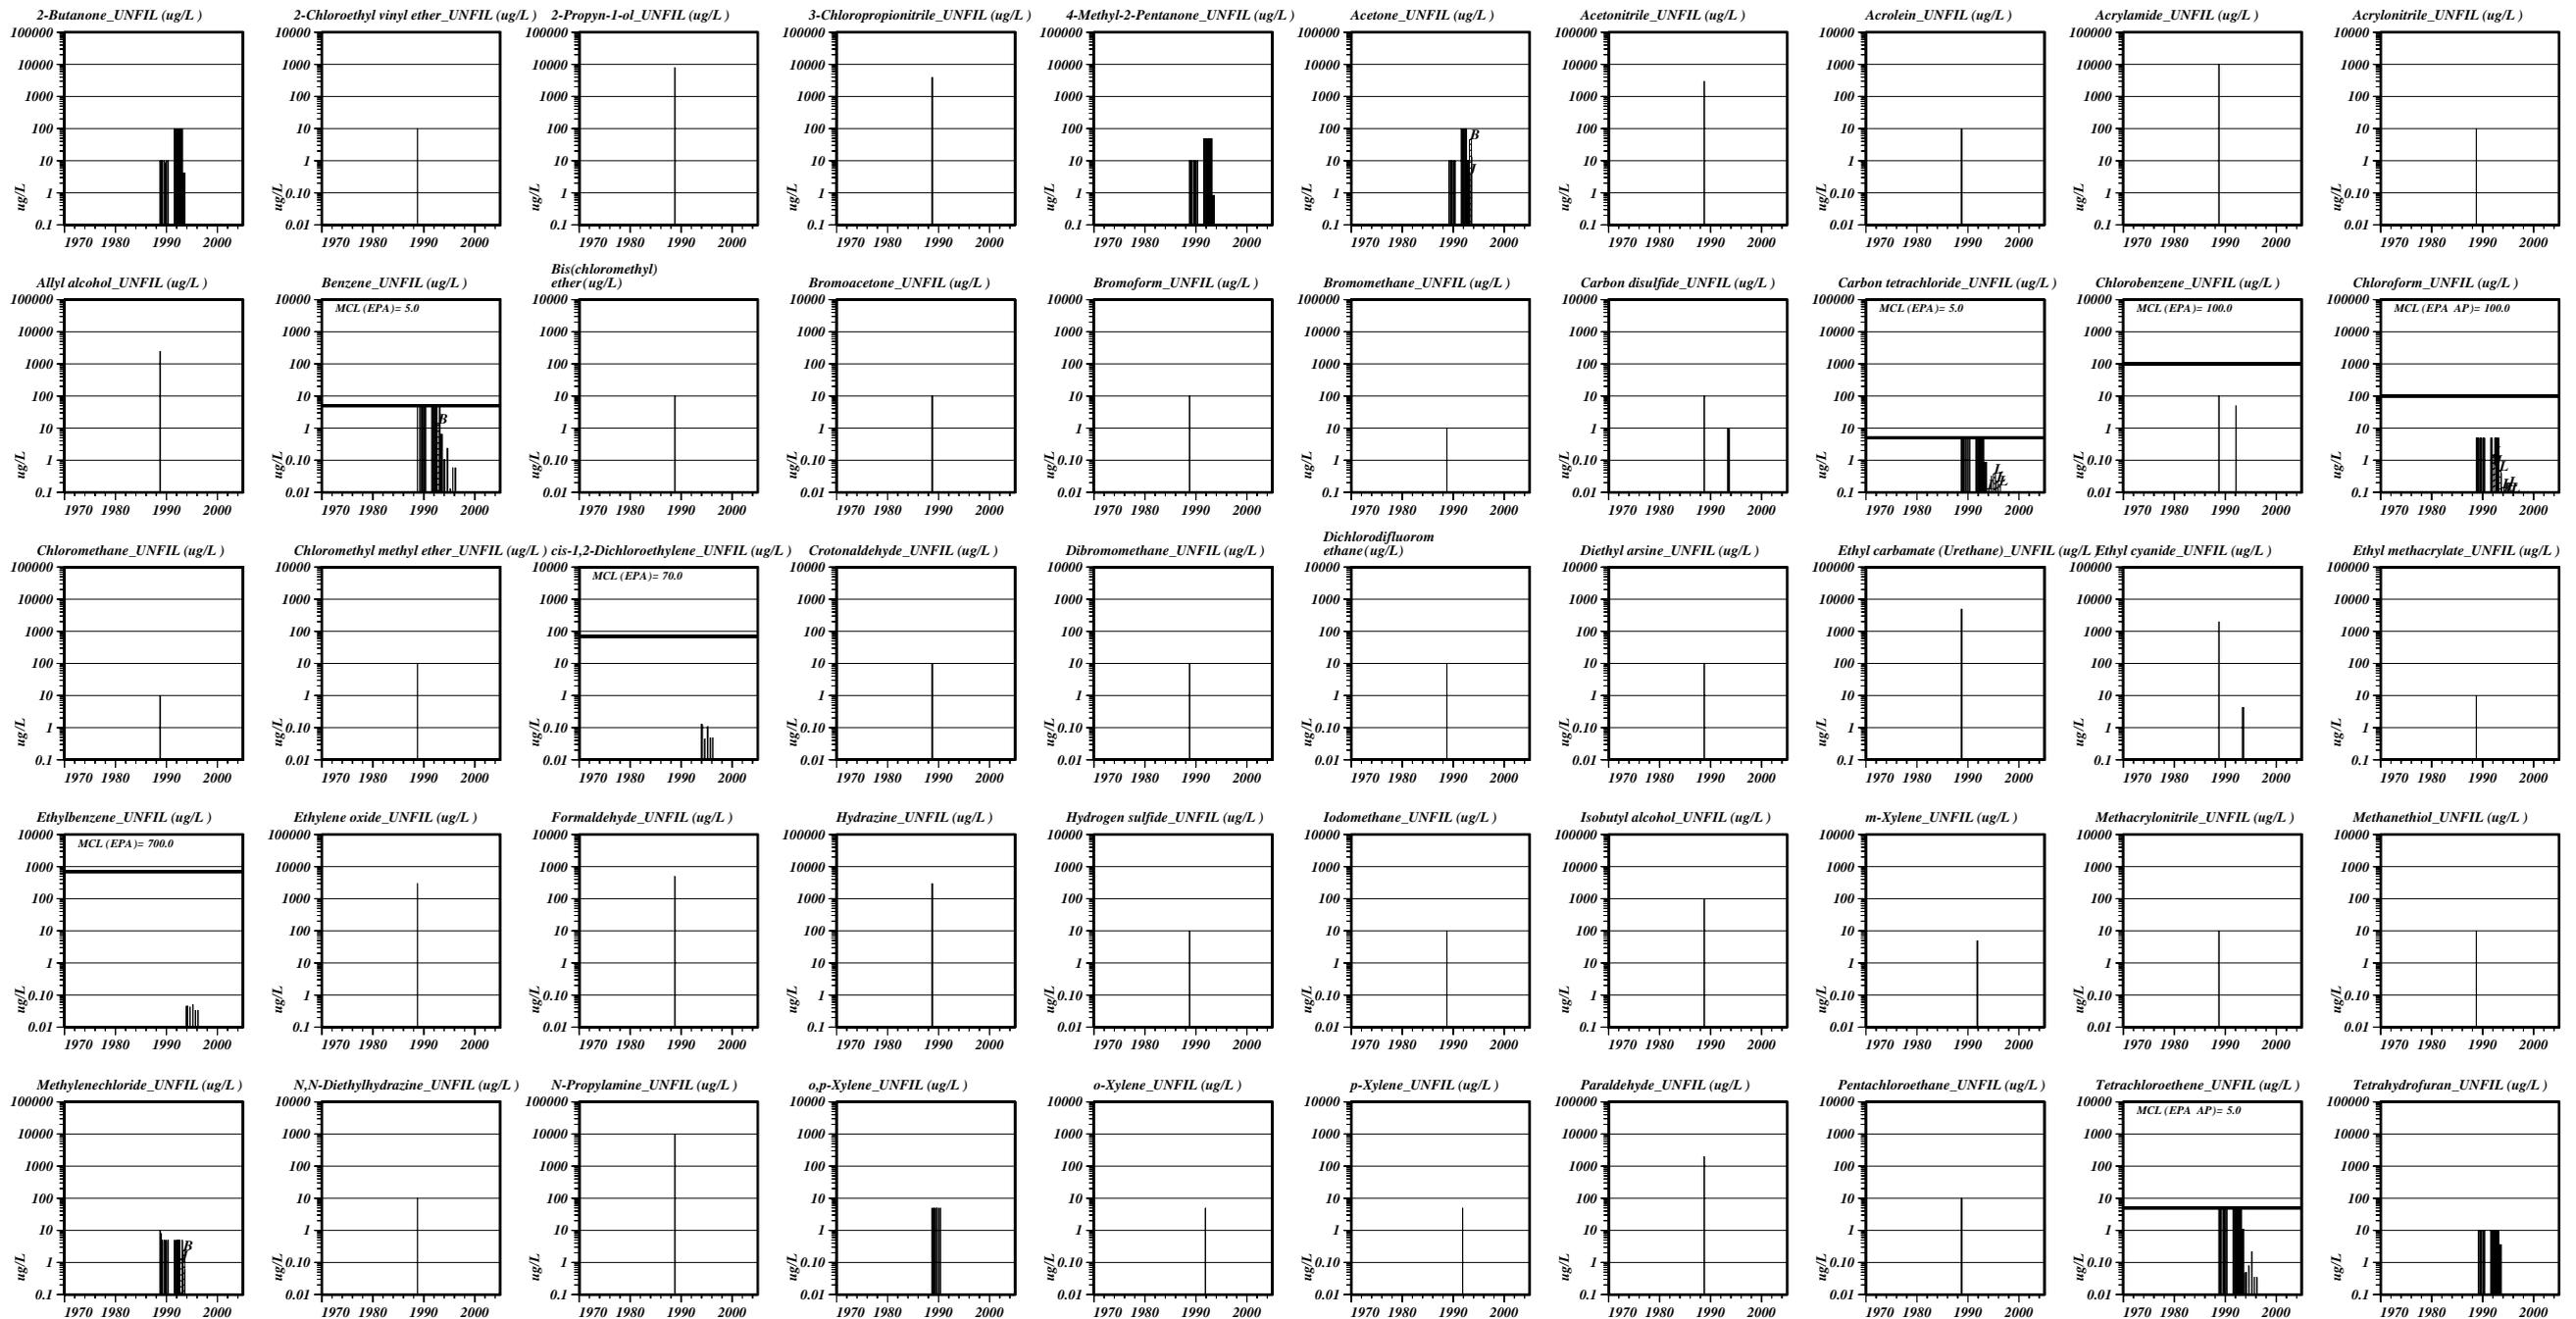


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

**VOLATILE ORGANIC COMPOUNDS**

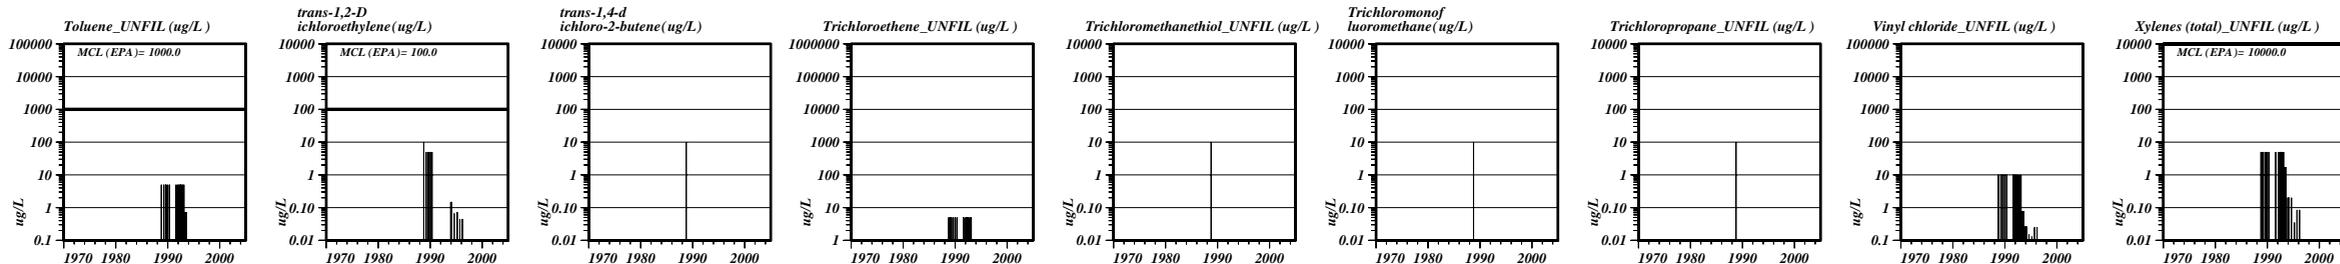


**SEMI-VOLATILE ORGANIC COMPOUNDS**

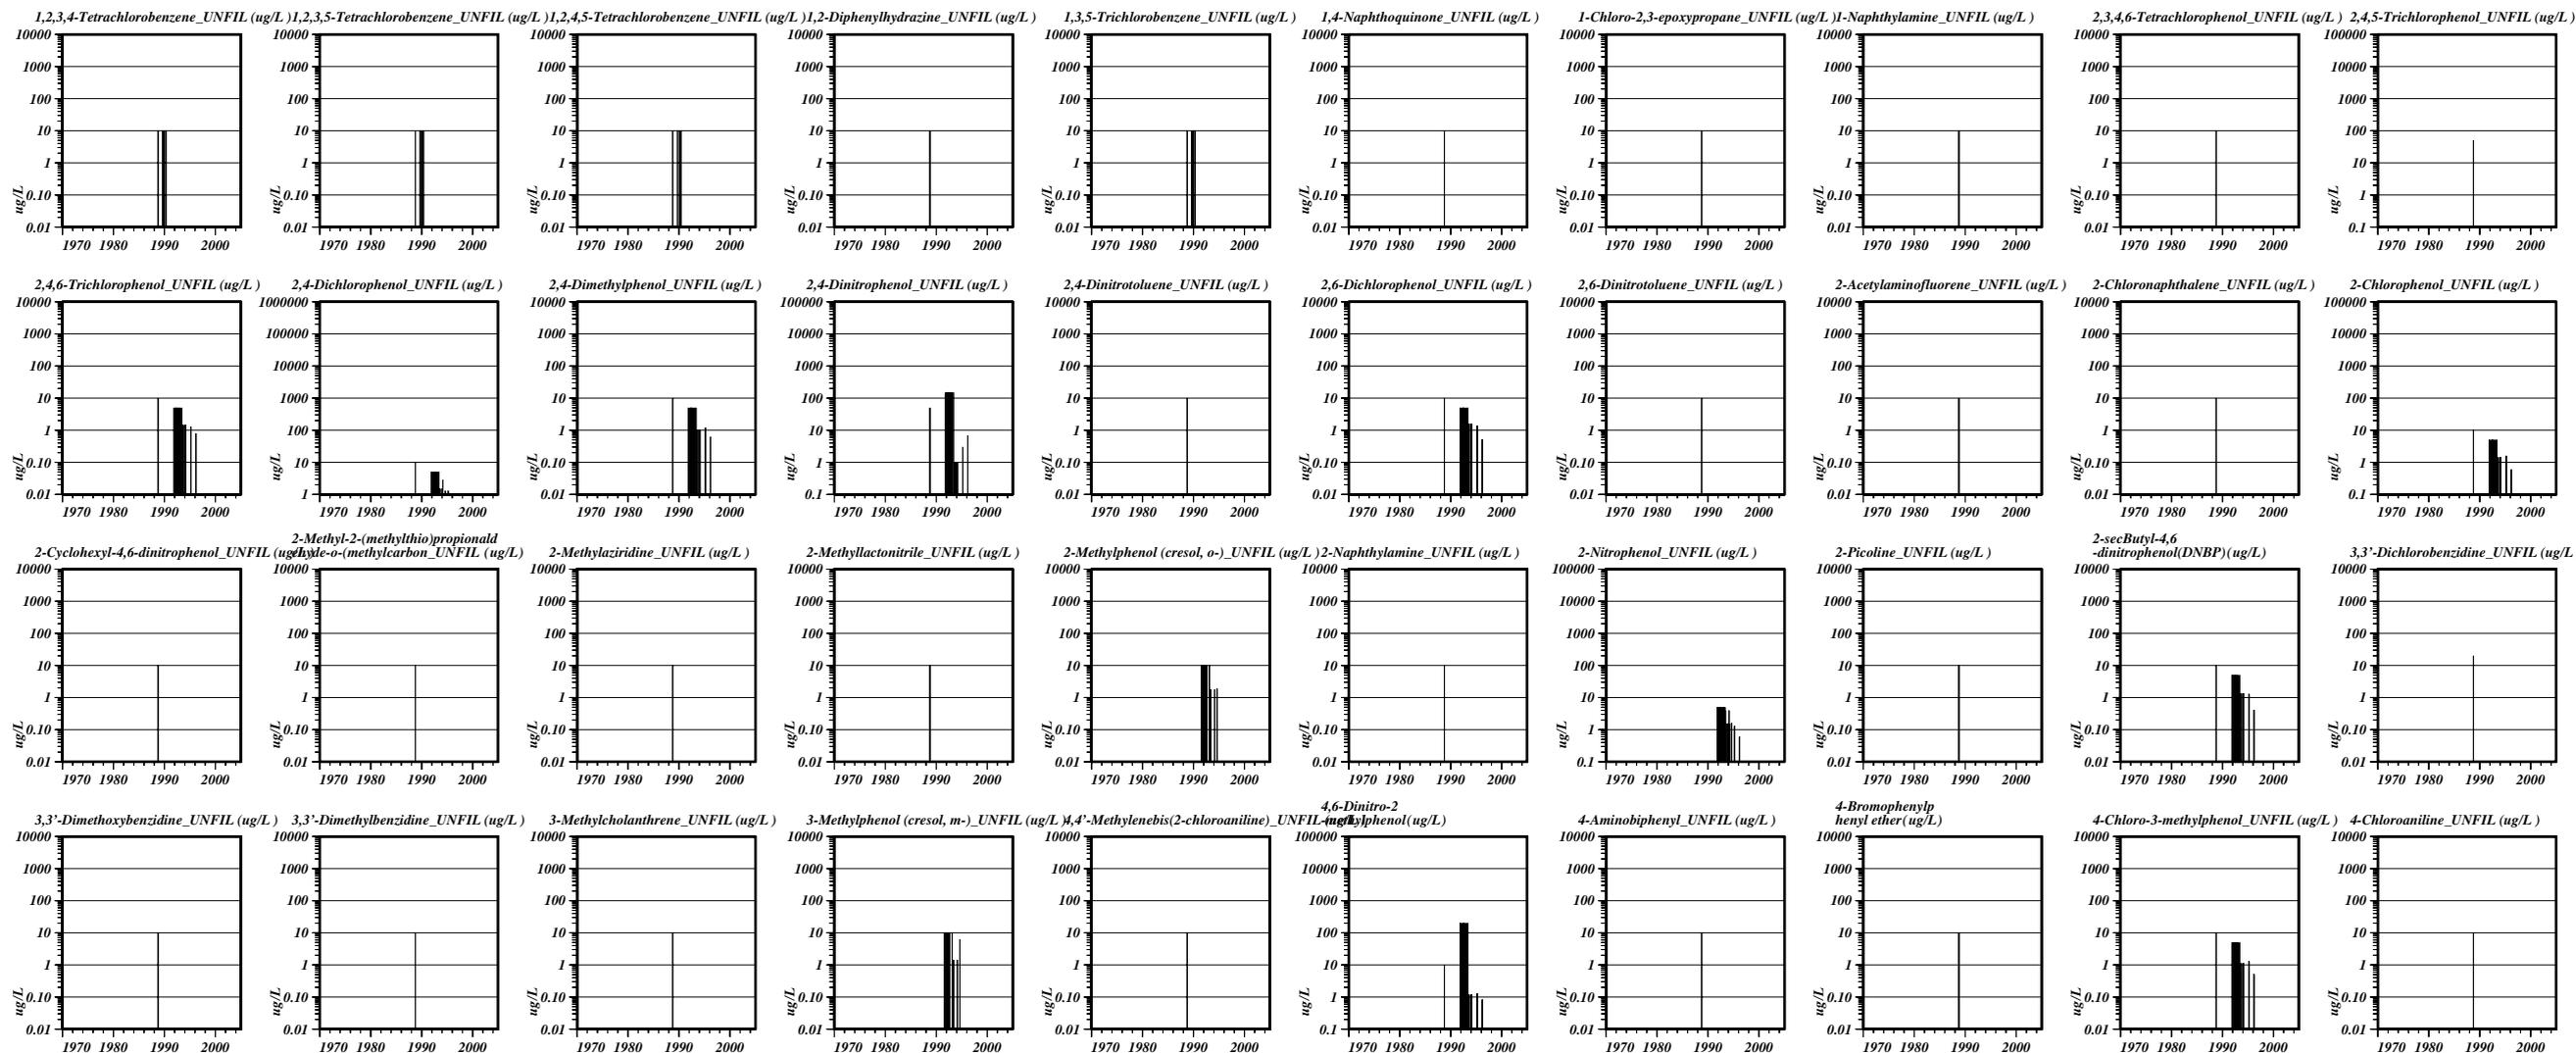

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value;L=Value between IDL and CRQL (estimated);T=Tentatively identified compound;

EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code; EXPLANATION: THICK FILLED BARS=Value Above Detection Limit;THIN BARS=Value Below Detection Limit;HATCHED BARS=Value With Data Qualifier Flag


SEMI-VOLATILE ORGANIC COMPOUNDS

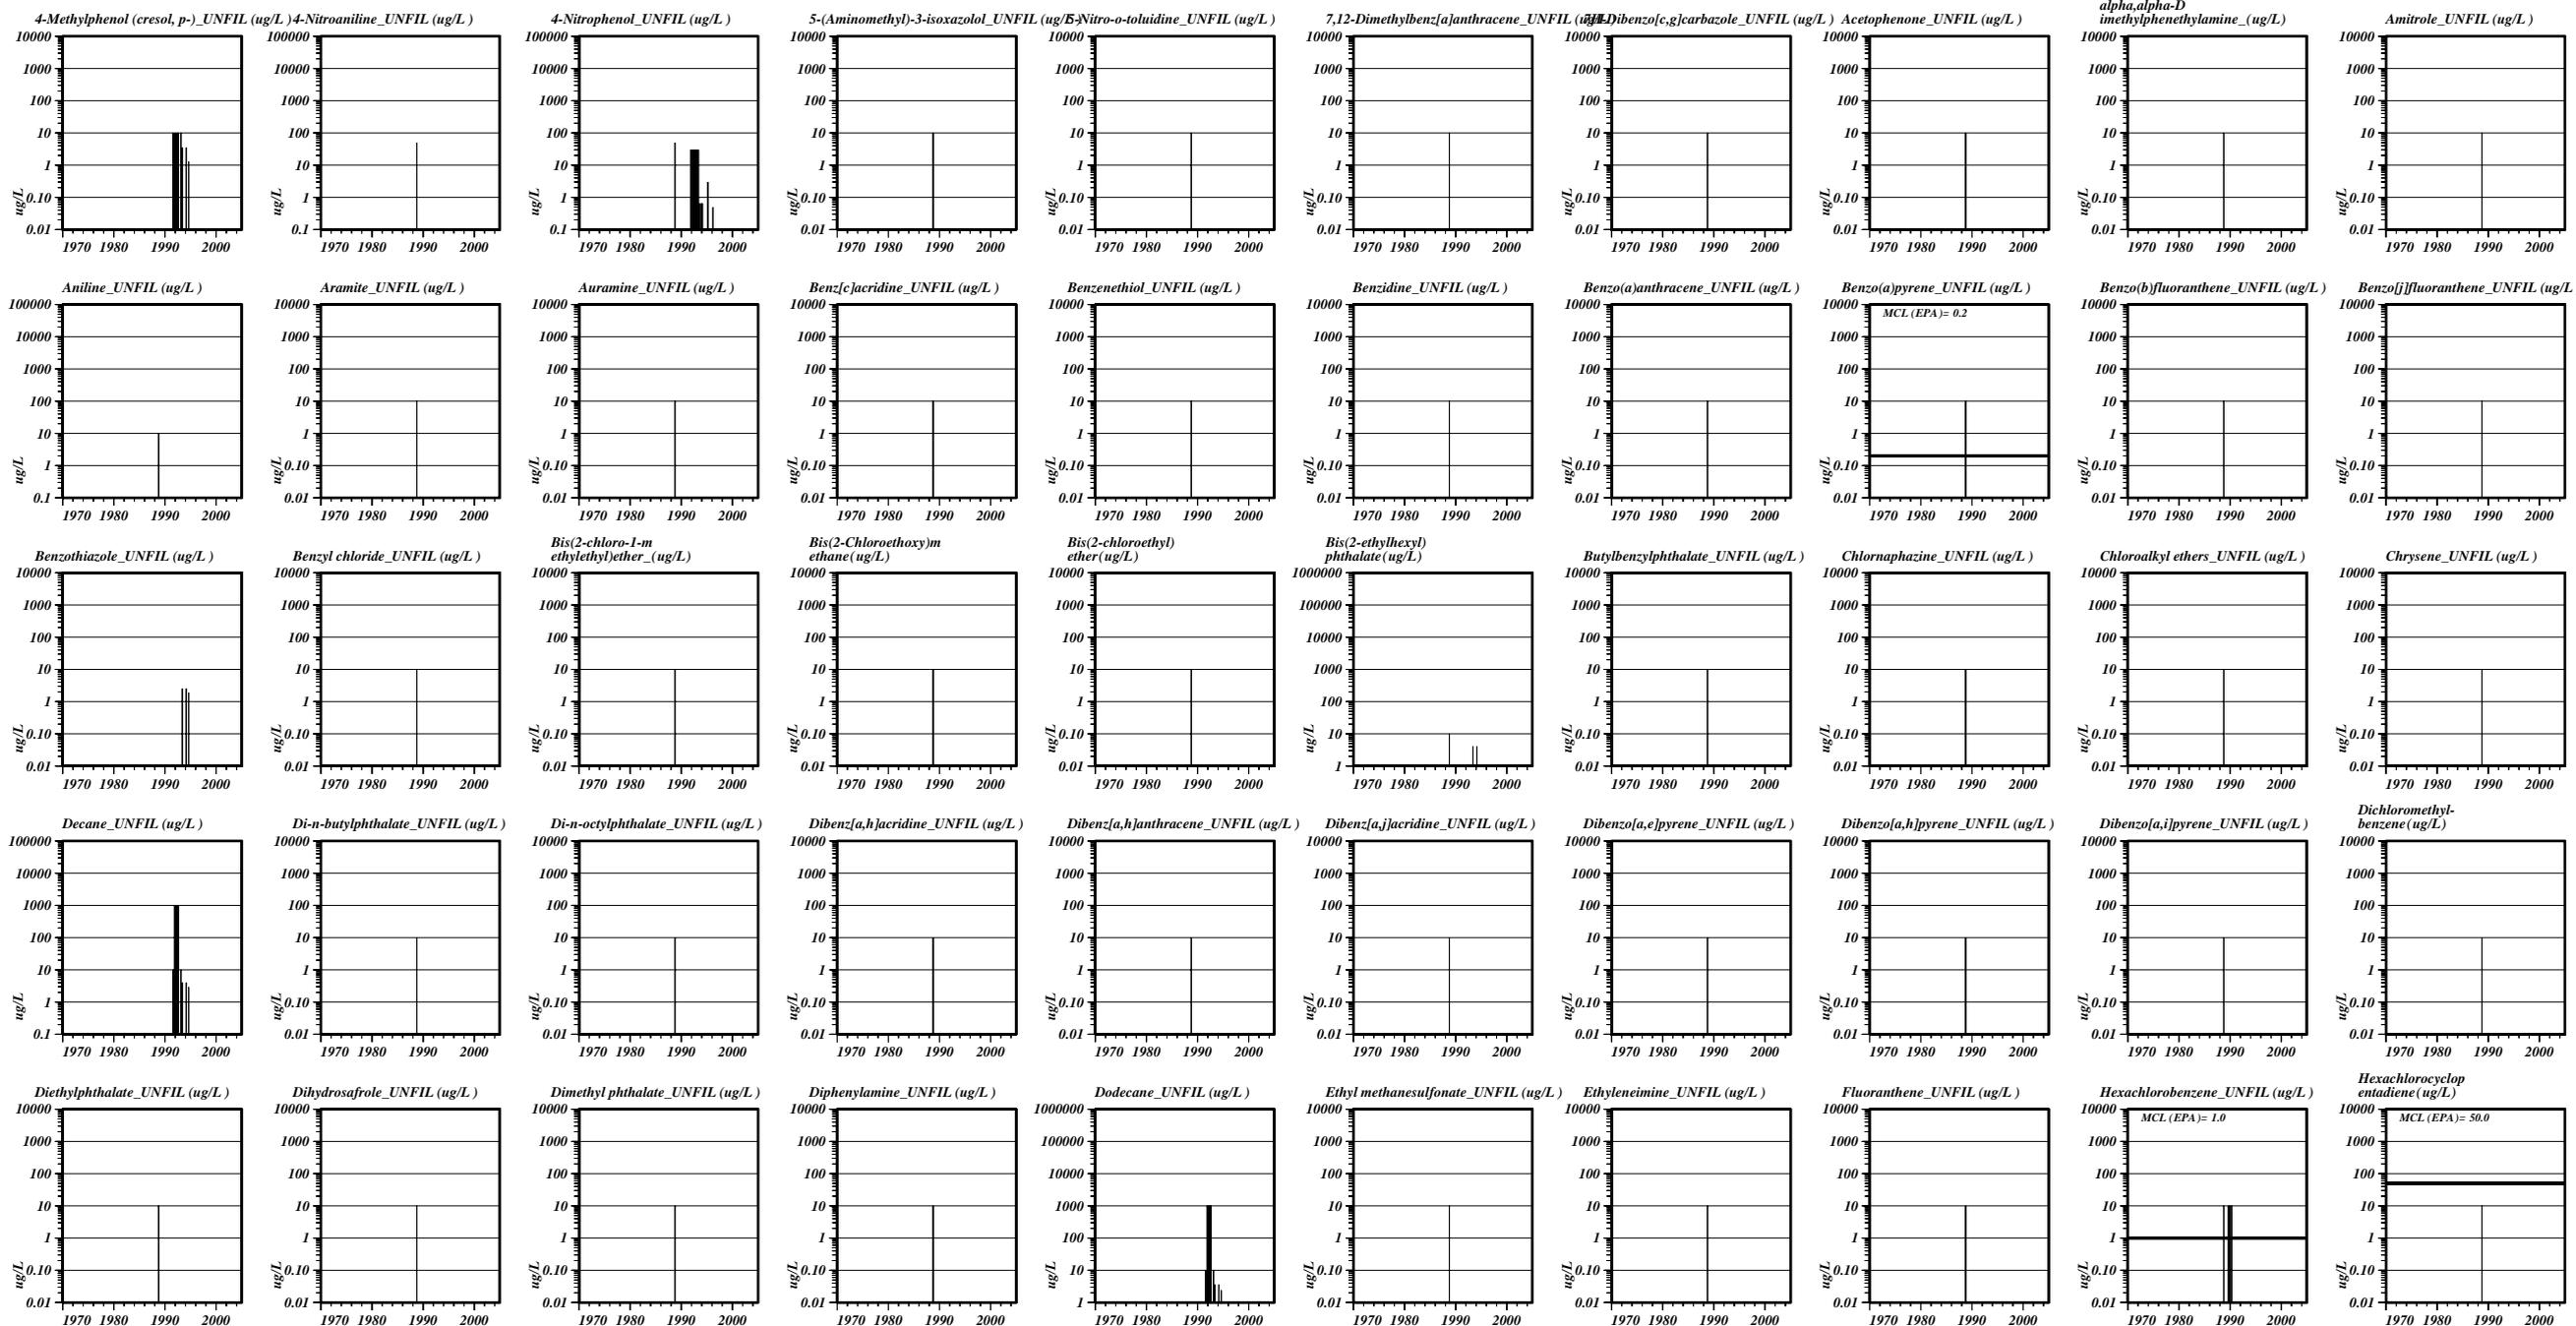

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag


SEMI-VOLATILE ORGANIC COMPOUNDS

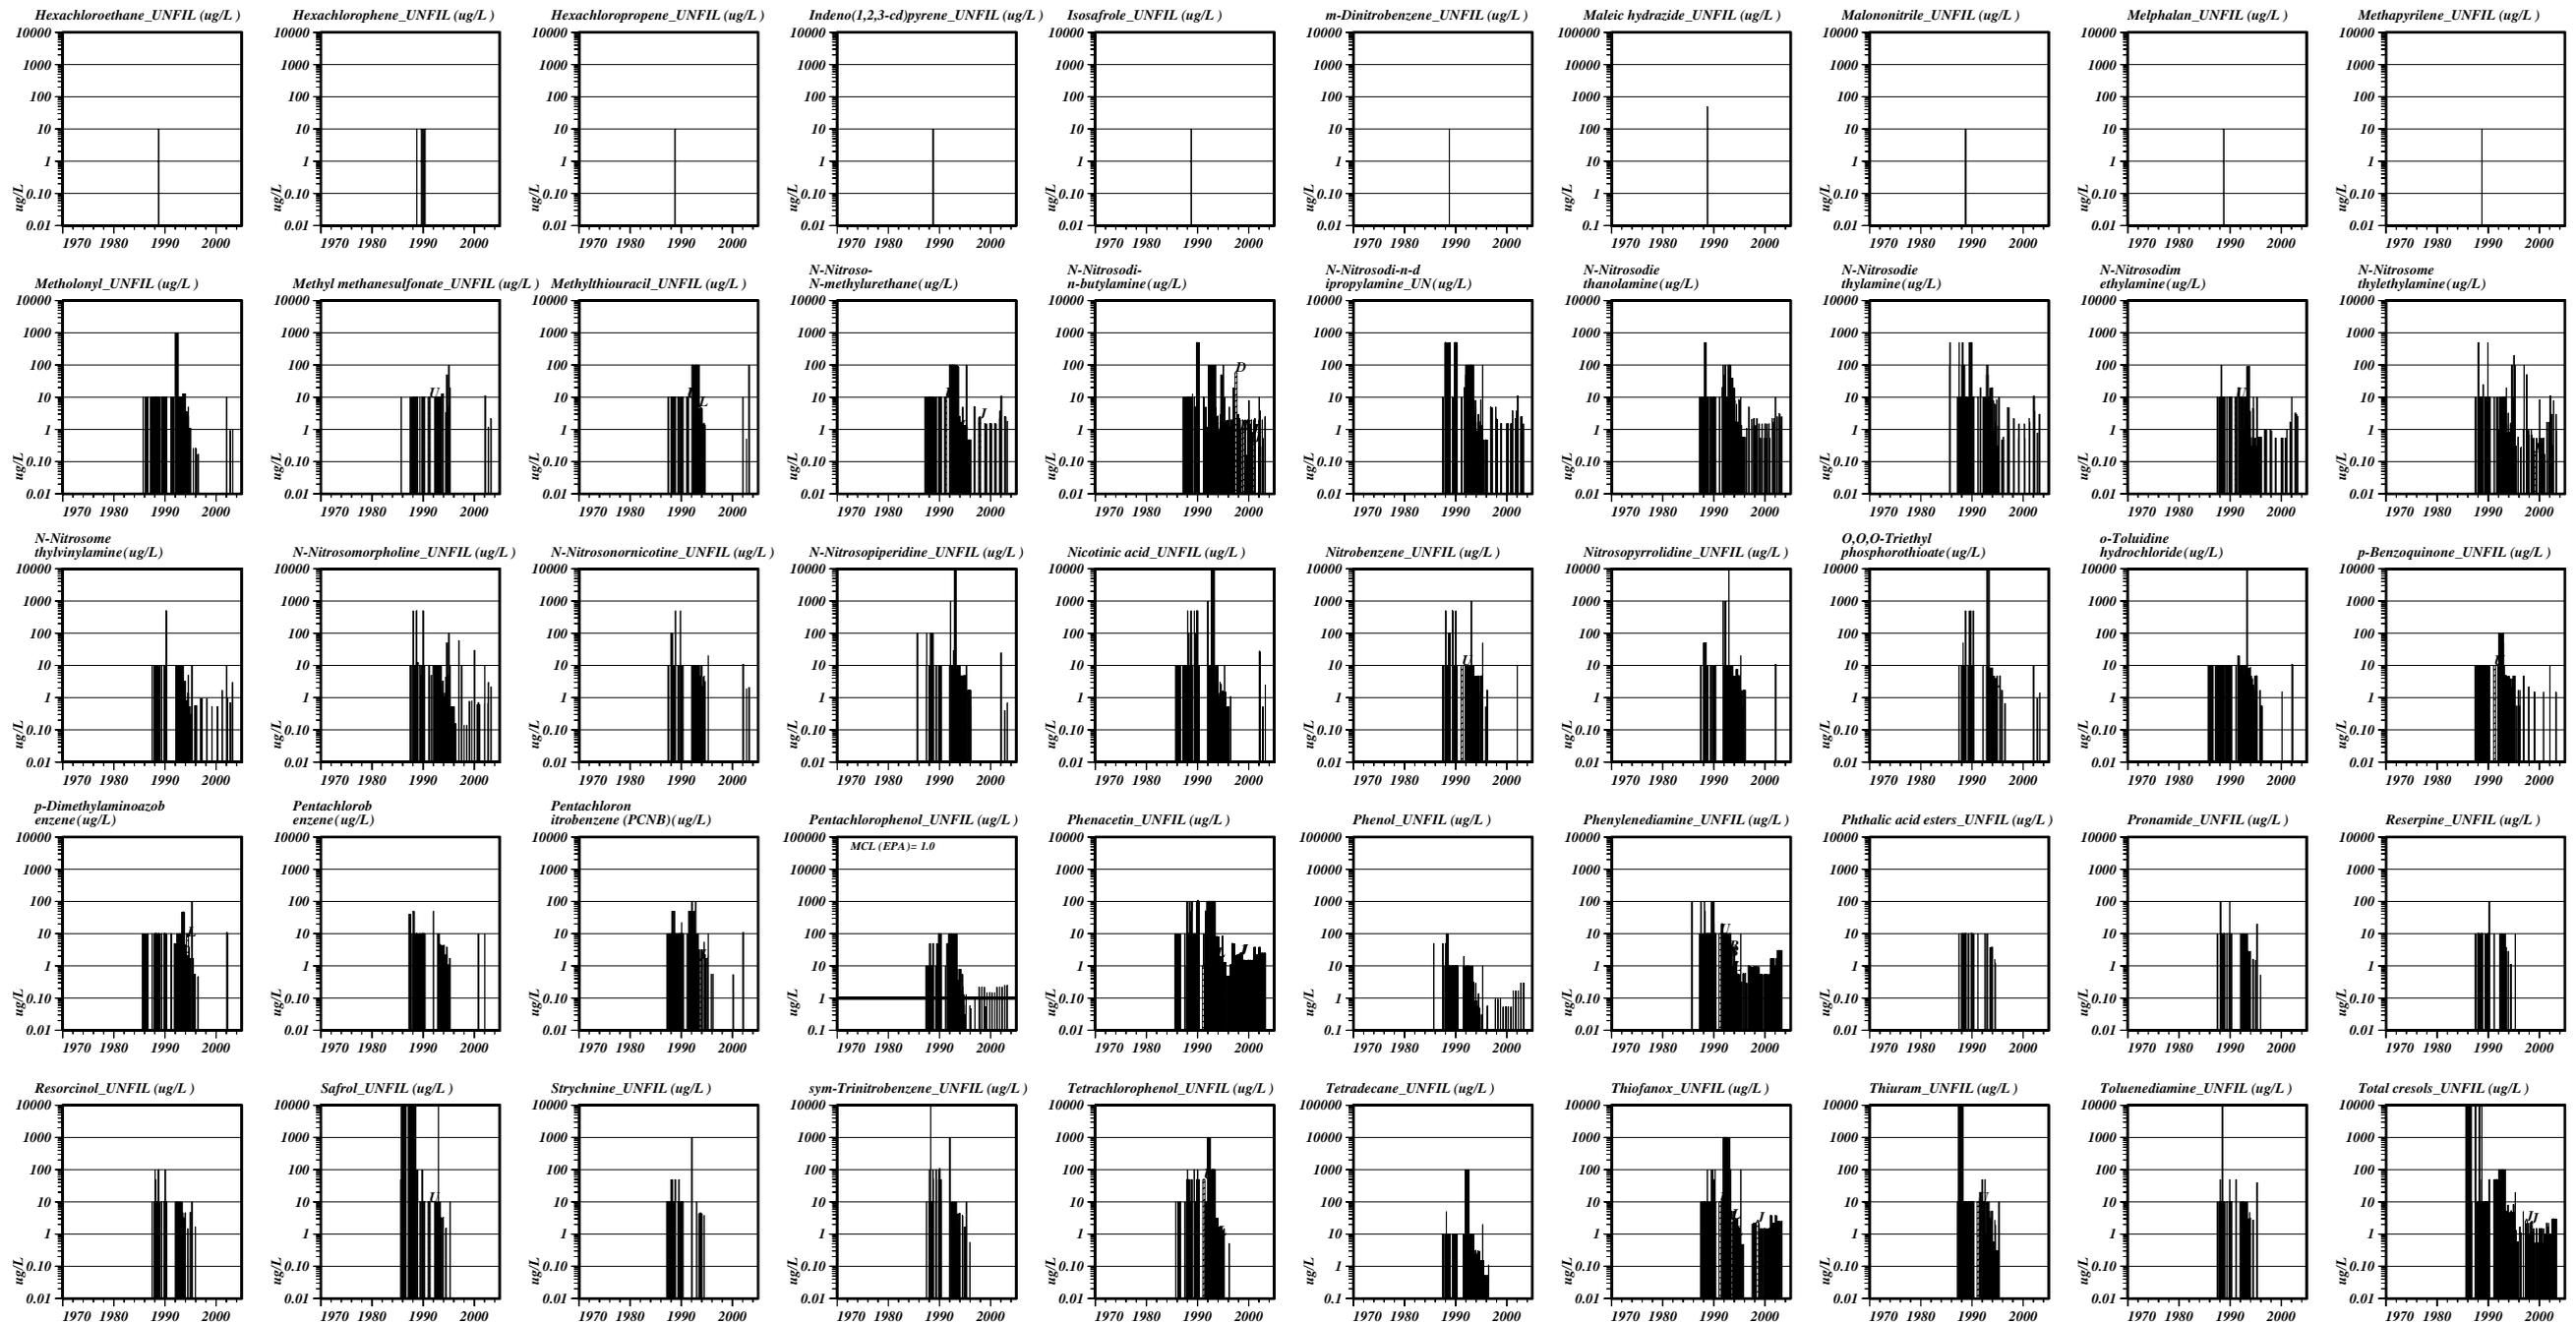


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

SEMI-VOLATILE ORGANIC COMPOUNDS

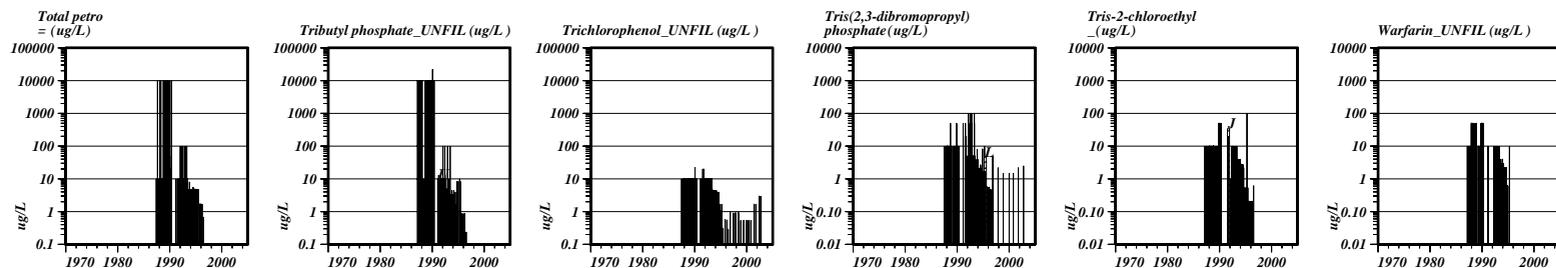


METALS & PHYSICAL PARAMETERS

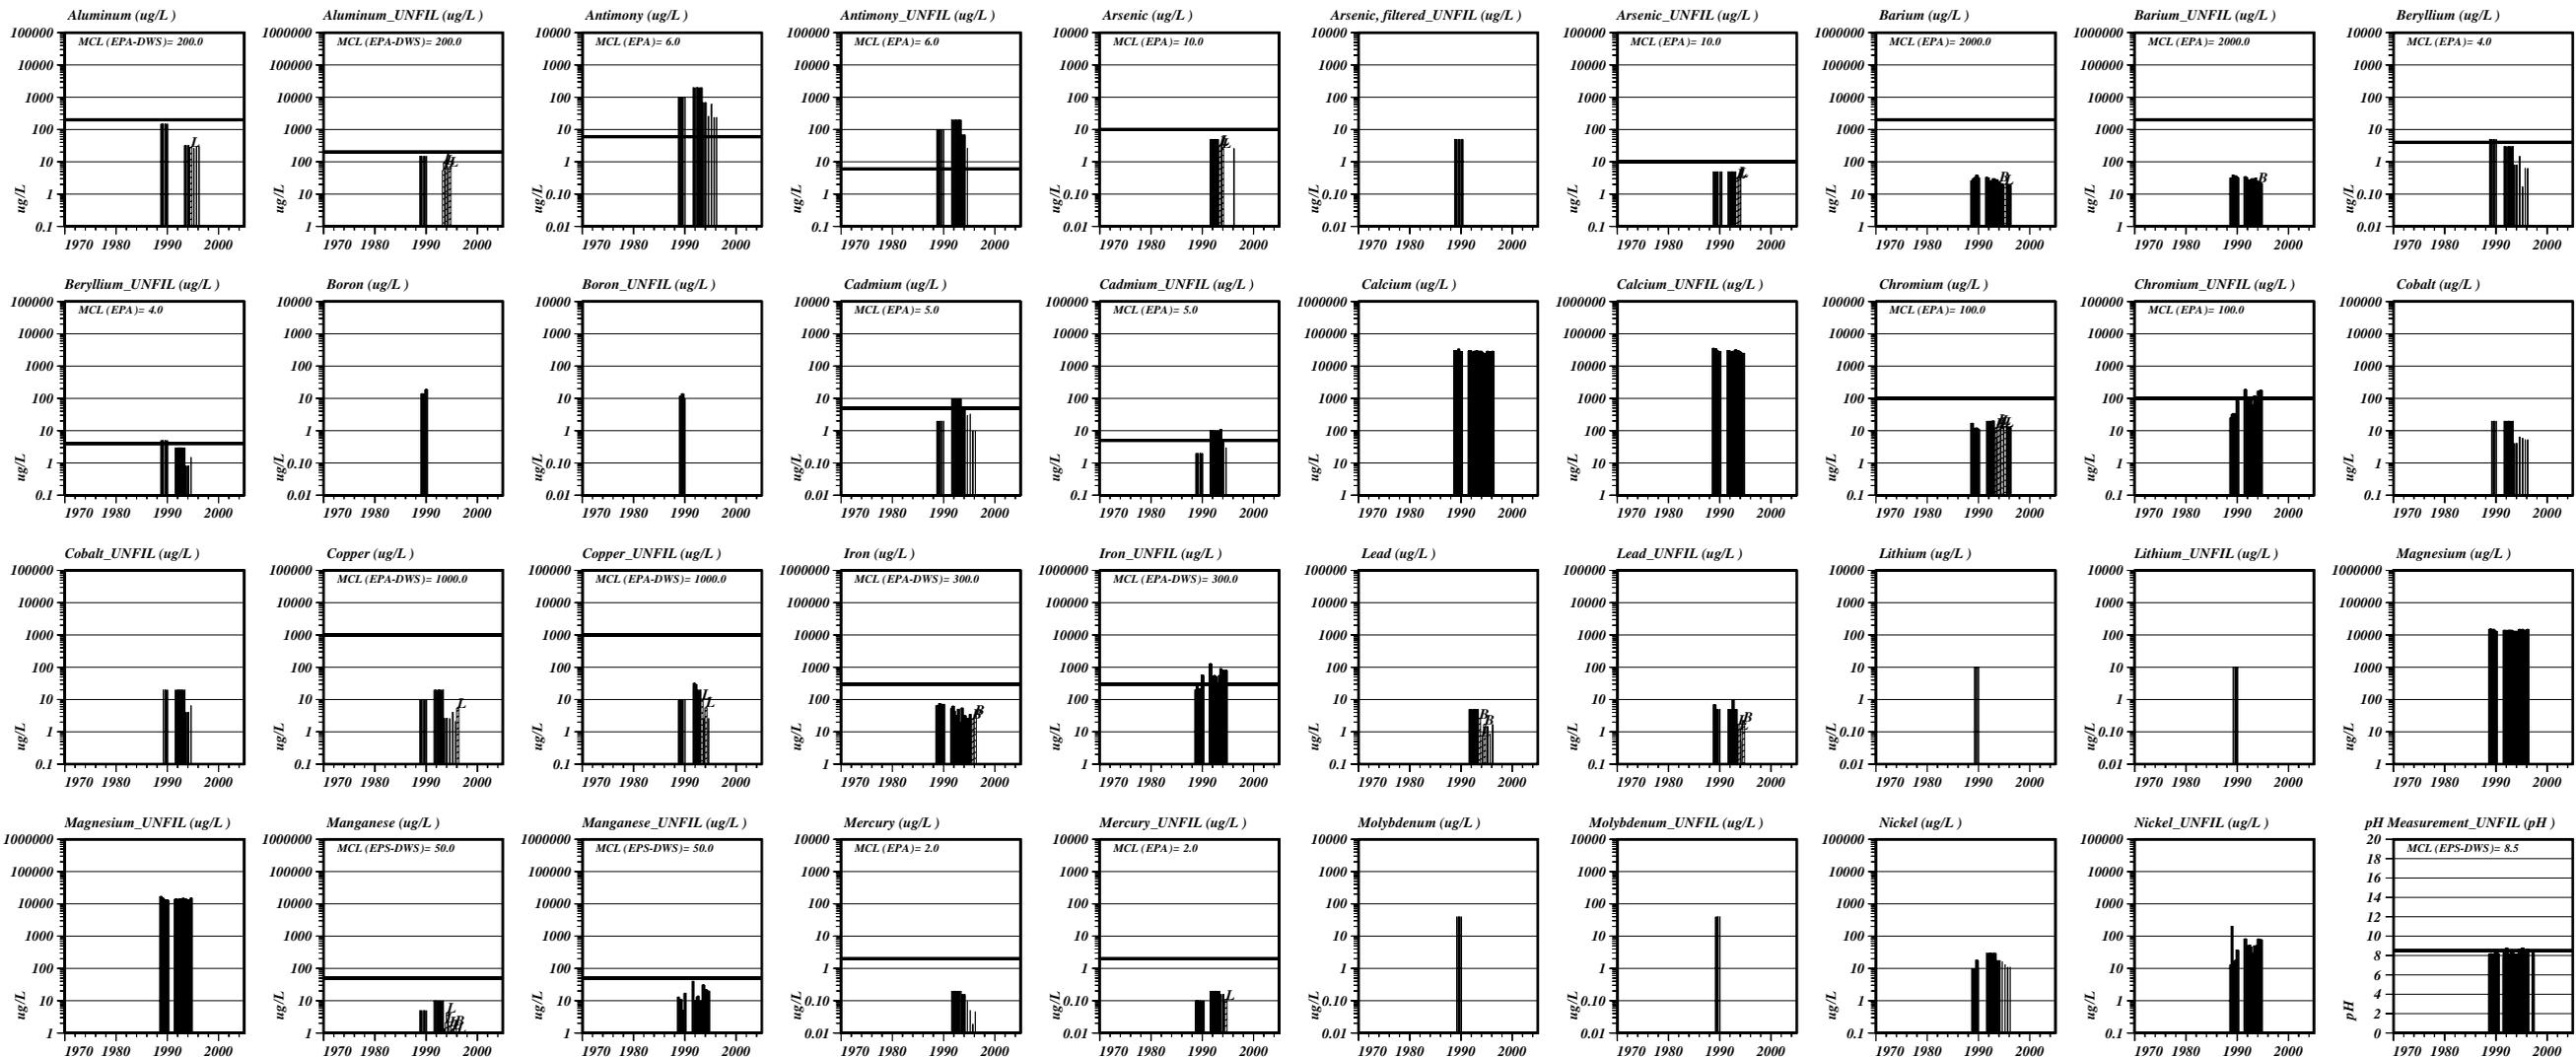


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

METALS & PHYSICAL PARAMETERS

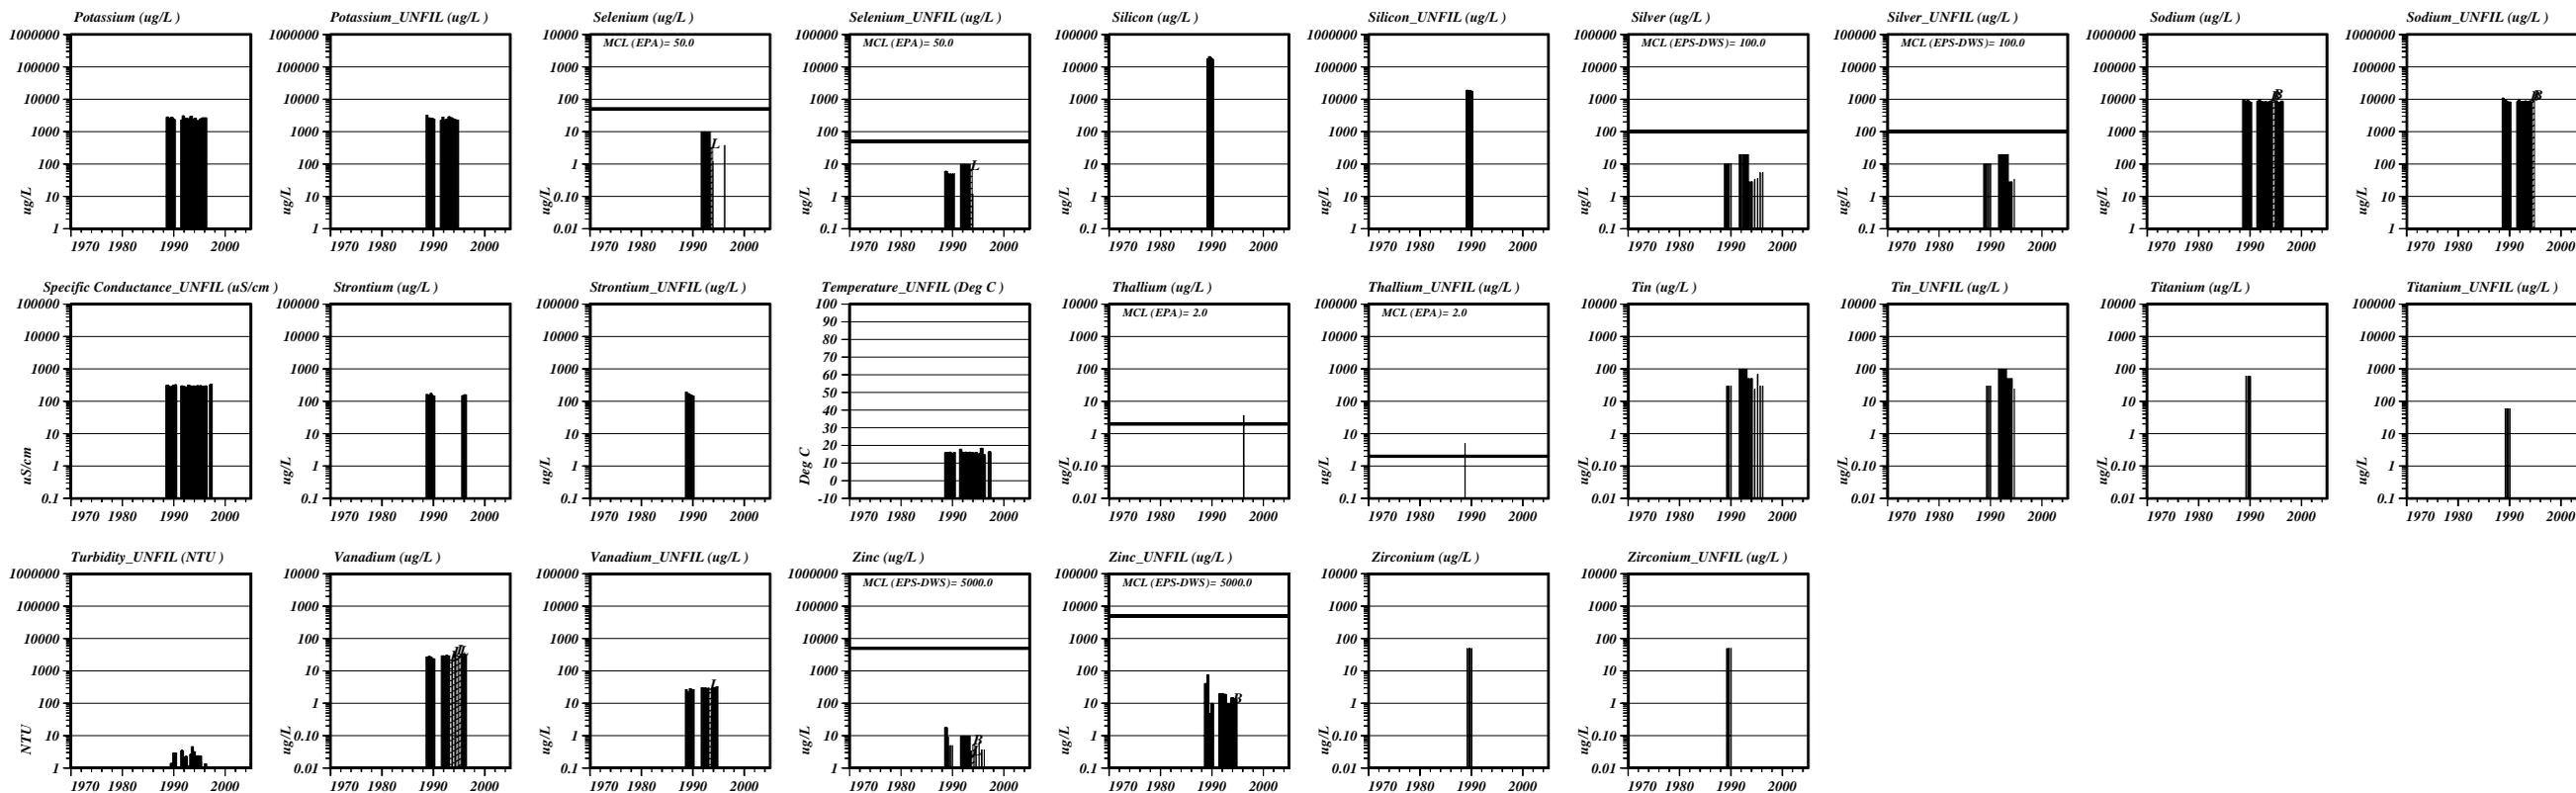


PEST/PCB, HERB, & DIOXINS

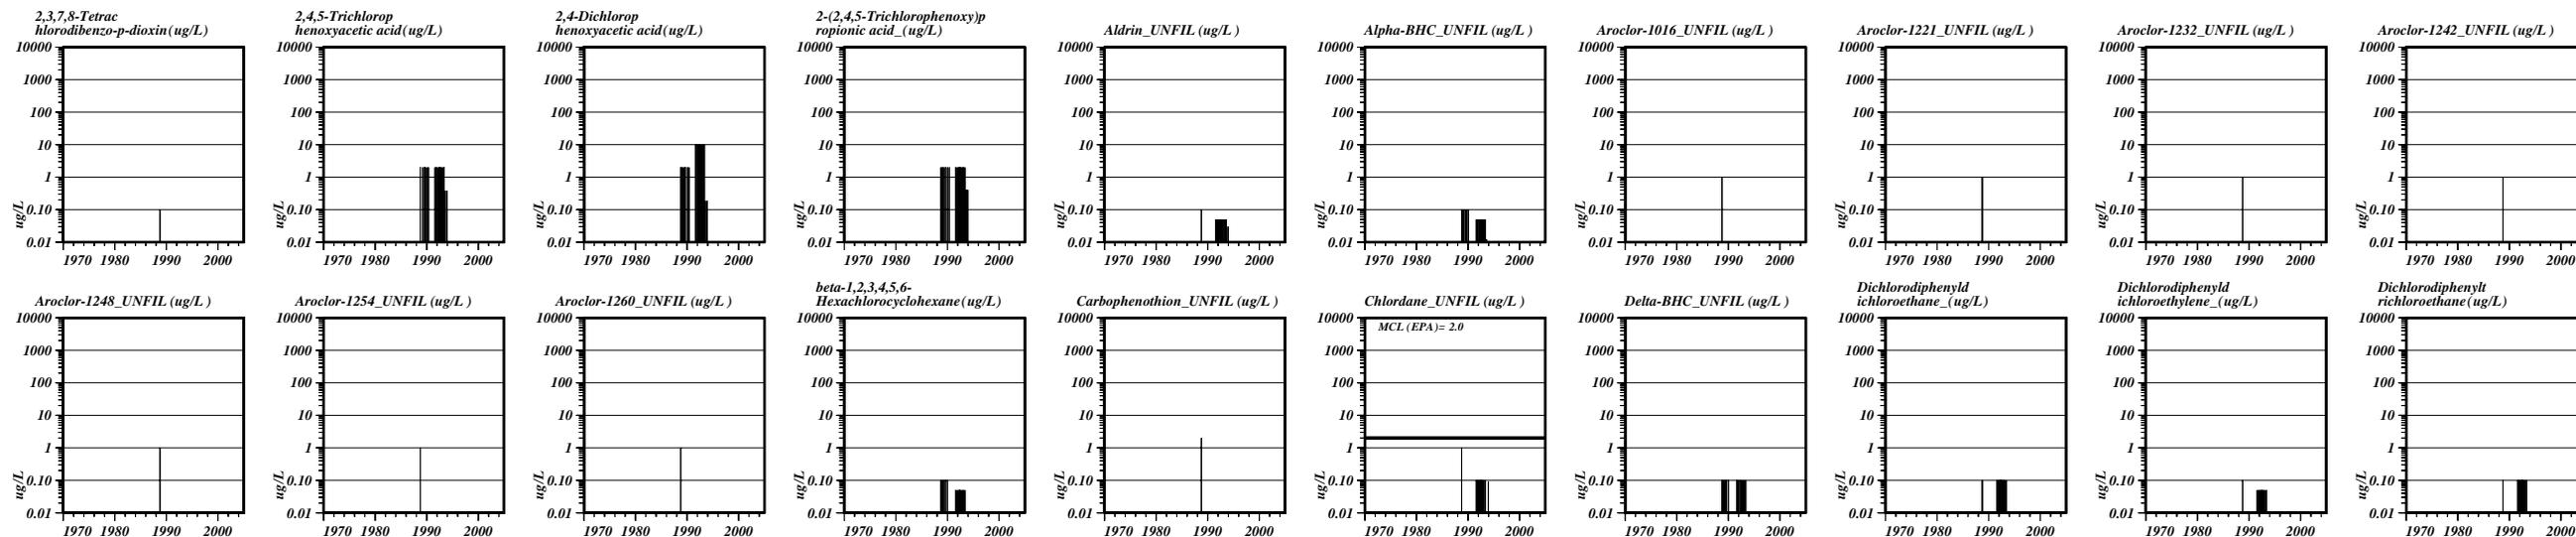


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound; EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

PEST/PCB, HERB, & DIOXINS

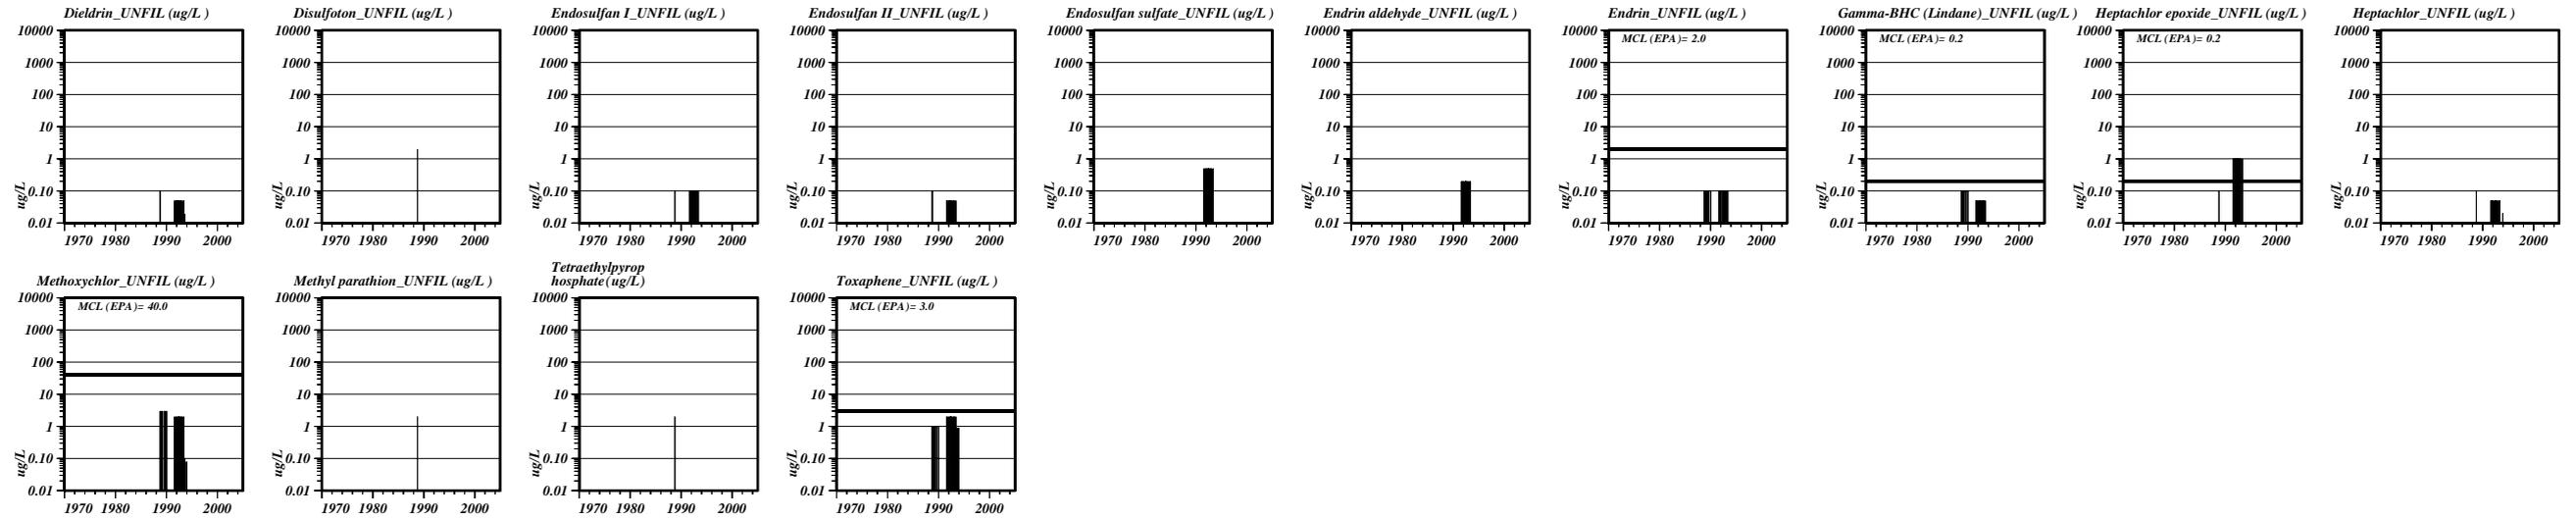

GENCHEM & ORGANICS & GENORGANICS

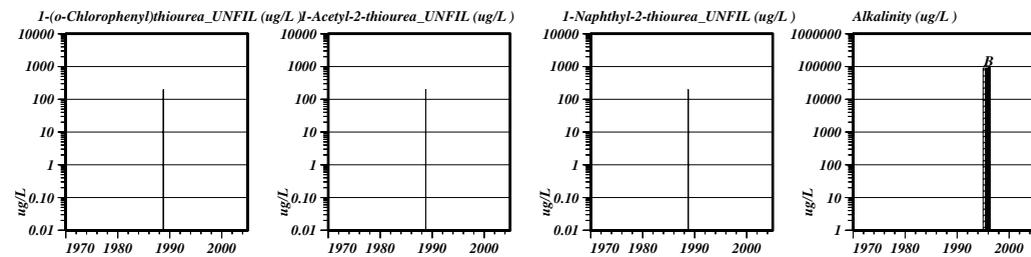

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag