



WELLNAME=399-3-1 WELLID=A5046	
Well Type=STANDARD	Well purpose=GROUNDWATER
Owner=DOE	Contact=BHI Well Addr=Compliance=NON-COMPLIANT
Well Construction Date=1/12/1994	
X_coor= 594481.30	Y_coor= 116008.00 Datum=NAD83(91) Date Survey=10/26/1992
Elevation= 118.004	Datum=NAVD88 Date Survey=10/26/92
Ref Point Desc=TOP OF CASING	Ref Point side=N Contractor=USACE(JECA)
Total Number of perforation Intervals=1	
NPERF#=1	Perf_top= 9.24 Bot= 19.81 m Cas_size= 8.00in Perf_cuts= 0.00 in

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


## SEMI-VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE

## METALS &amp; PHYSICAL PARAMETERS

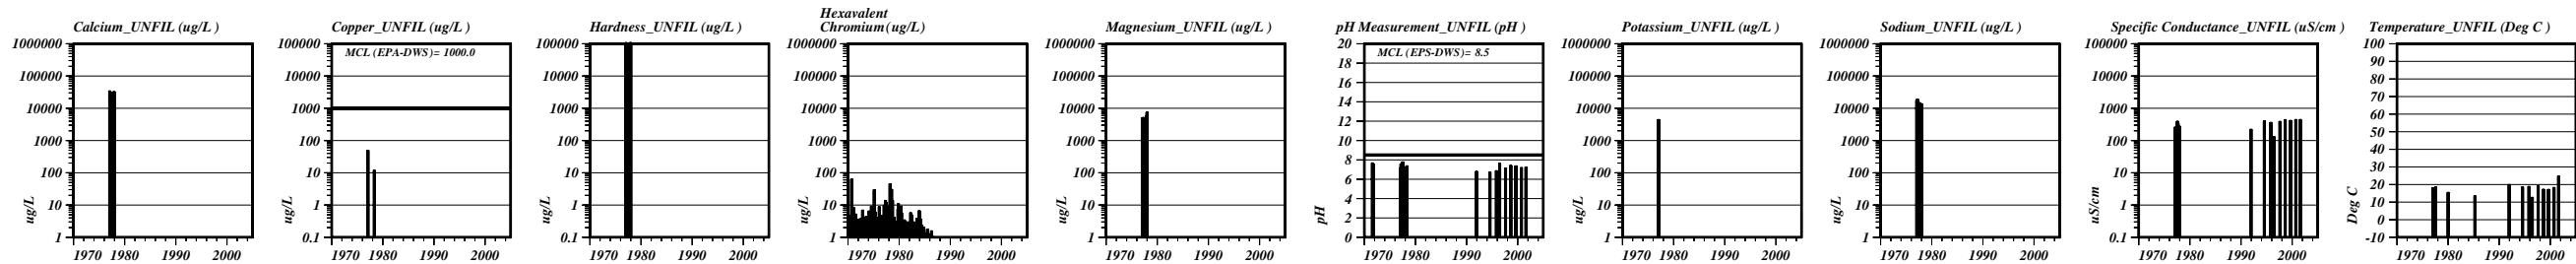

## PEST/PCB, HERB, &amp; DIOXINS NO DATA AVAILABLE

## GENCHEM &amp; ORGANICS &amp; GENORGANICS

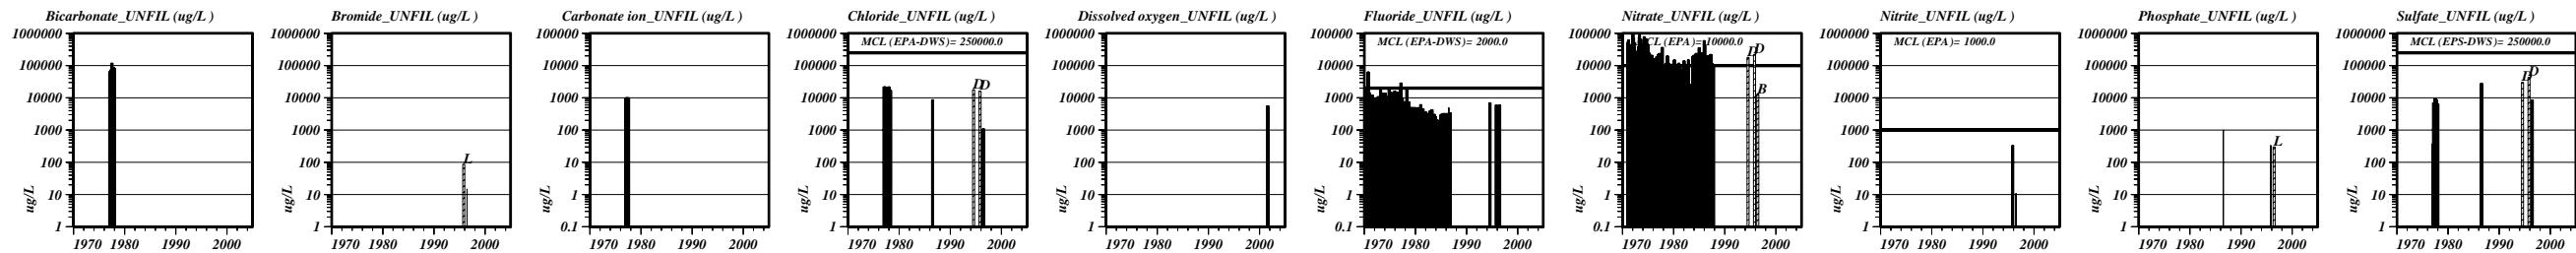

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag