
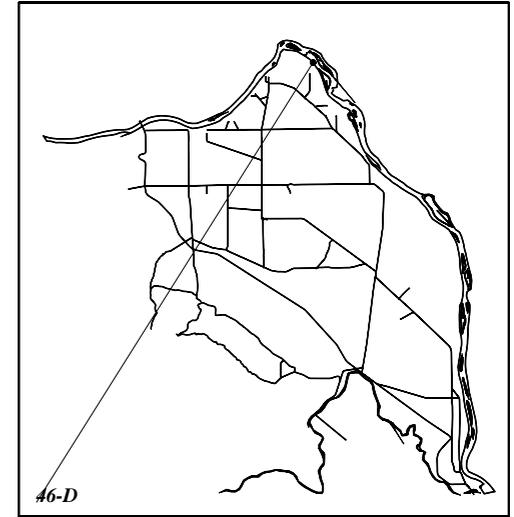





**RADIONUCLIDES**

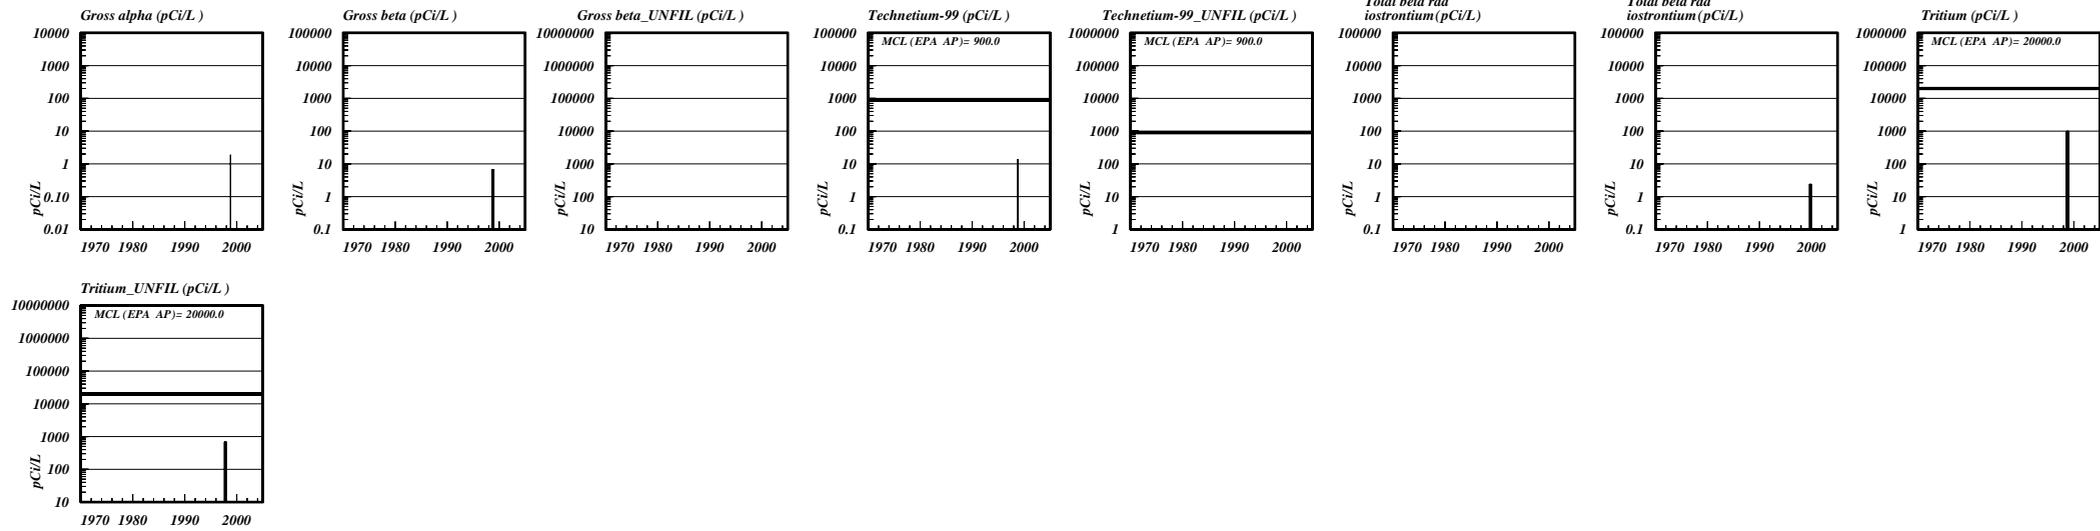

**VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE**

**SEMI-VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE**

**METALS & PHYSICAL PARAMETERS**

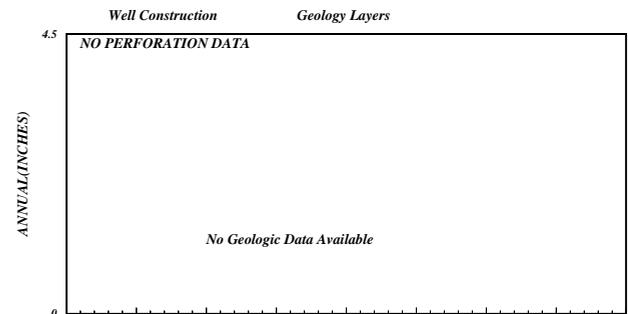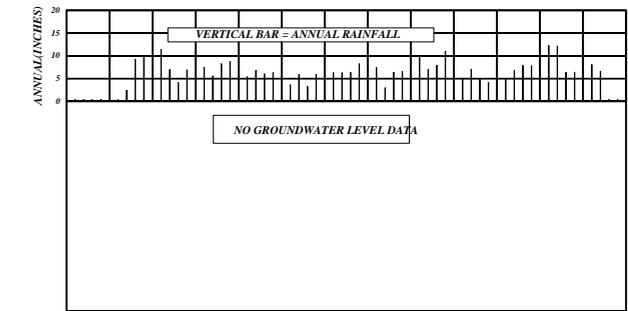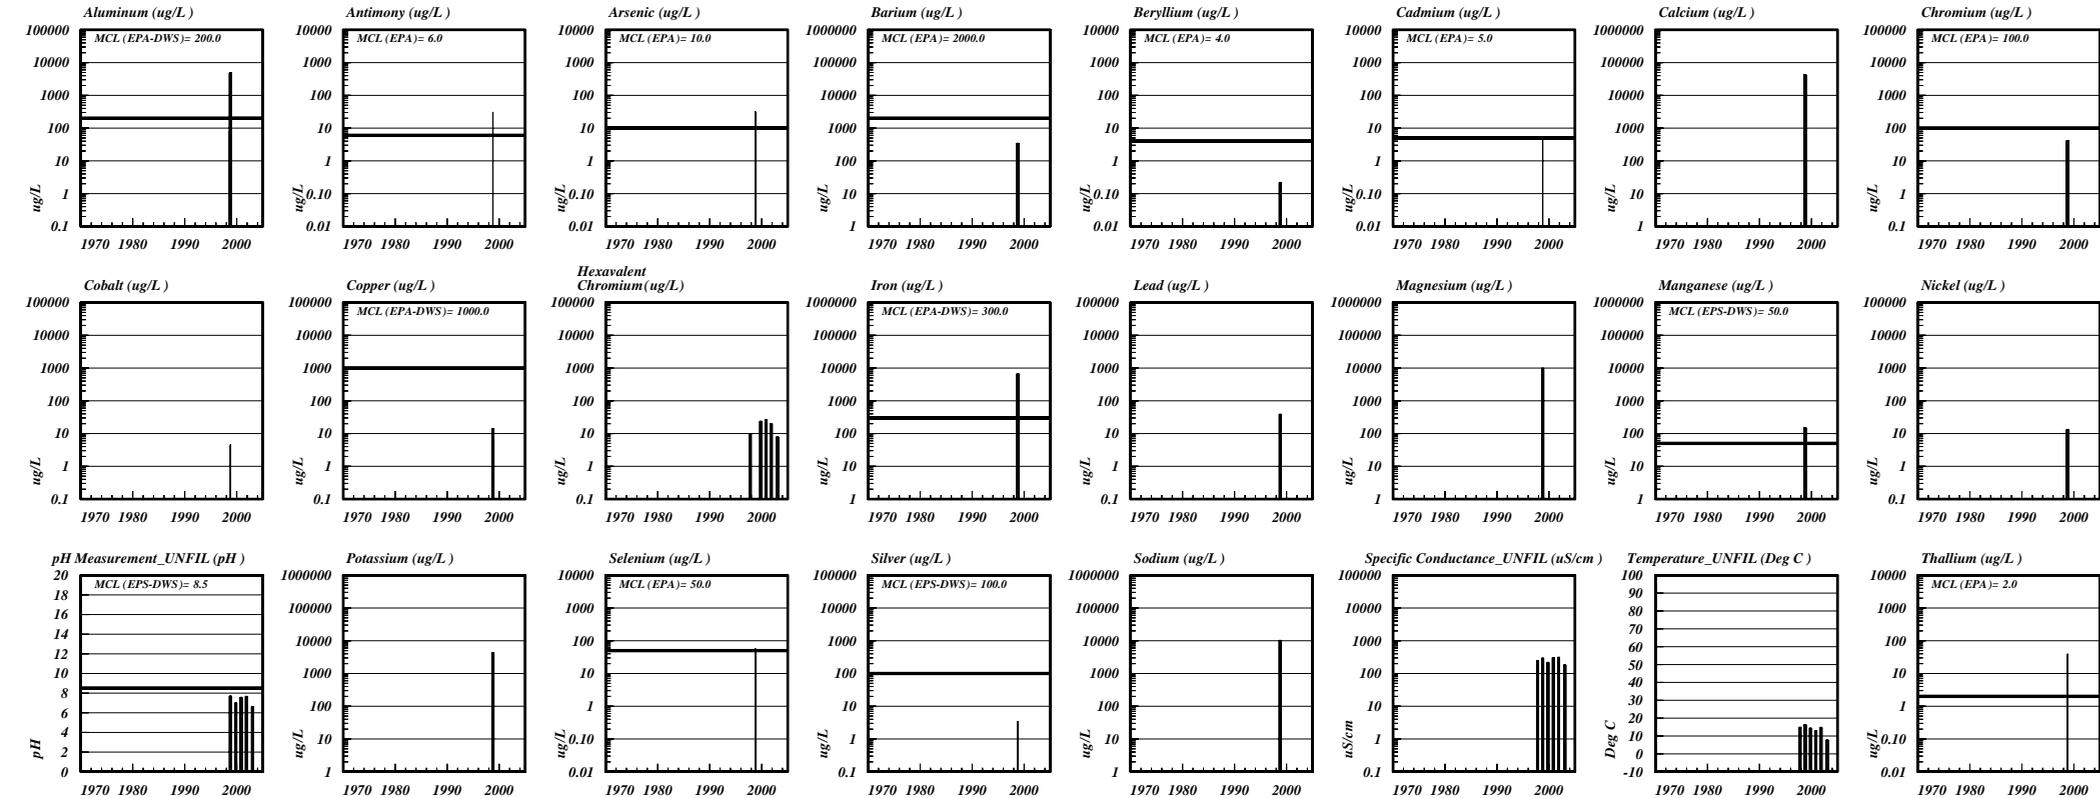


**WELLNAME=46-D WELLID=B8286**  
 Well Type=STANDARD Well purpose=AQUIFER TUBE  
 Owner=DOE Contact=Peterson, Robr Compliance=VARIANCE  
 X\_coord= 578031.50 Y\_coord= 152998.30 Datum=NAD83(91) Date Survey=11/24/1997  
 Well\_Comment= Port Identifier 46-D; BHI-01153

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound; EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;


EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

**METALS & PHYSICAL PARAMETERS**

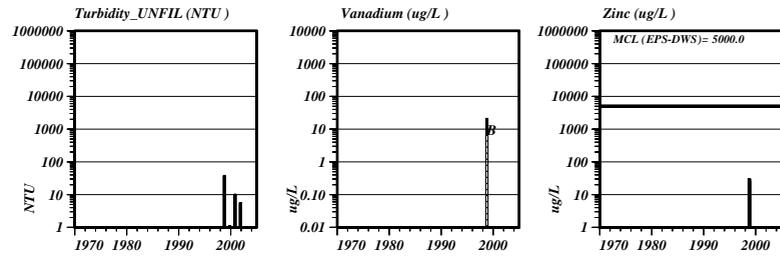

**PEST/PCB, HERB, & DIOXINS NO DATA AVAILABLE**

**GENCHEM & ORGANICS & GENORGANICS**

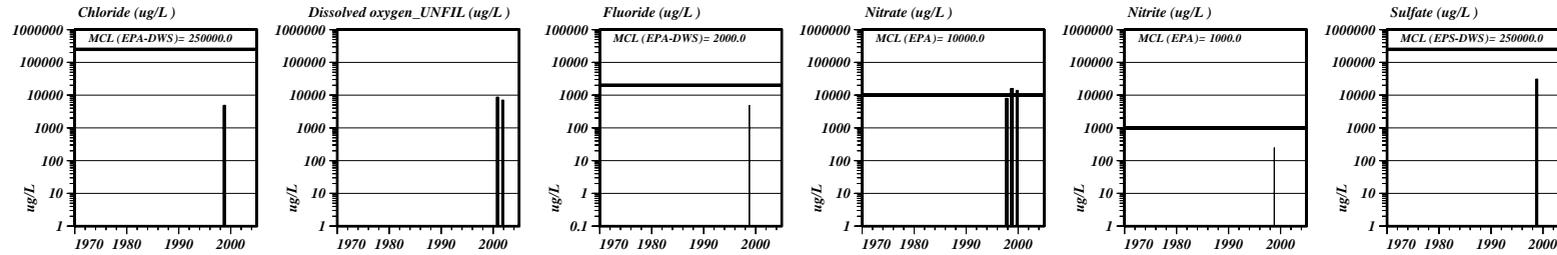

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
 EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag