

DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-36-61A

DOE HANFORD SITE

GROUNDWATER MONITORING

WELL 699-36-61A

WELL ID: A5144

WELL NUMBER: 699-36-61A

WELL LOCATION: 571395.50, 134557.10

WELL DEPTH: 229.00 m

WELL DIA.: 112.17 mm

WELL TYPING: STANDARD

WELL USE: GROUNDWATER

WELL OWNER: DOE

WELL ADDRESS: ContractBHI

WELL COMPLIANCE: NON-COMPLIANT

WELL CONSTRUCTION DATE: 9/19/1994

WELL ELEVATION: 229.00 m

WELL DATUM: NAD83(91)

WELL SURVEY DATE: 9/30/1994

REF POINT DESC: TOP OF CASING

REF POINT SIDE: N

CONTRACTOR: USACE(JECA)

TOTAL NUMBER OF PERFORATION INTERVALS: 1

NPERF#: 1

PERF_top: 100.58

Bot: 118.57

mCas_size: 8.00 in

Perf_cuts: 0.00 in

TOTAL NUMBER OF SEALS: 2

Seal#1 Depth_top: 110.64

Bottom: 112.17 m

Material: Internal Cement Grout

Seal#2 Depth_top: 112.17

Bottom: 118.87 m

Material: Backfill



More Information is at <http://www.envirodataaccess.com/wellfiles/699-36-61A.htm>

LABORATORY QUALIFIER FLAGS in HEIS are *; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;




EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

U.S. DOE Richland Office Data Processed by Consultants For Environmental System Technologies (CFEST Inc.) Copyright 2004 Tue Jul 13 13:02:21 2004 WELL PAGE#-1

RADIONUCLIDES

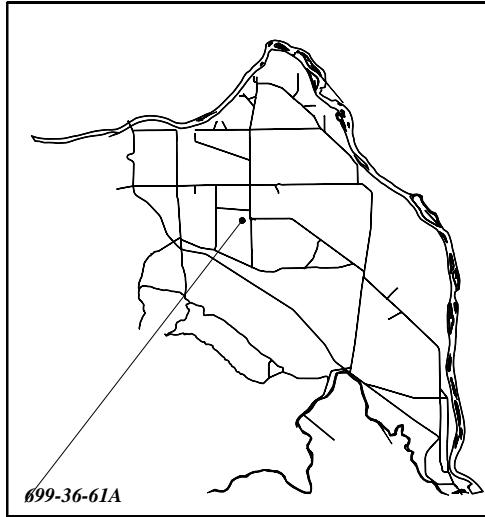
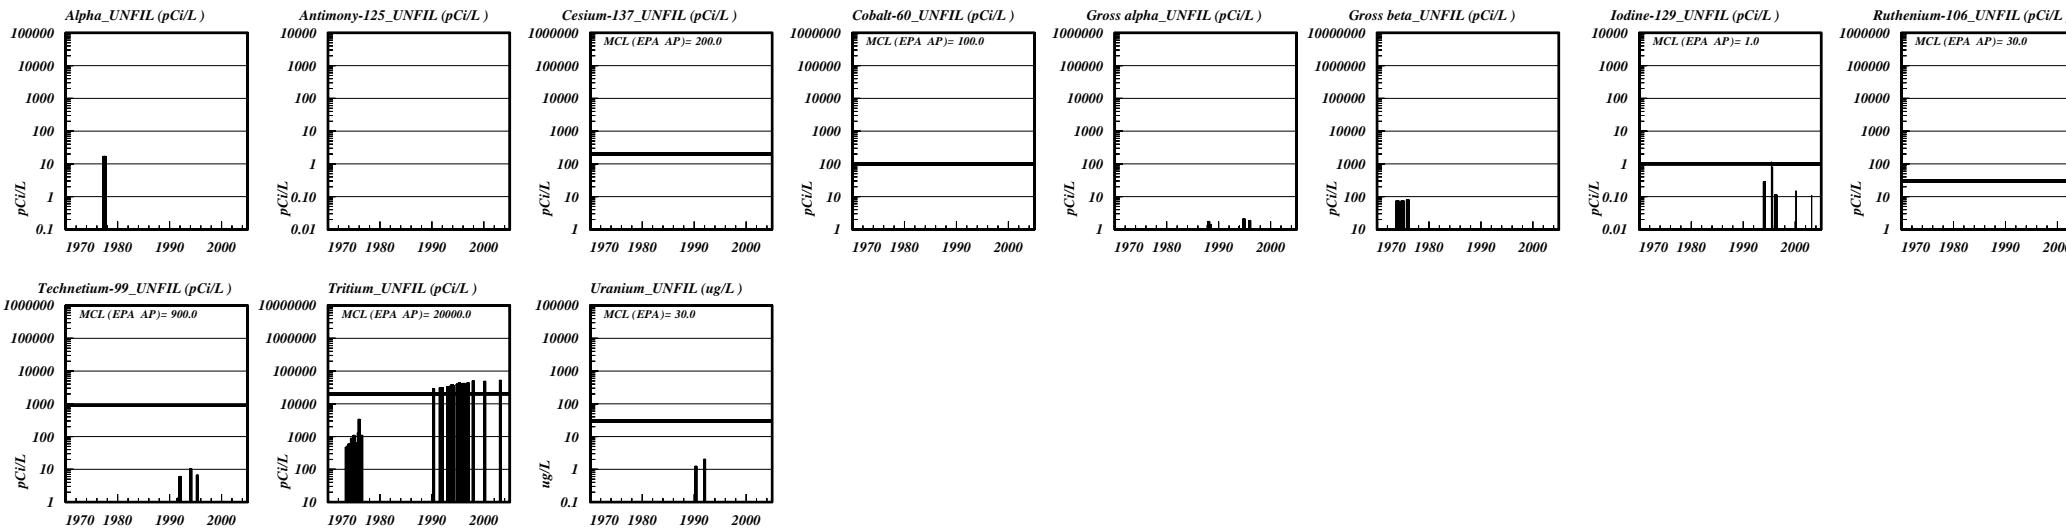


VOLATILE ORGANIC COMPOUNDS

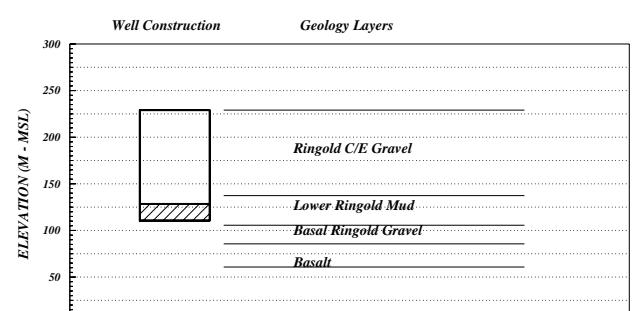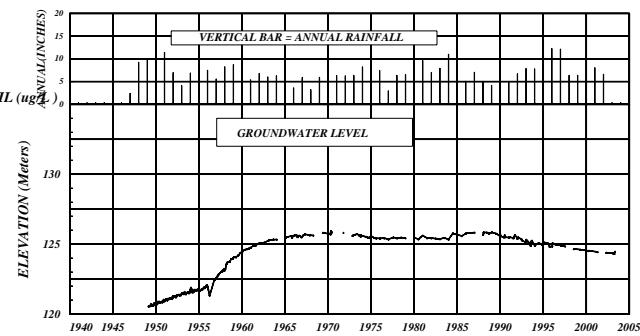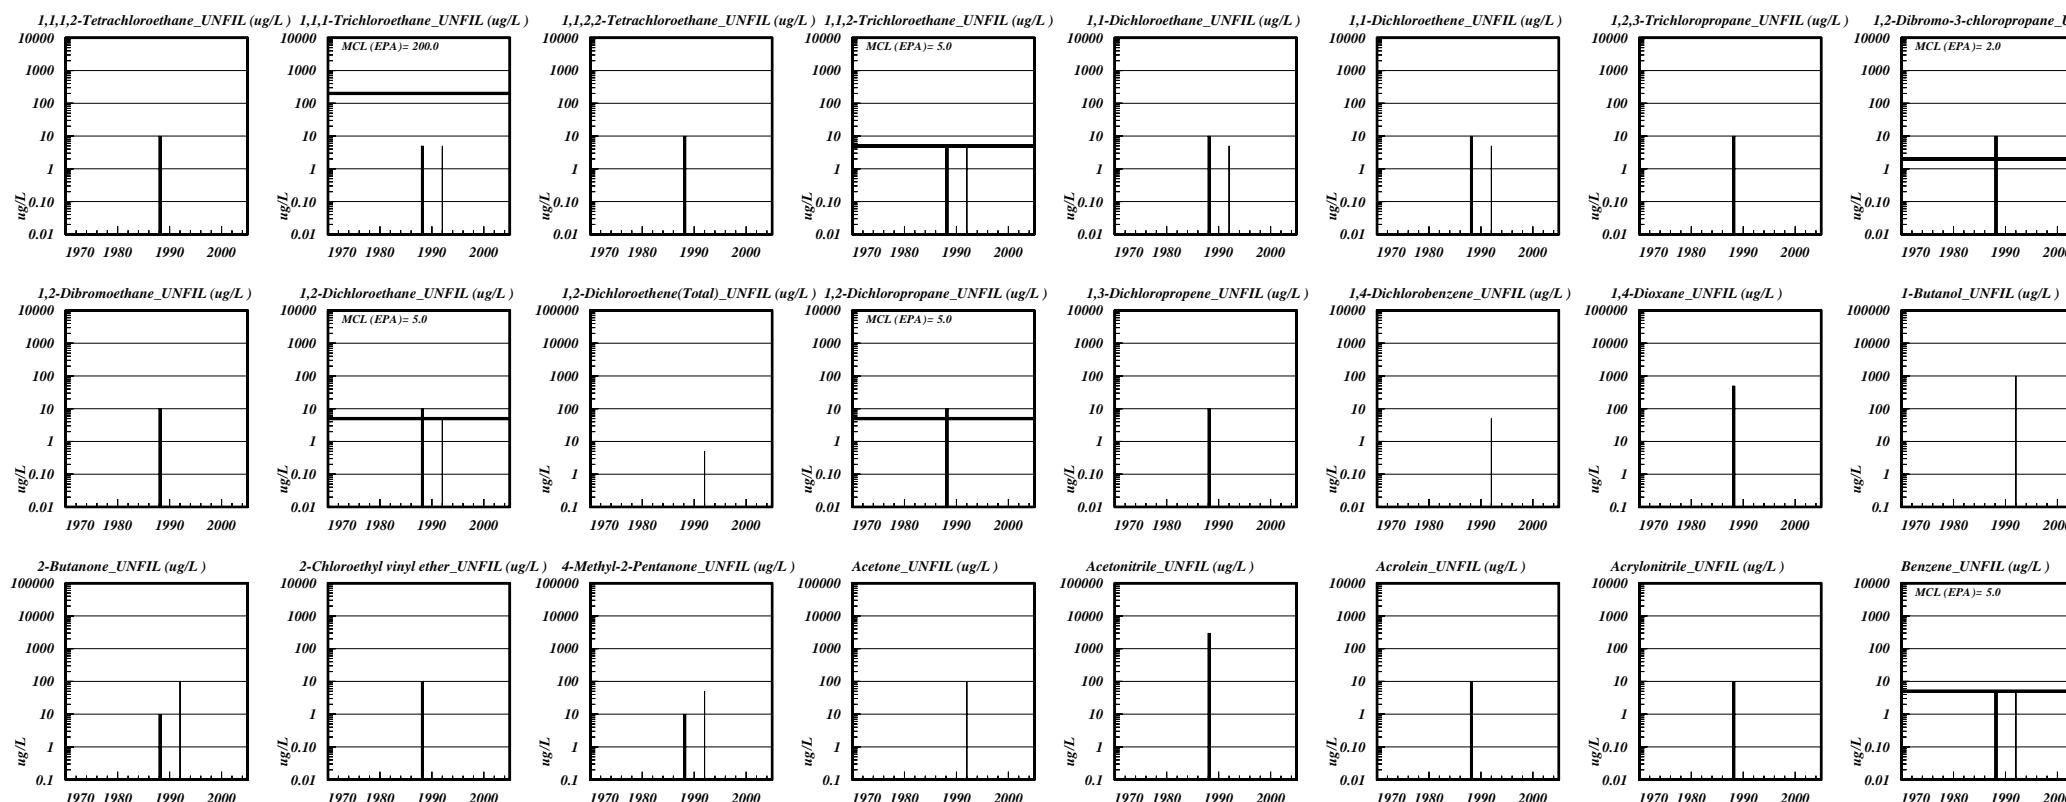

WELLNAME=699-36-61A WELLID=A5144

Well Type=STANDARD Well purpose=GROUNDWATER
Owner=DOE ContactBHI Well Addr: Compliance=NON-COMPLIANT
Well Construction Date=9/19/1994
X_coor= 571395.50 Y_coor= 134557.10 Datum=NAD83(91) Date Survey= 9/30/1994
Elevation= 229.00 m Datum=NAVD88 Date Survey=05/19/94
Ref Point Desc=TOP OF CASING Ref Point side=N Contractor=USACE(JECA)
Total Number of perforation Intervals=1
NPERF#=1 Perf_top= 100.58 Bot= 118.57 m Cas_size= 8.00 in Perf_cuts= 0.00 in
Total Number of Seals=2
Seal#1 Depth_top: 110.64 Bottom: 112.17 m Material: Internal Cement Grout
Seal#2 Depth_top: 112.17 Bottom: 118.87 m Material: Backfill
More Information is at <http://www.envirodataaccess.com/wellfiles/699-36-61A.htm>

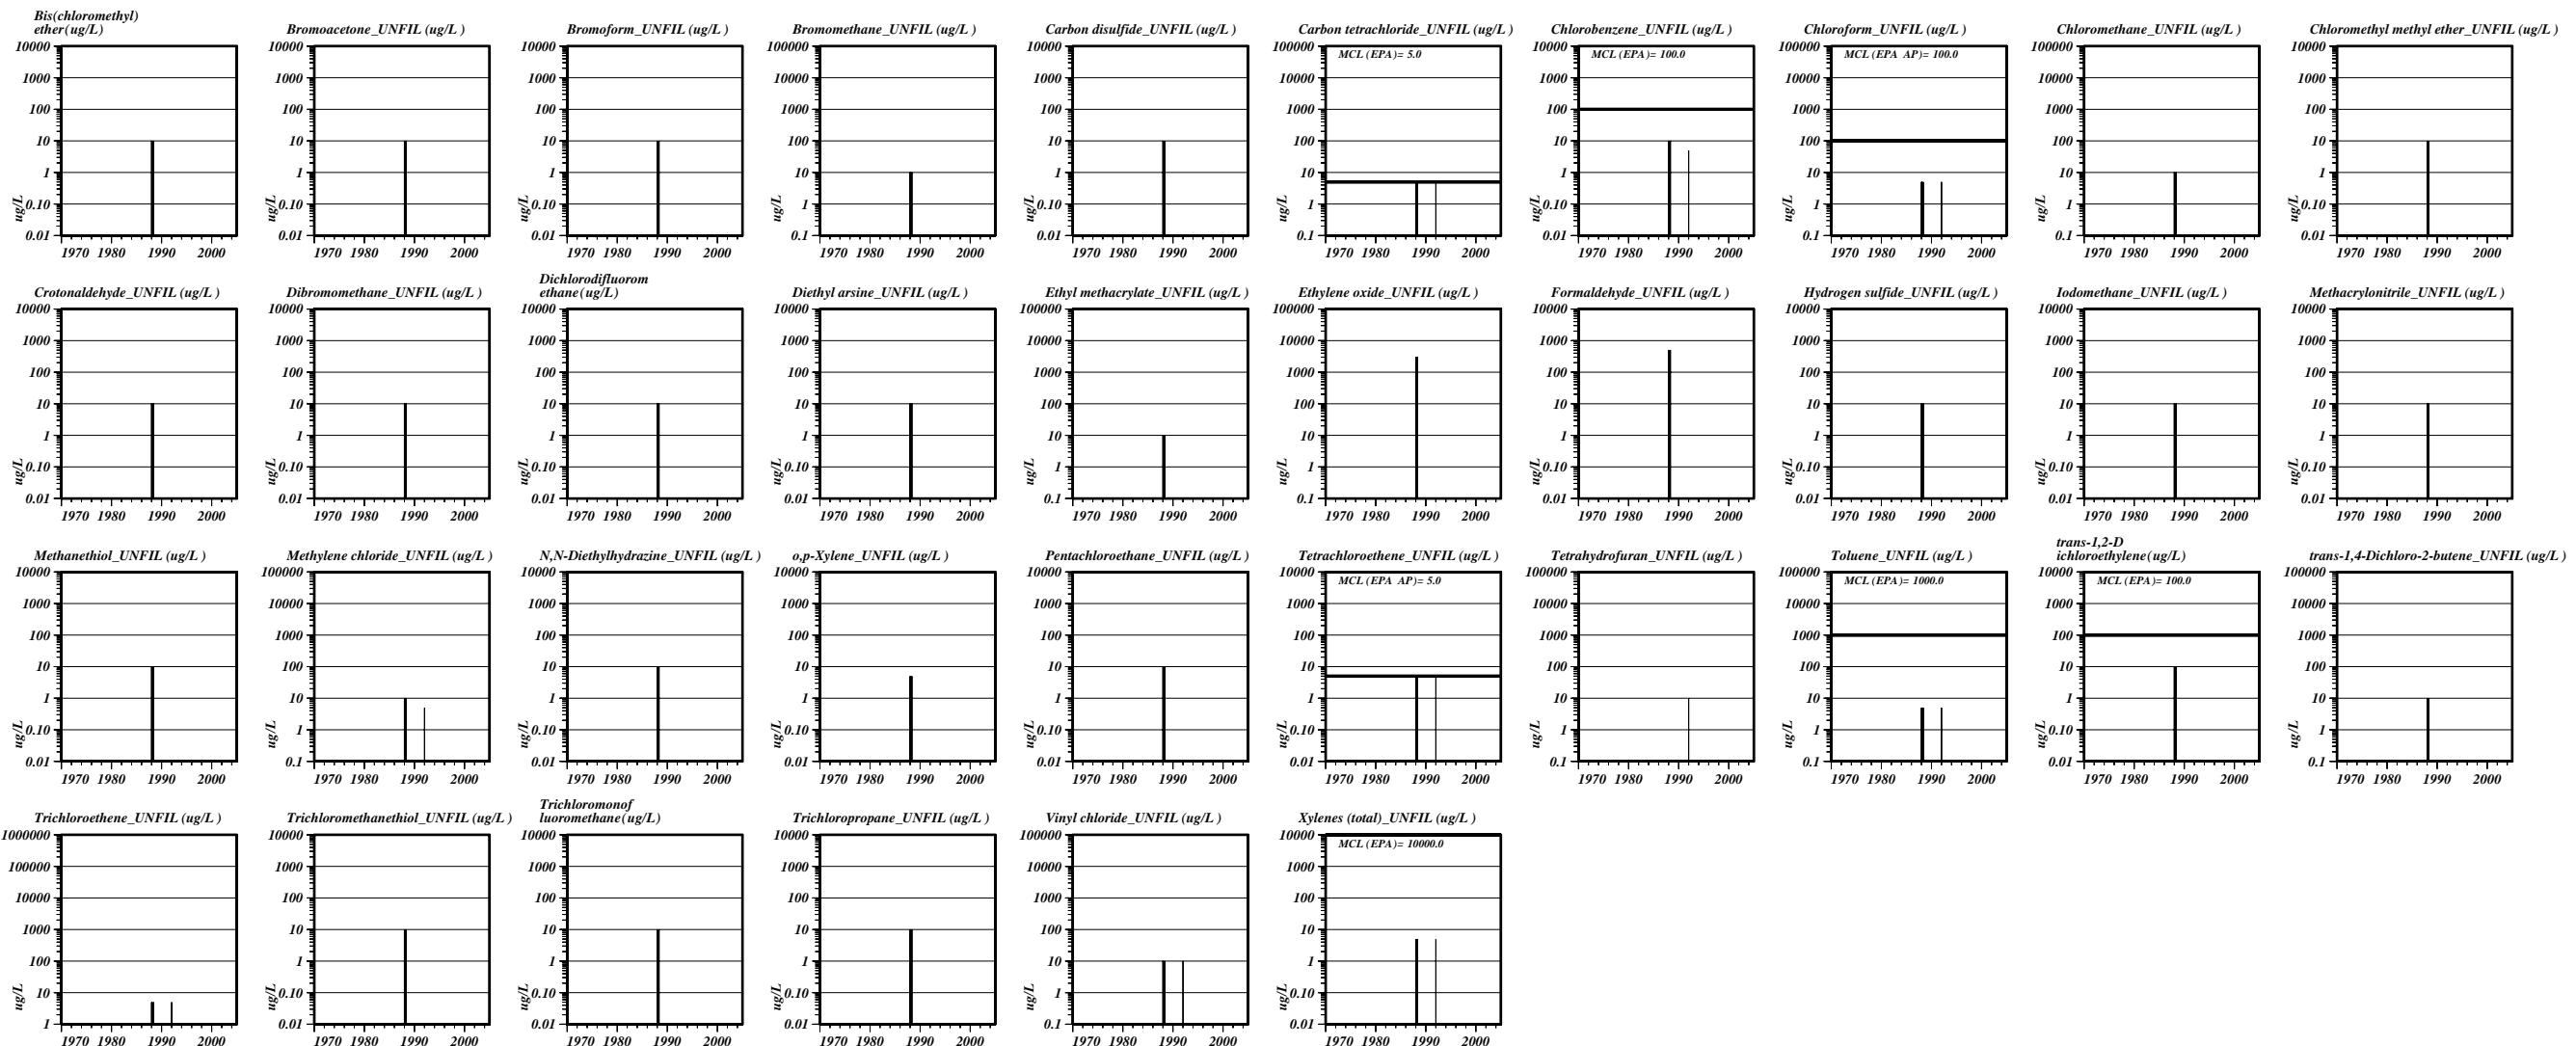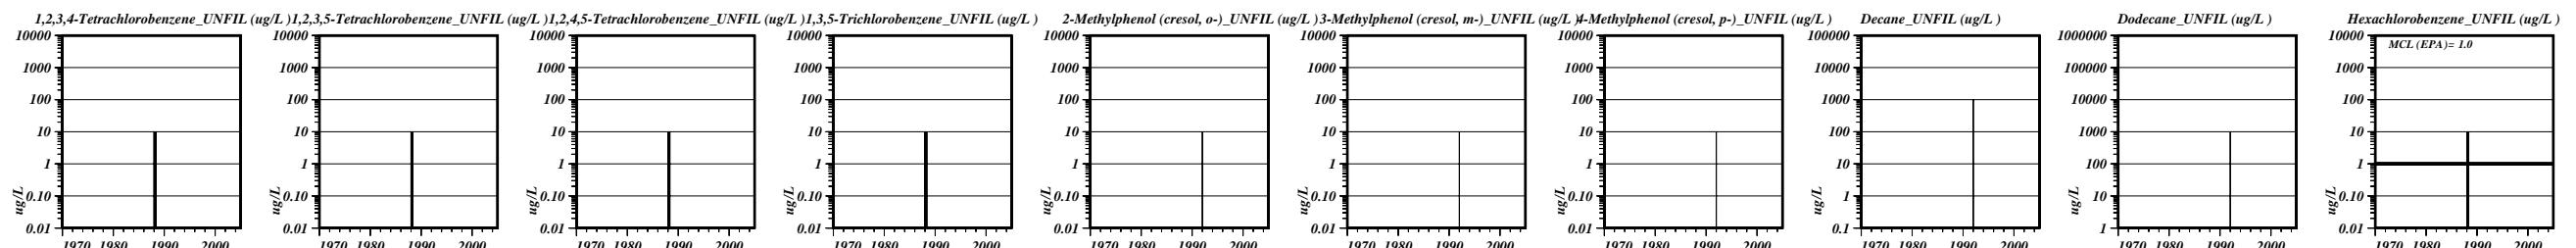VOLATILE ORGANIC COMPOUNDS**SEMI-VOLATILE ORGANIC COMPOUNDS**


LABORATORY QUALIFIER FLAGS in HEIS are *; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-36-61A

SEMI-VOLATILE ORGANIC COMPOUNDS

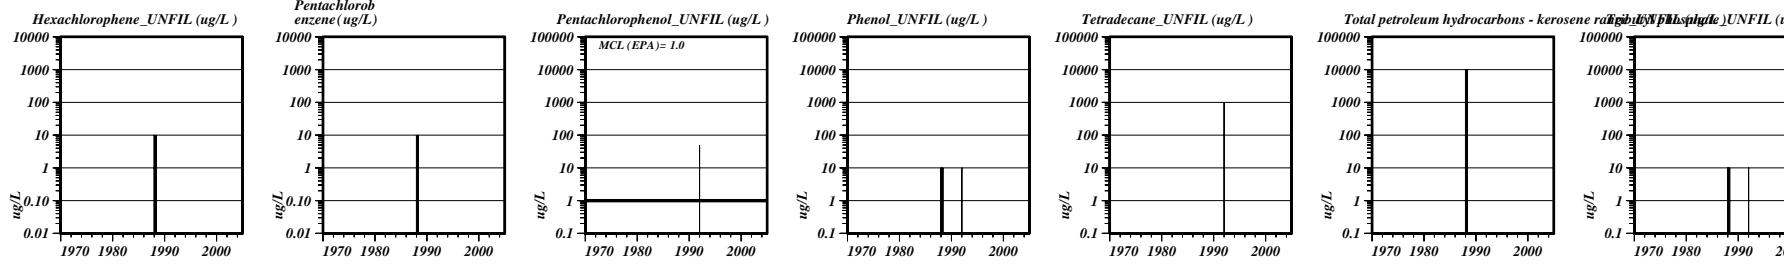

METALS & PHYSICAL PARAMETERS

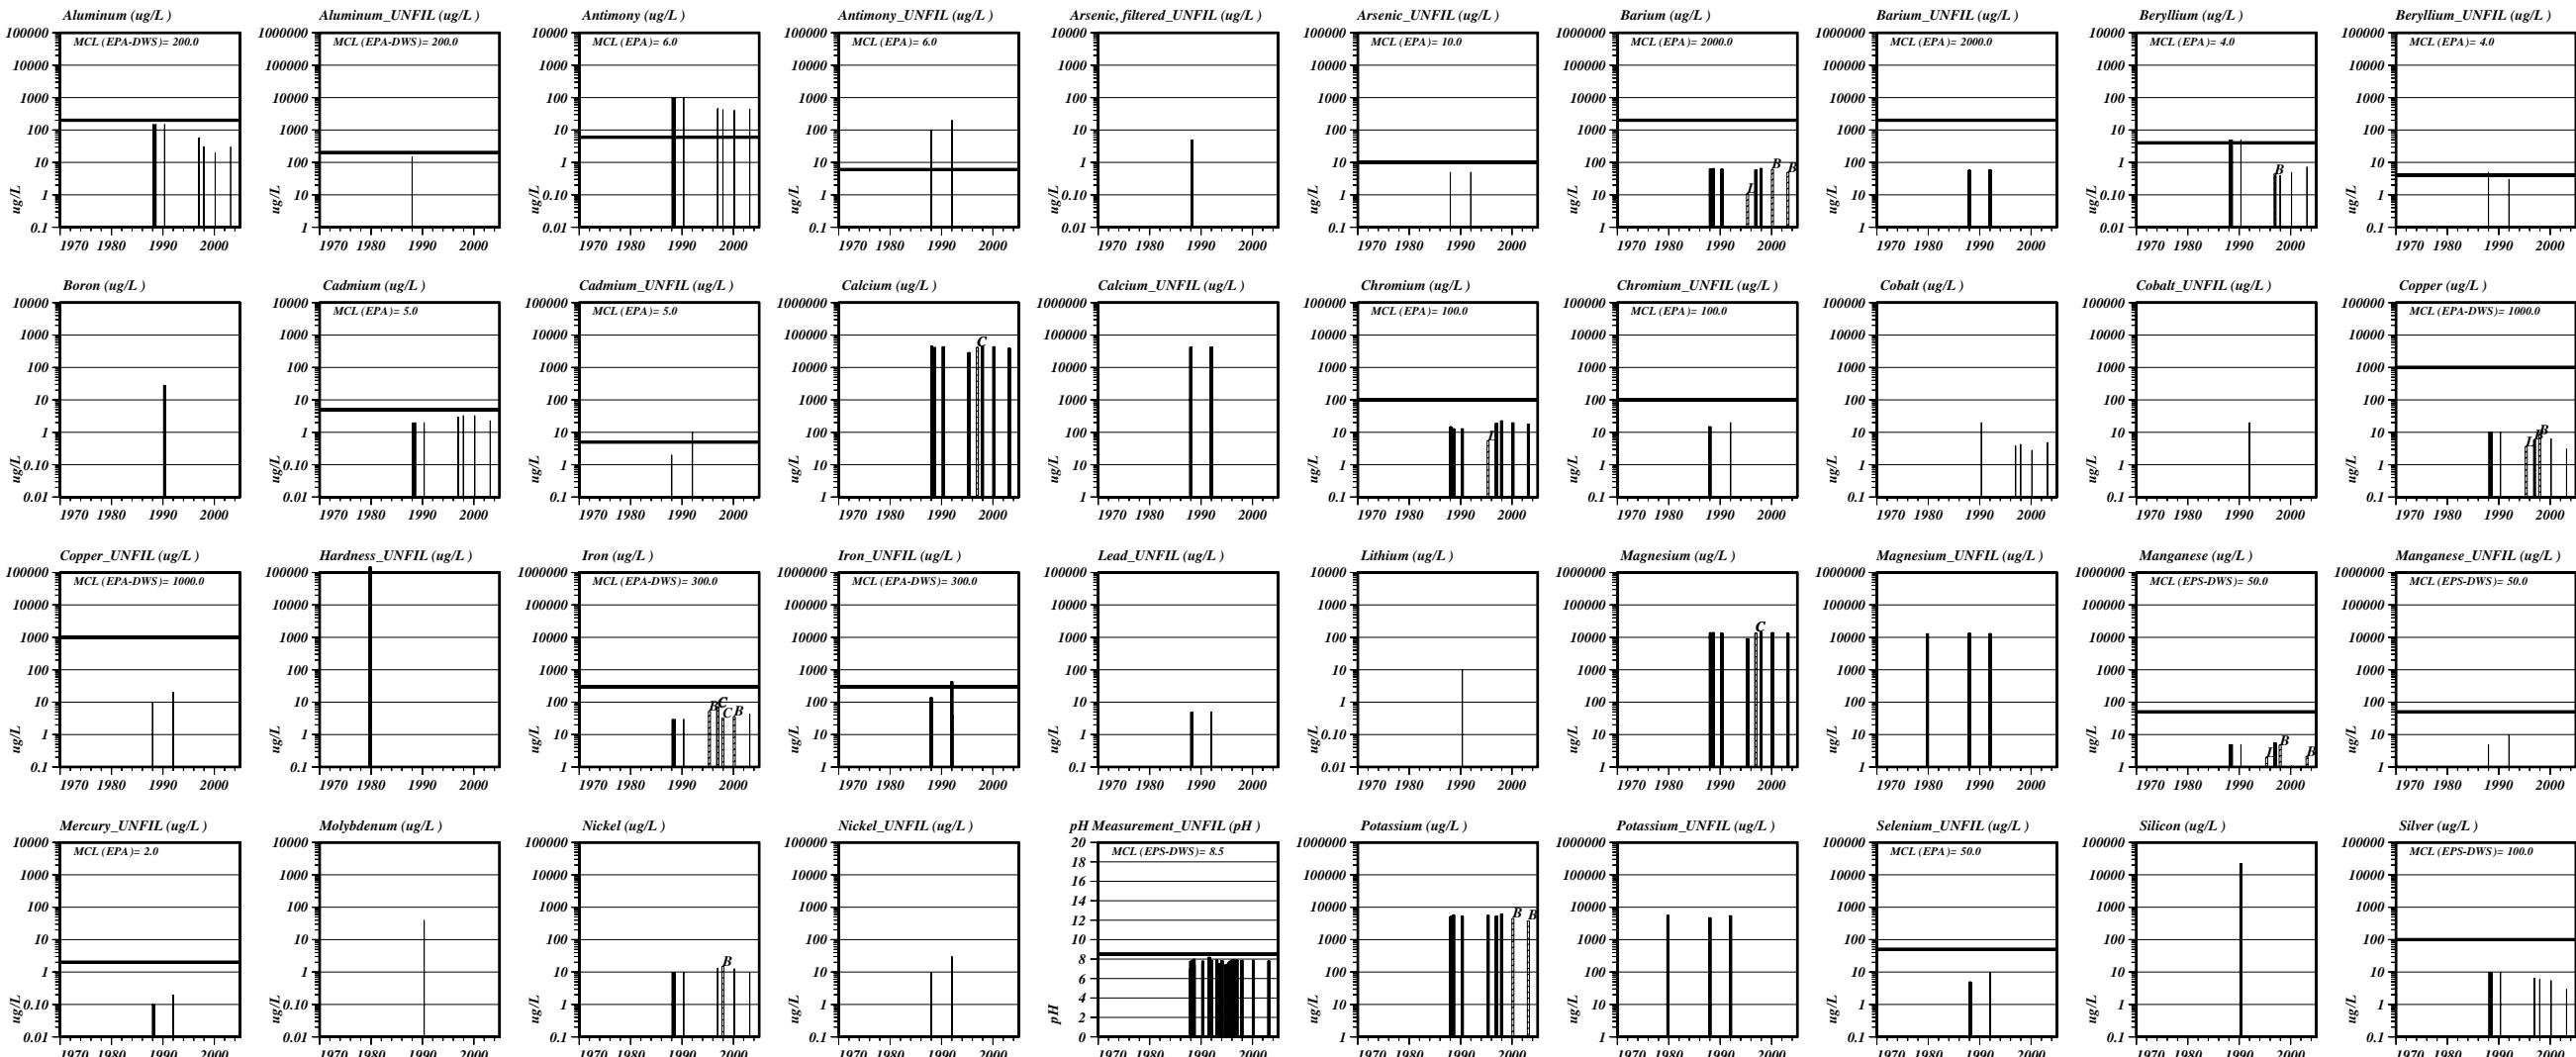


LABORATORY QUALIFIER FLAGS in HEIS are *; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-36-61A


METALS & PHYSICAL PARAMETERS

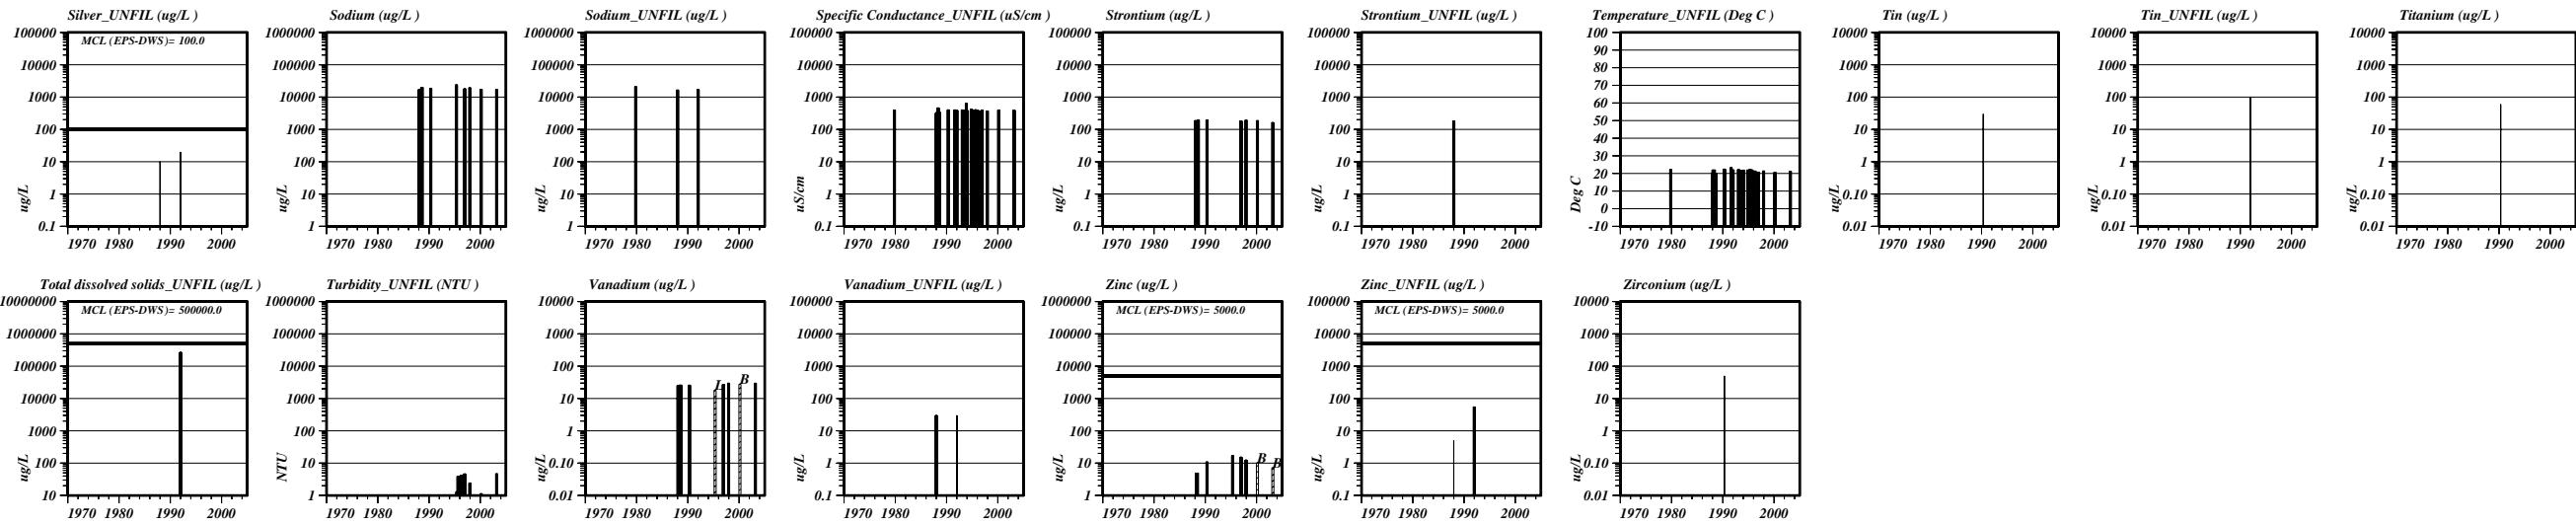

PEST/PCB, HERB, & DIOXINS

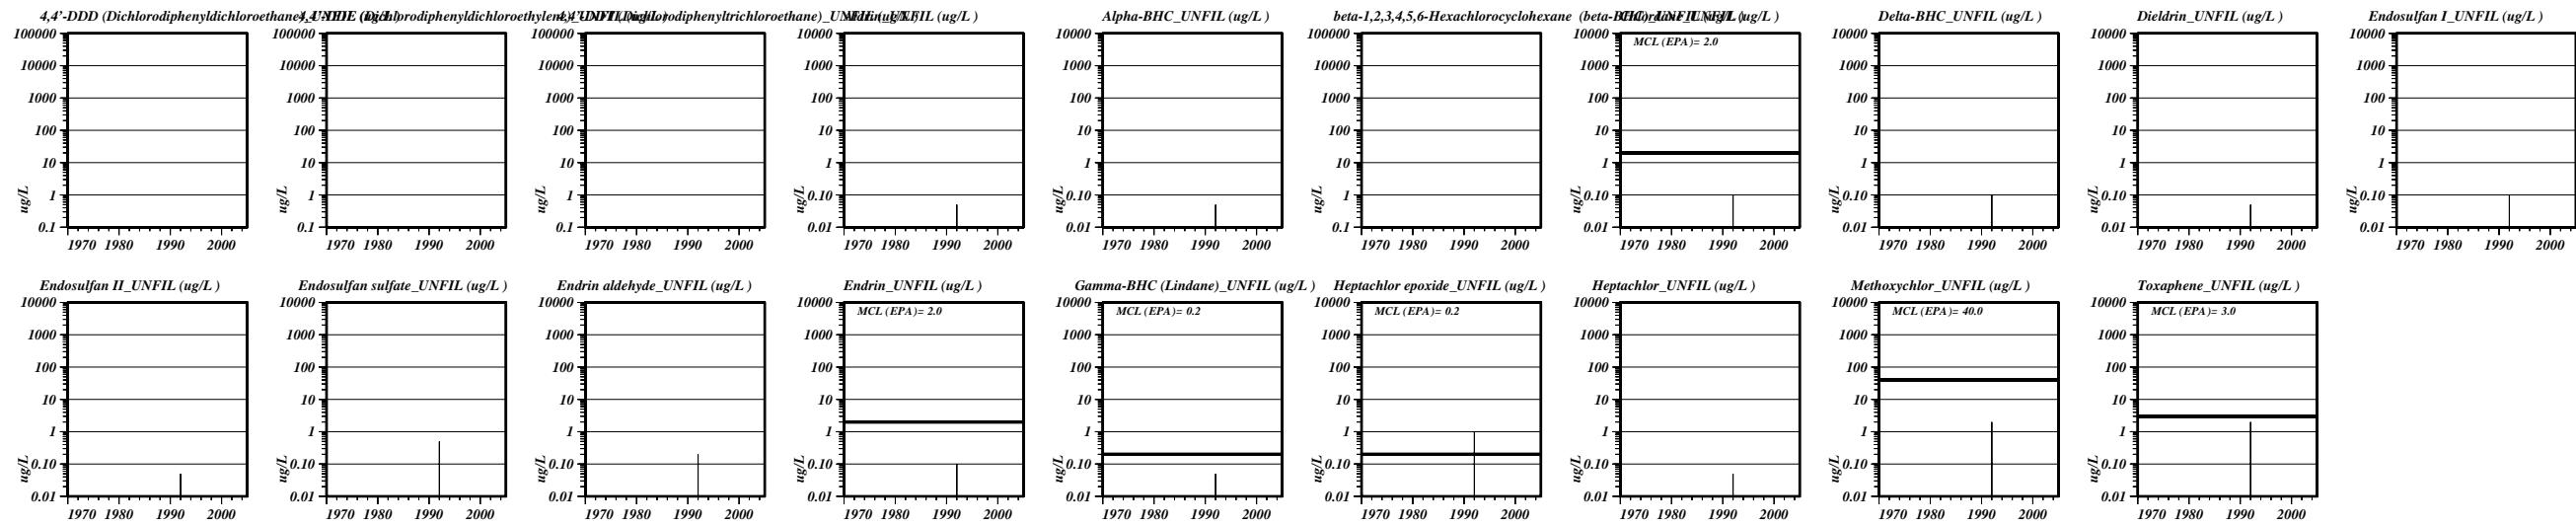


GENCHEM & ORGANICS & GENORGANICS

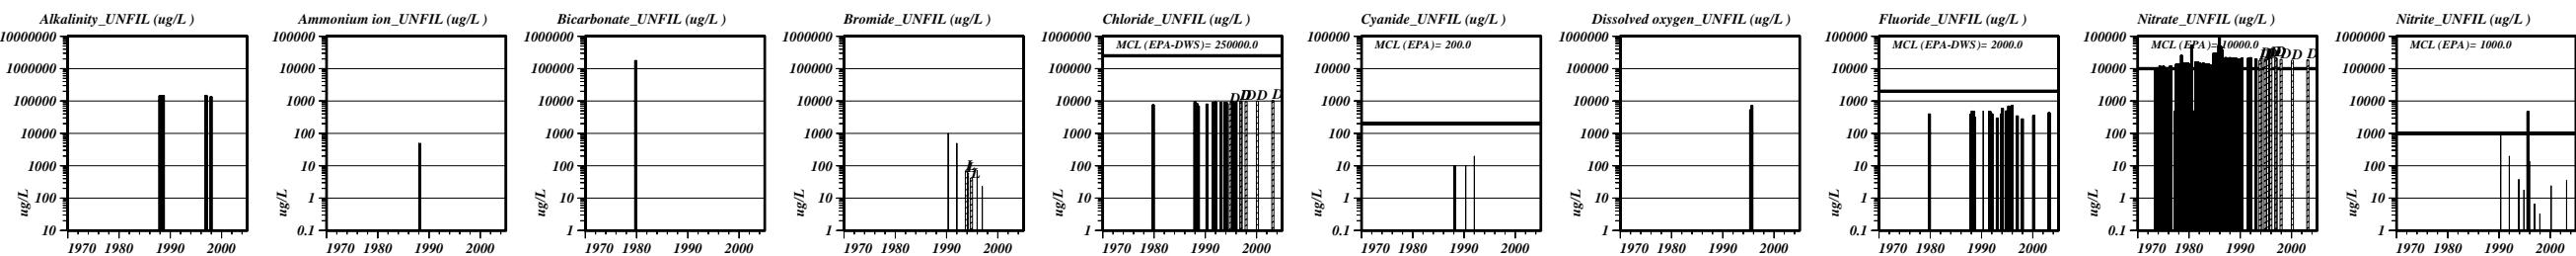

LABORATORY QUALIFIER FLAGS in HEIS are *; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

GENCHEM & ORGANICS & GENORGANICS

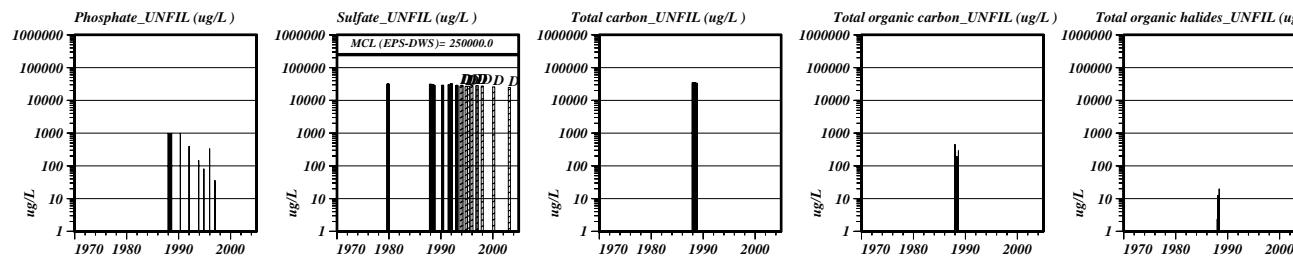

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag