
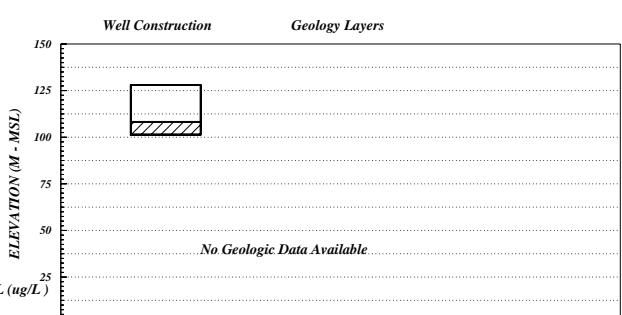
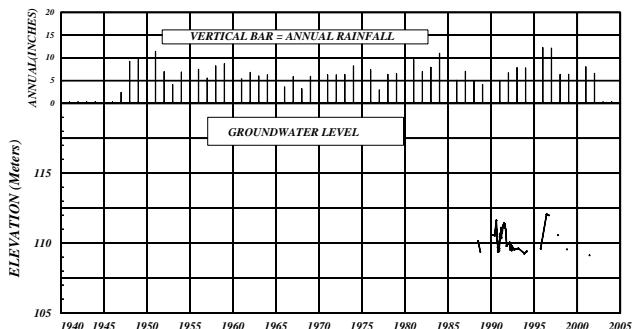
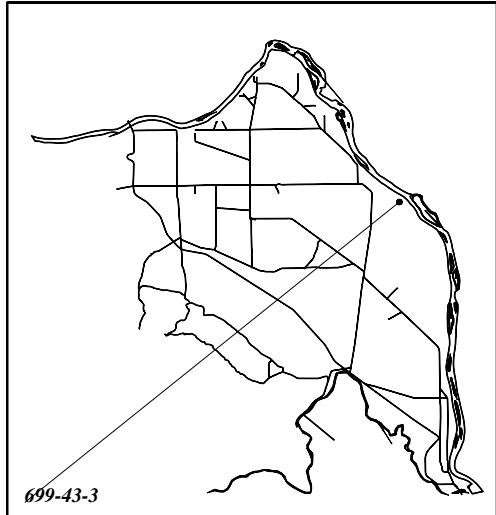


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-43-3

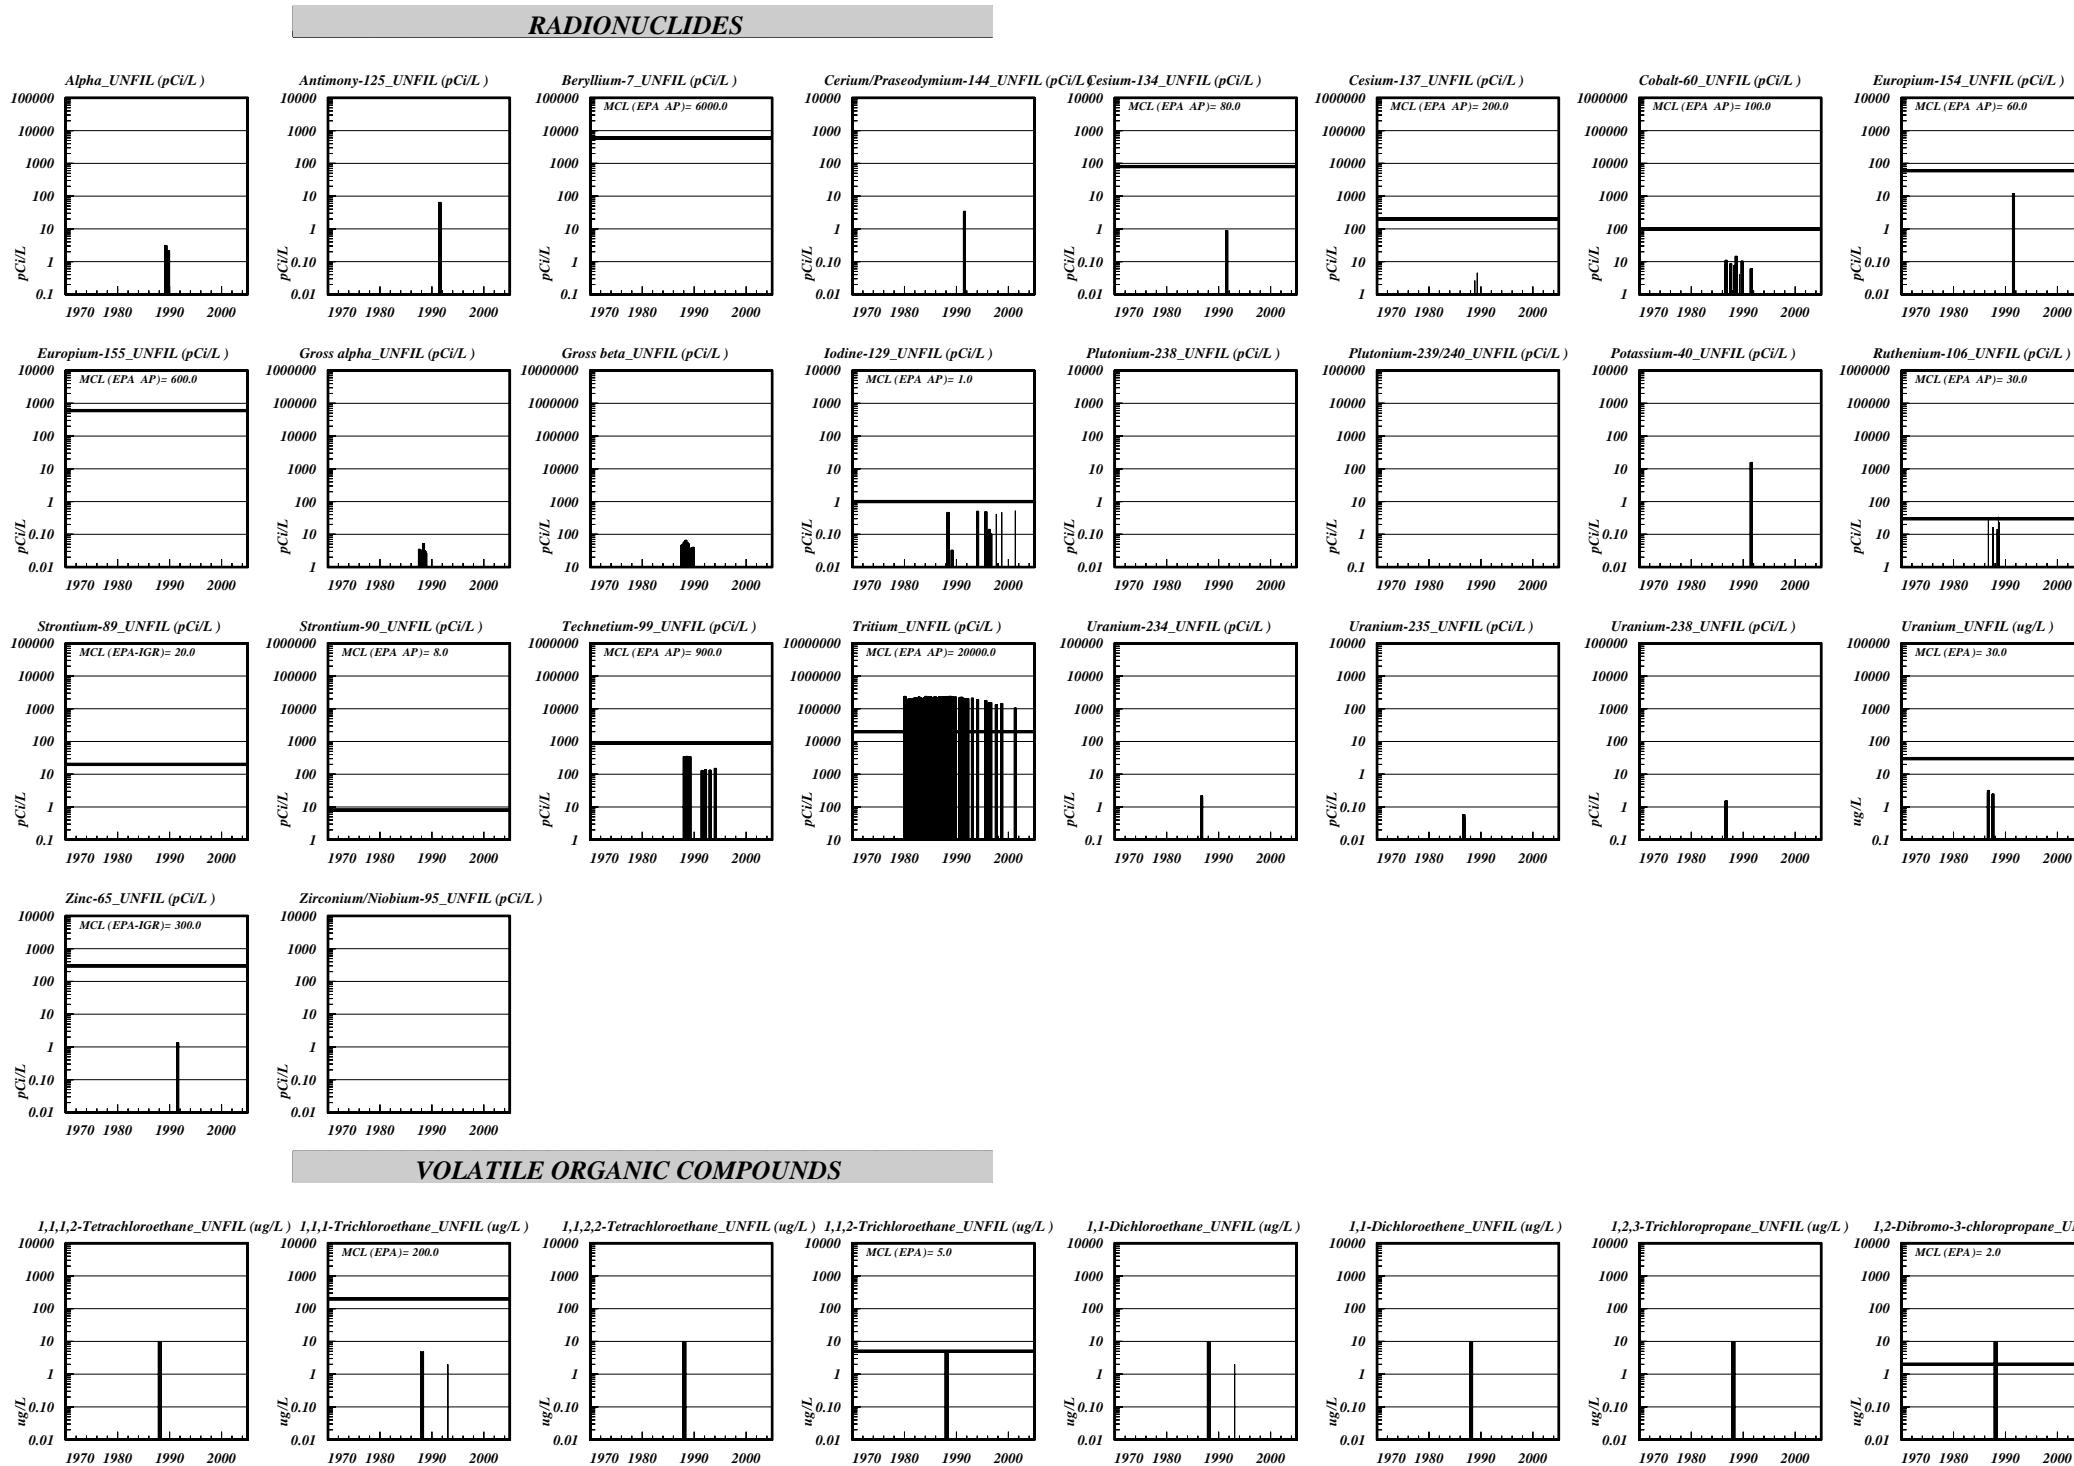


WELLNAME=699-43-3 WELLID=A8677

Well Type=STANDARD Well purpose=GROUNDWATER
 Owner=DOE Contact=BHI Well Adm Compliance=NON-COMPLIANT
 X_coor= 589054.80 Y_coor= 136710.60 Datum=NAD83(91) Date Survey= 9/30/1994
 Elevation= 128.005 Datum=NAVD88 Date Survey=05/24/94
 Ref_Point_Desc=TOP OF CASING Ref_Point_side=N Contractor=USACE(JECA)
 Well Comment= STATUS=IN-USE
 Total Number of perforation Intervals=1
 NPERF#=1 Perf_top= 19.81 Bot= 26.67 mCas_size= 6.00in Perf_cuts= 0.00

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
 EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;



EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

VOLATILE ORGANIC COMPOUNDS

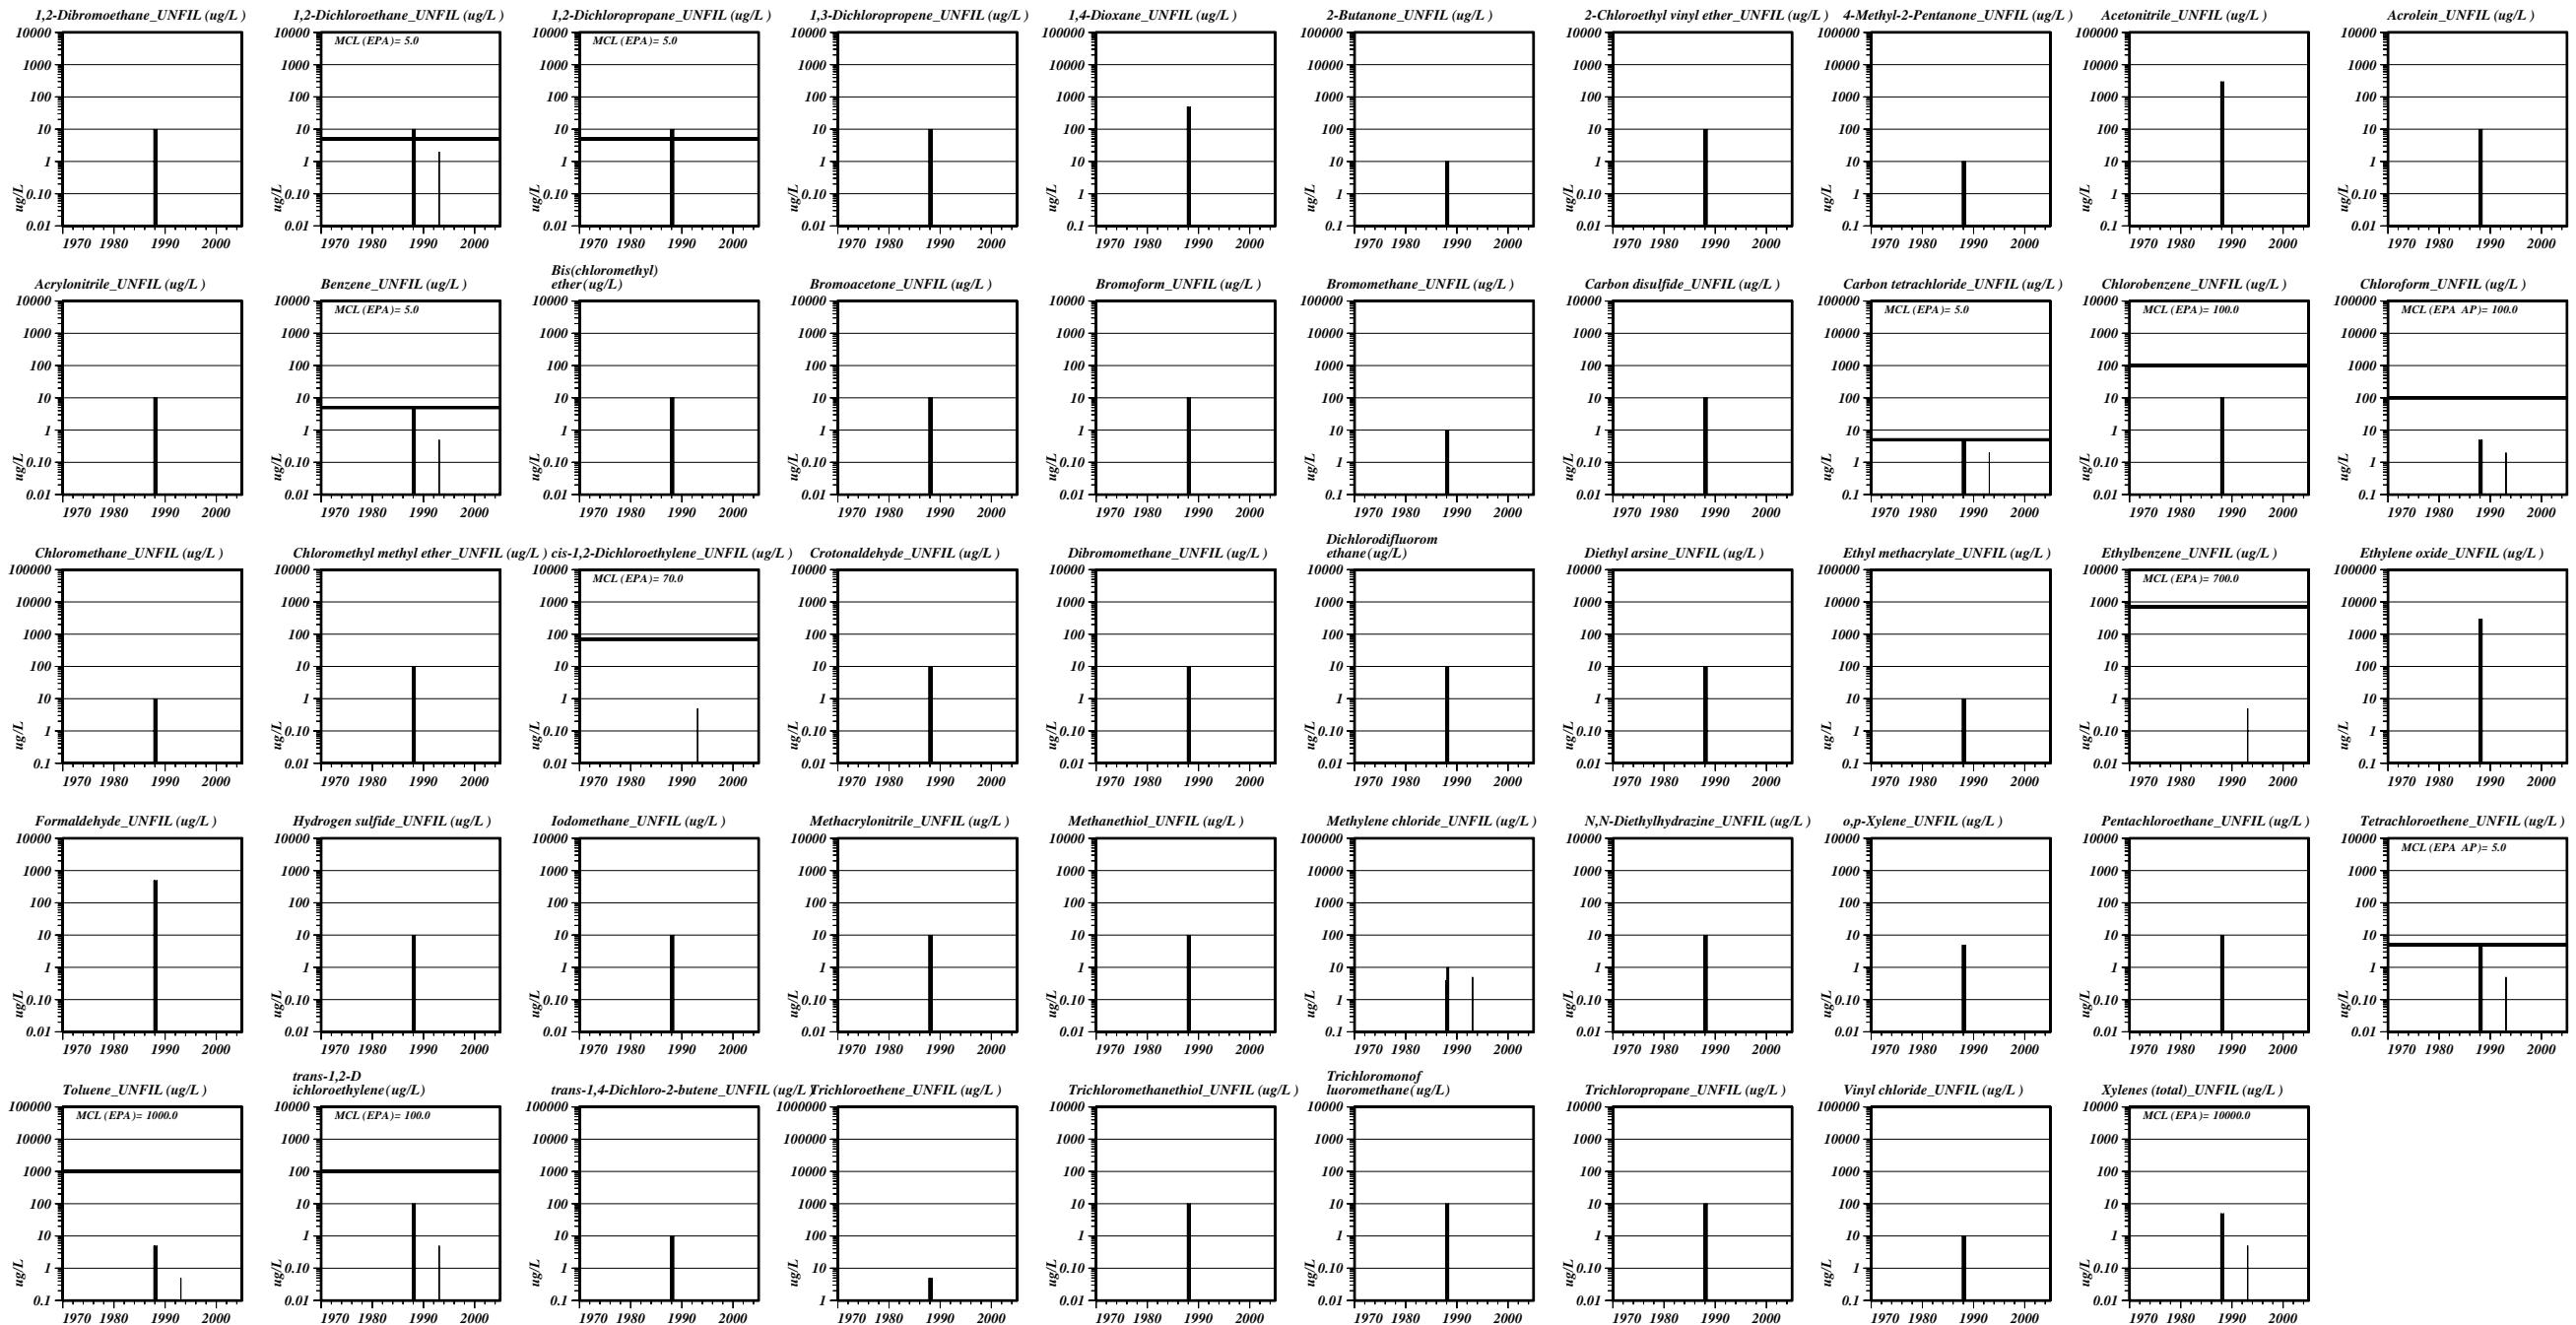

LABORATORY QUALIFIER FLAGS in HEIS are *; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag












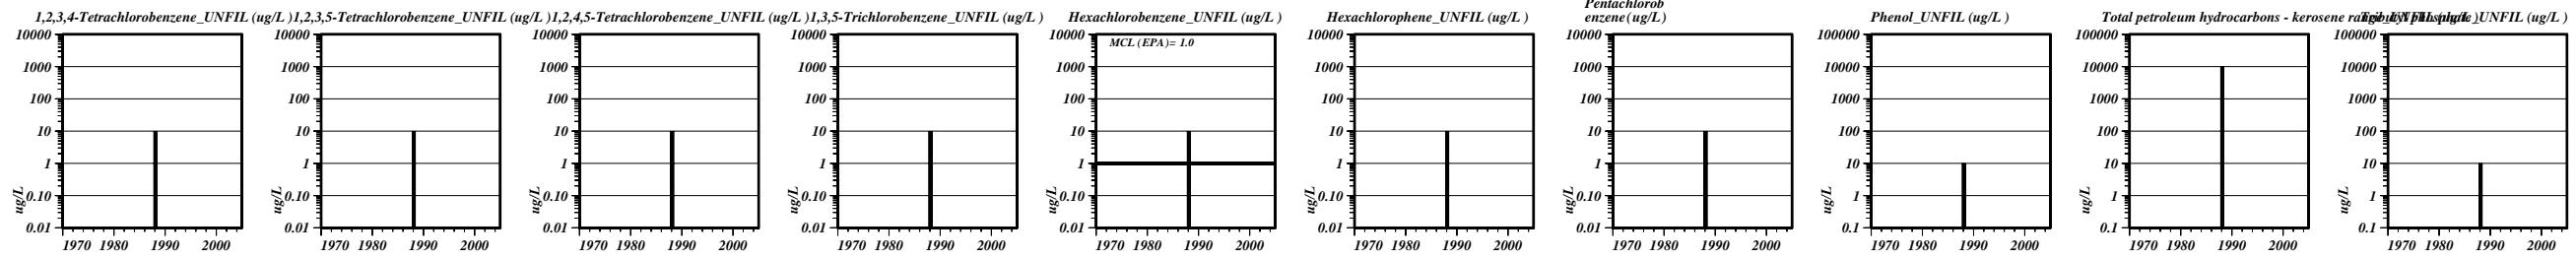
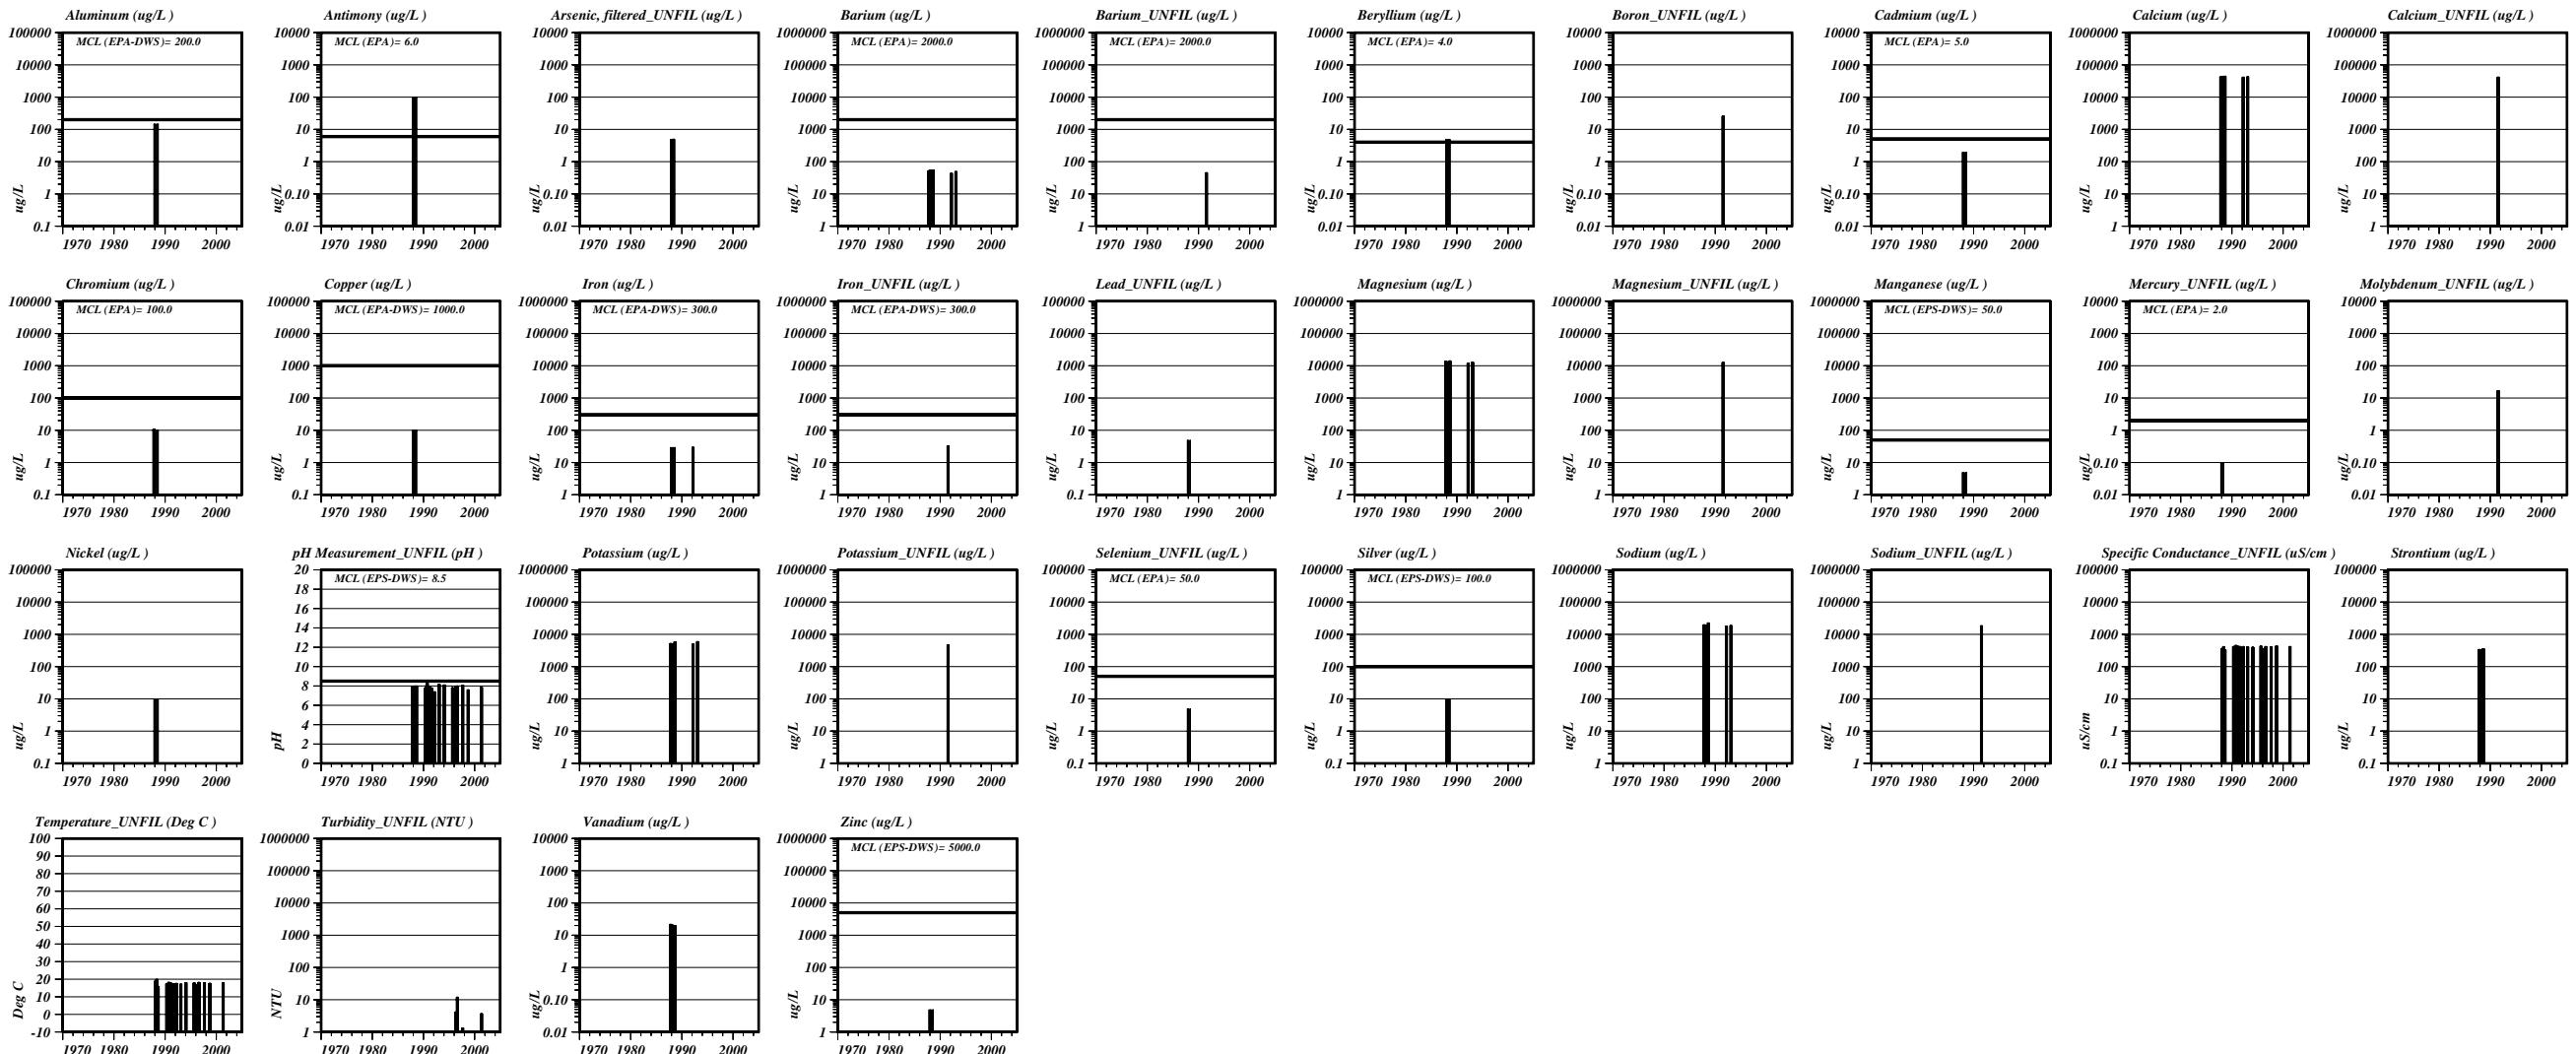
SEMI-VOLATILE ORGANIC COMPOUNDS**METALS & PHYSICAL PARAMETERS**

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

PEST/PCB, HERB, & DIOXINS NO DATA AVAILABLE

GENCHEM & ORGANICS & GENORGANICS

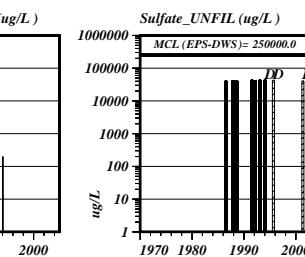

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag