
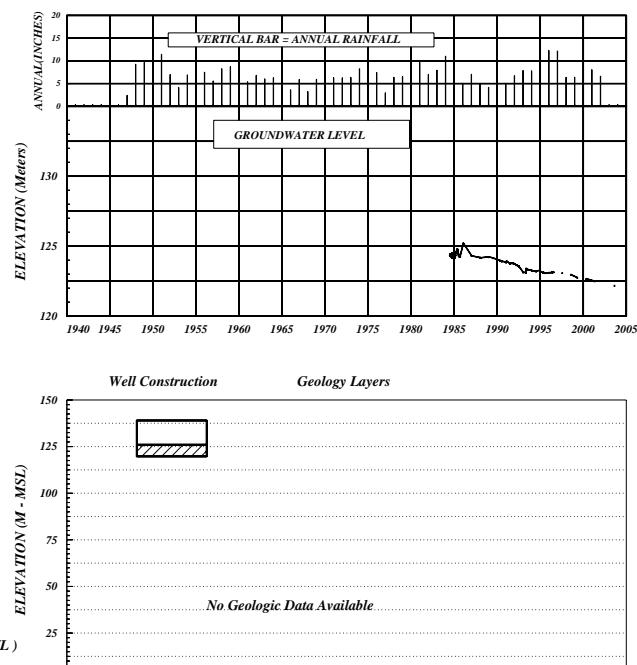
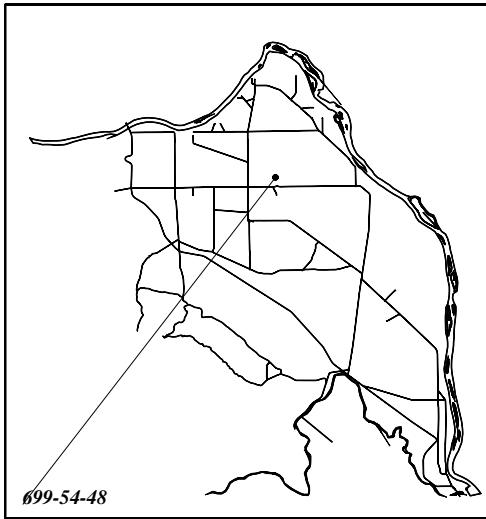


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS



wellseries-600-699 WELL#=699-54-48

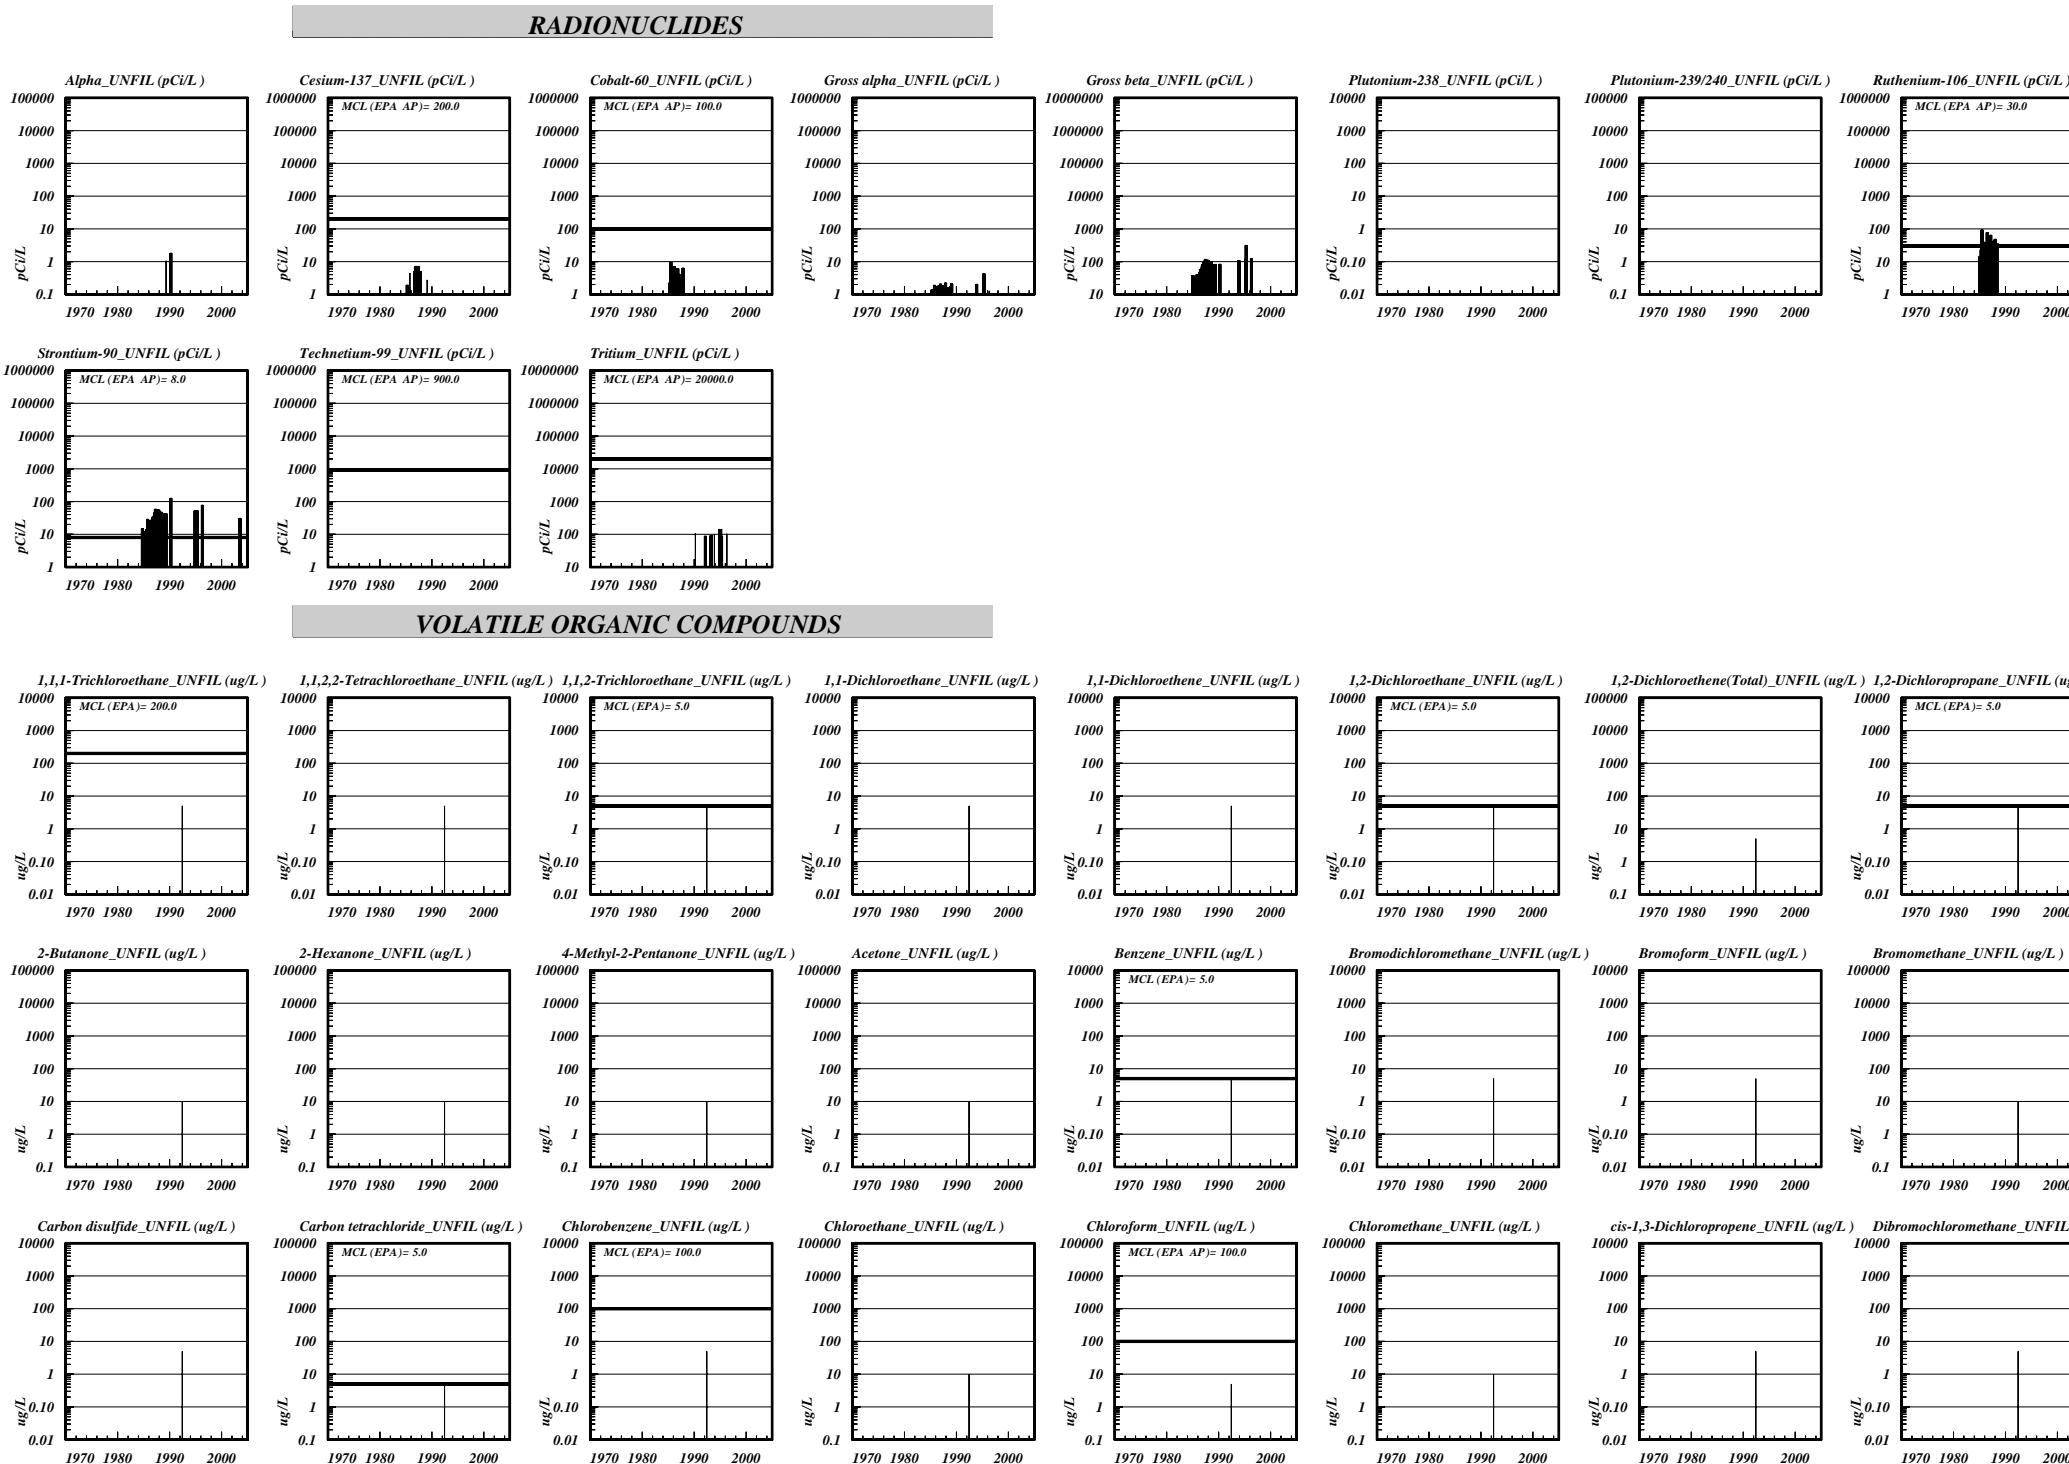

WELLNAME=699-54-48 WELLID=A5252
Well Type=STANDARD Well purpose=GROUNDWATER
Owner=DOE Contact=BHI Well Adm Compliance=NON-COMPLIANT
X_coor=575357.80 Y_coor=139821.20 Datum=NAD83(91) Date Survey= 6/1/1994
Elevation= 139.001 Datum=NGVD29 Date Survey=06/01/94
Ref_Point_Desc=BRASS CAP Ref_Point_side=NONE Contractor=USACE(JECA)
Total Number of Screen Intervals=1
Screen#1 Screen_diam= 6.00 in Top= 12.95 Bottom= 19.20 m Slot_size= 0.03 in
Screen_material=Stainless Steel
Total Number of Seals=4
Seal#1 Depth_top= 0.00 Bottom= 5.79 m Material=Cement Grout
Seal#2 Depth_top= 21.34 Bottom= 22.86 m Material=Internal Backfill
Seal#3 Depth_top= 22.86 Bottom= 28.04 m Material=Backfill
Seal#4 Depth_top= 28.04 Bottom= 30.78 m Material=Internal Cement Grout
Seal_comment =GROUTED OP
More Information is at <a href="http://www.envirodataaccess.com/wellfiles/699-54-48.htm">http://www.envirodataaccess.com/wellfiles/699-54-48.htm</a>

LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

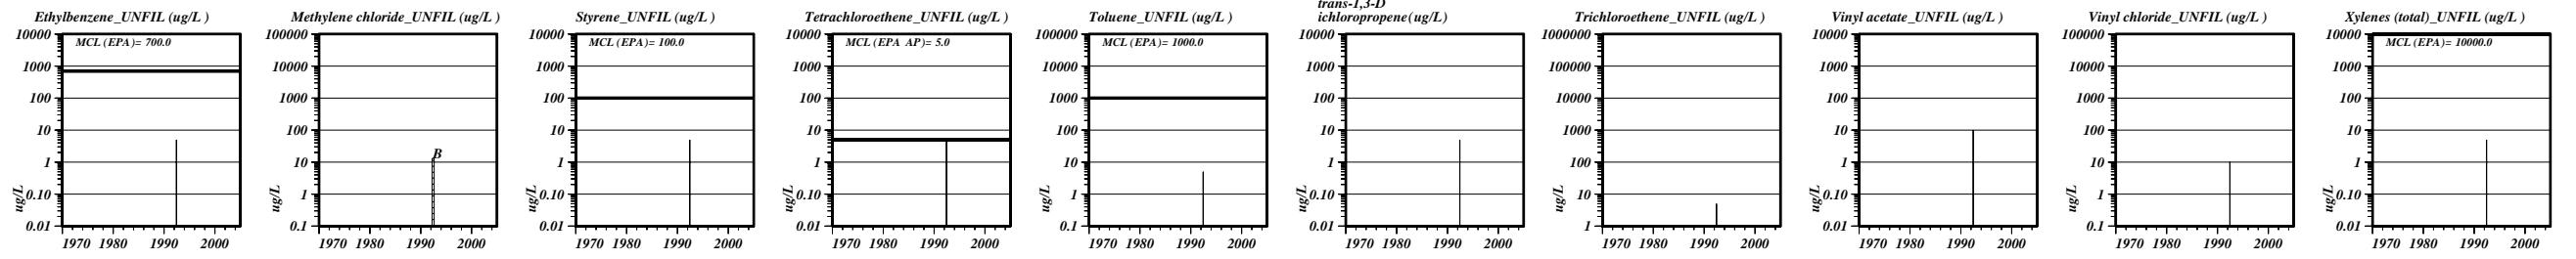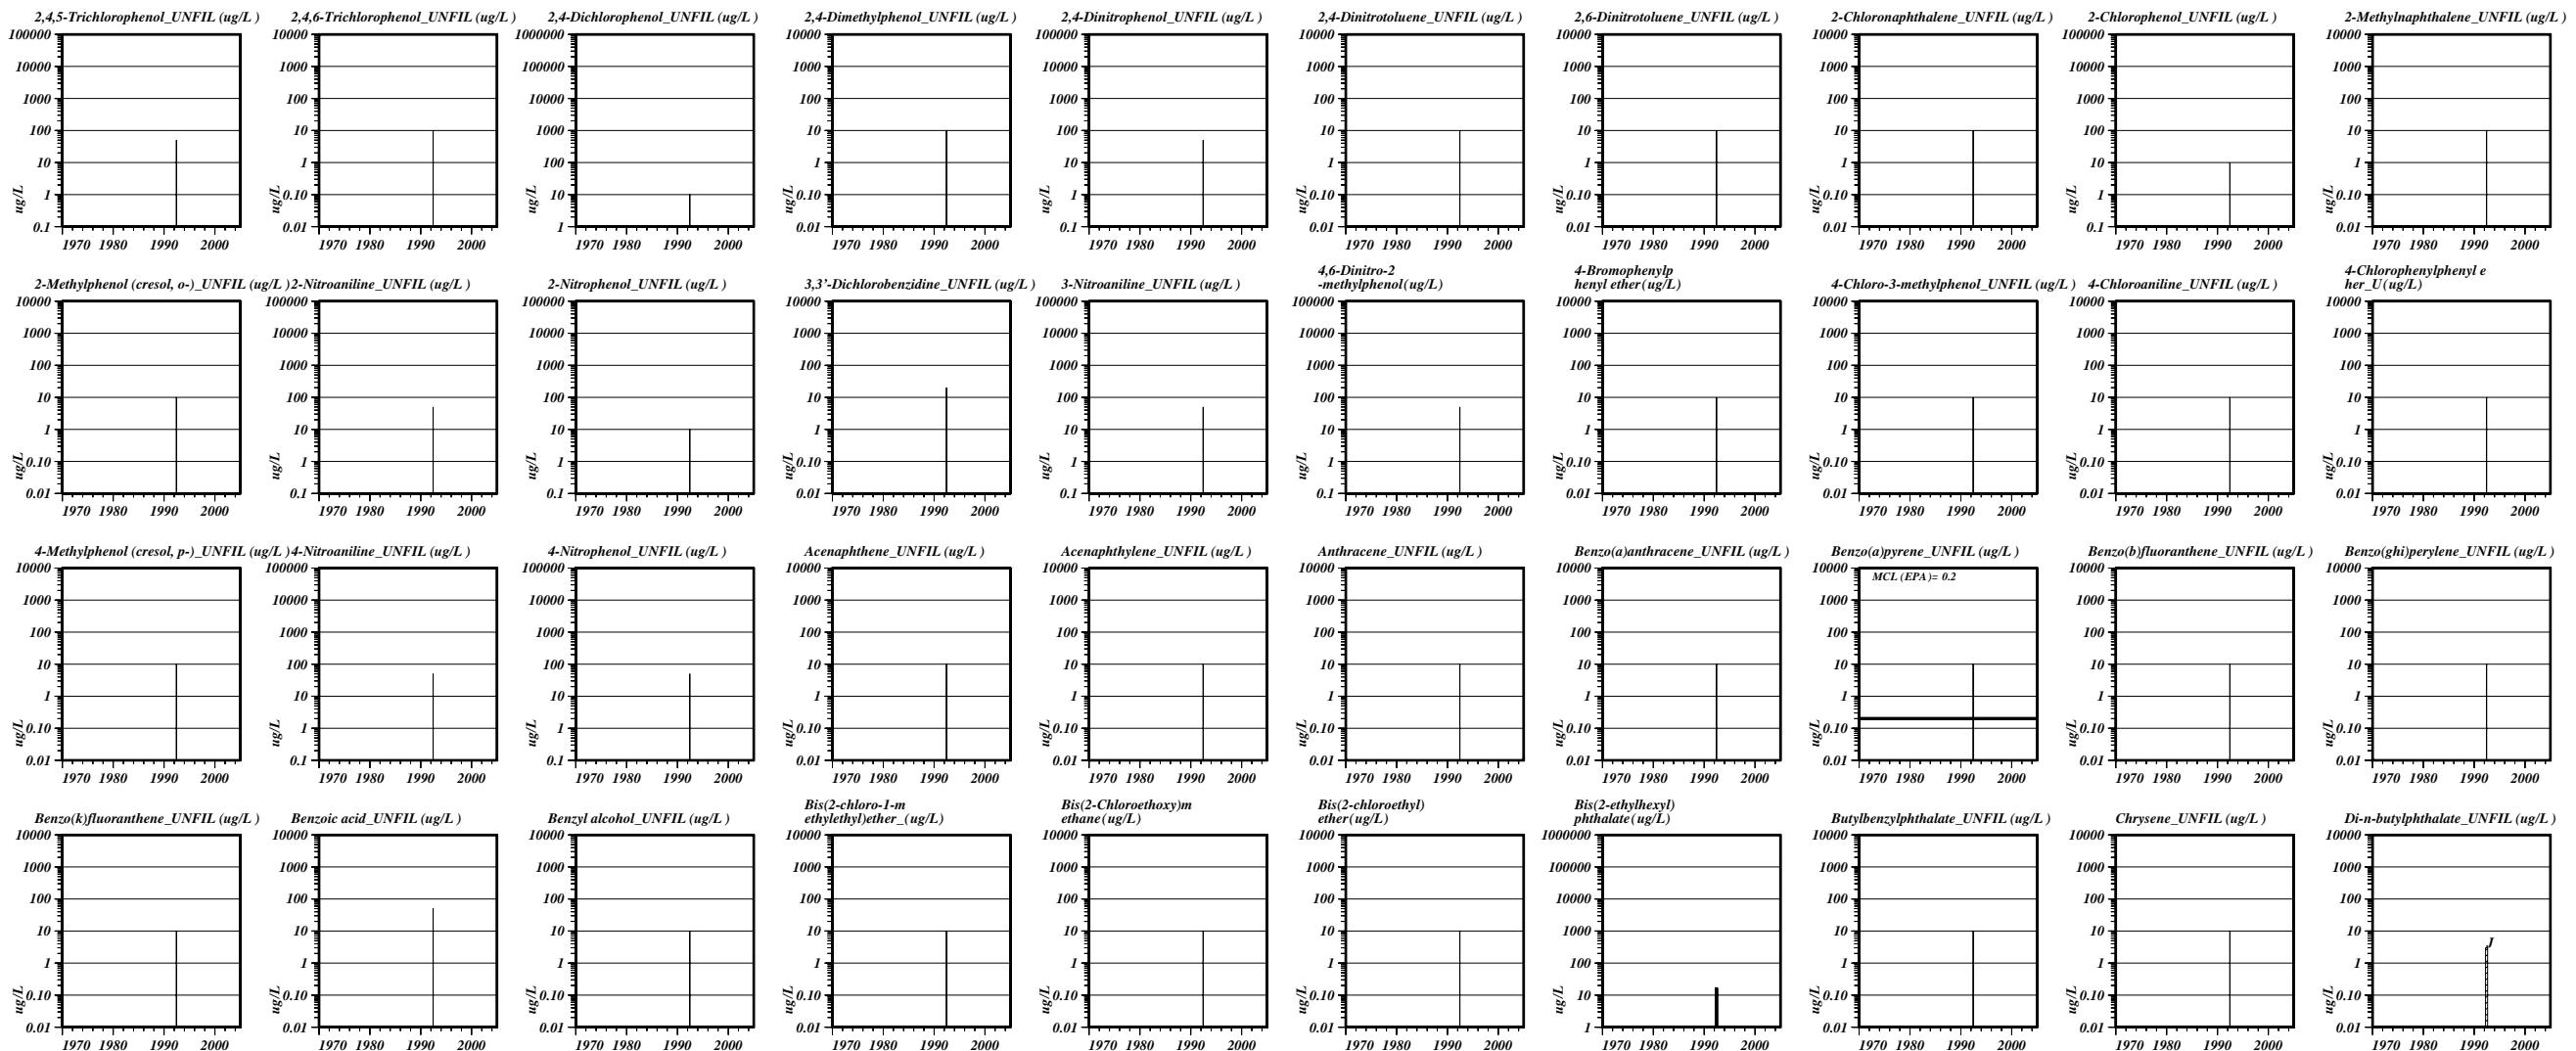
**VOLATILE ORGANIC COMPOUNDS****SEMI-VOLATILE ORGANIC COMPOUNDS**

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-54-48

## SEMI-VOLATILE ORGANIC COMPOUNDS

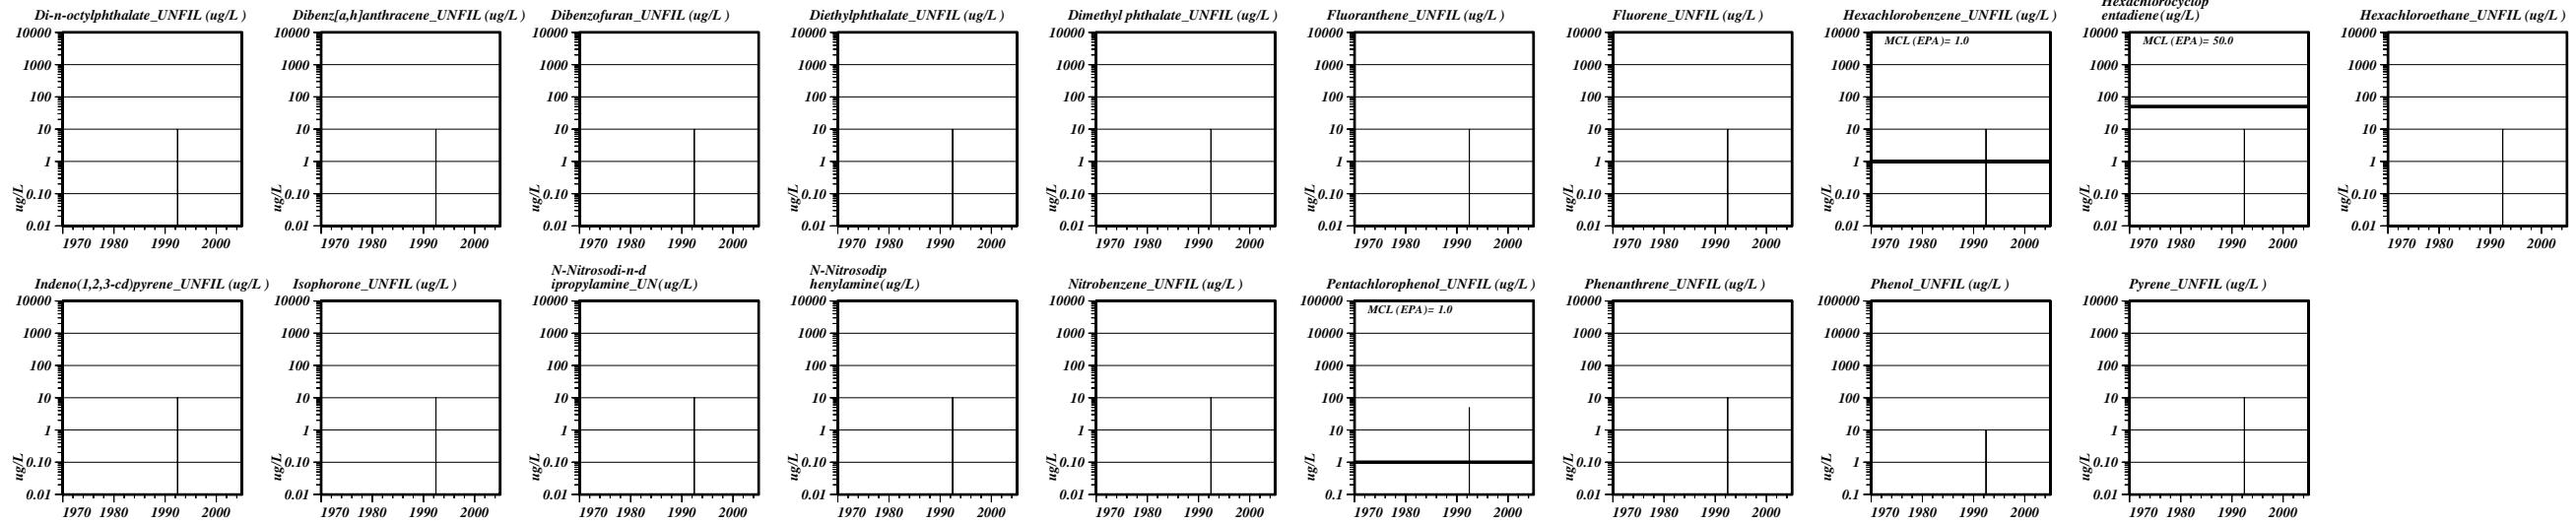

## METALS & PHYSICAL PARAMETERS

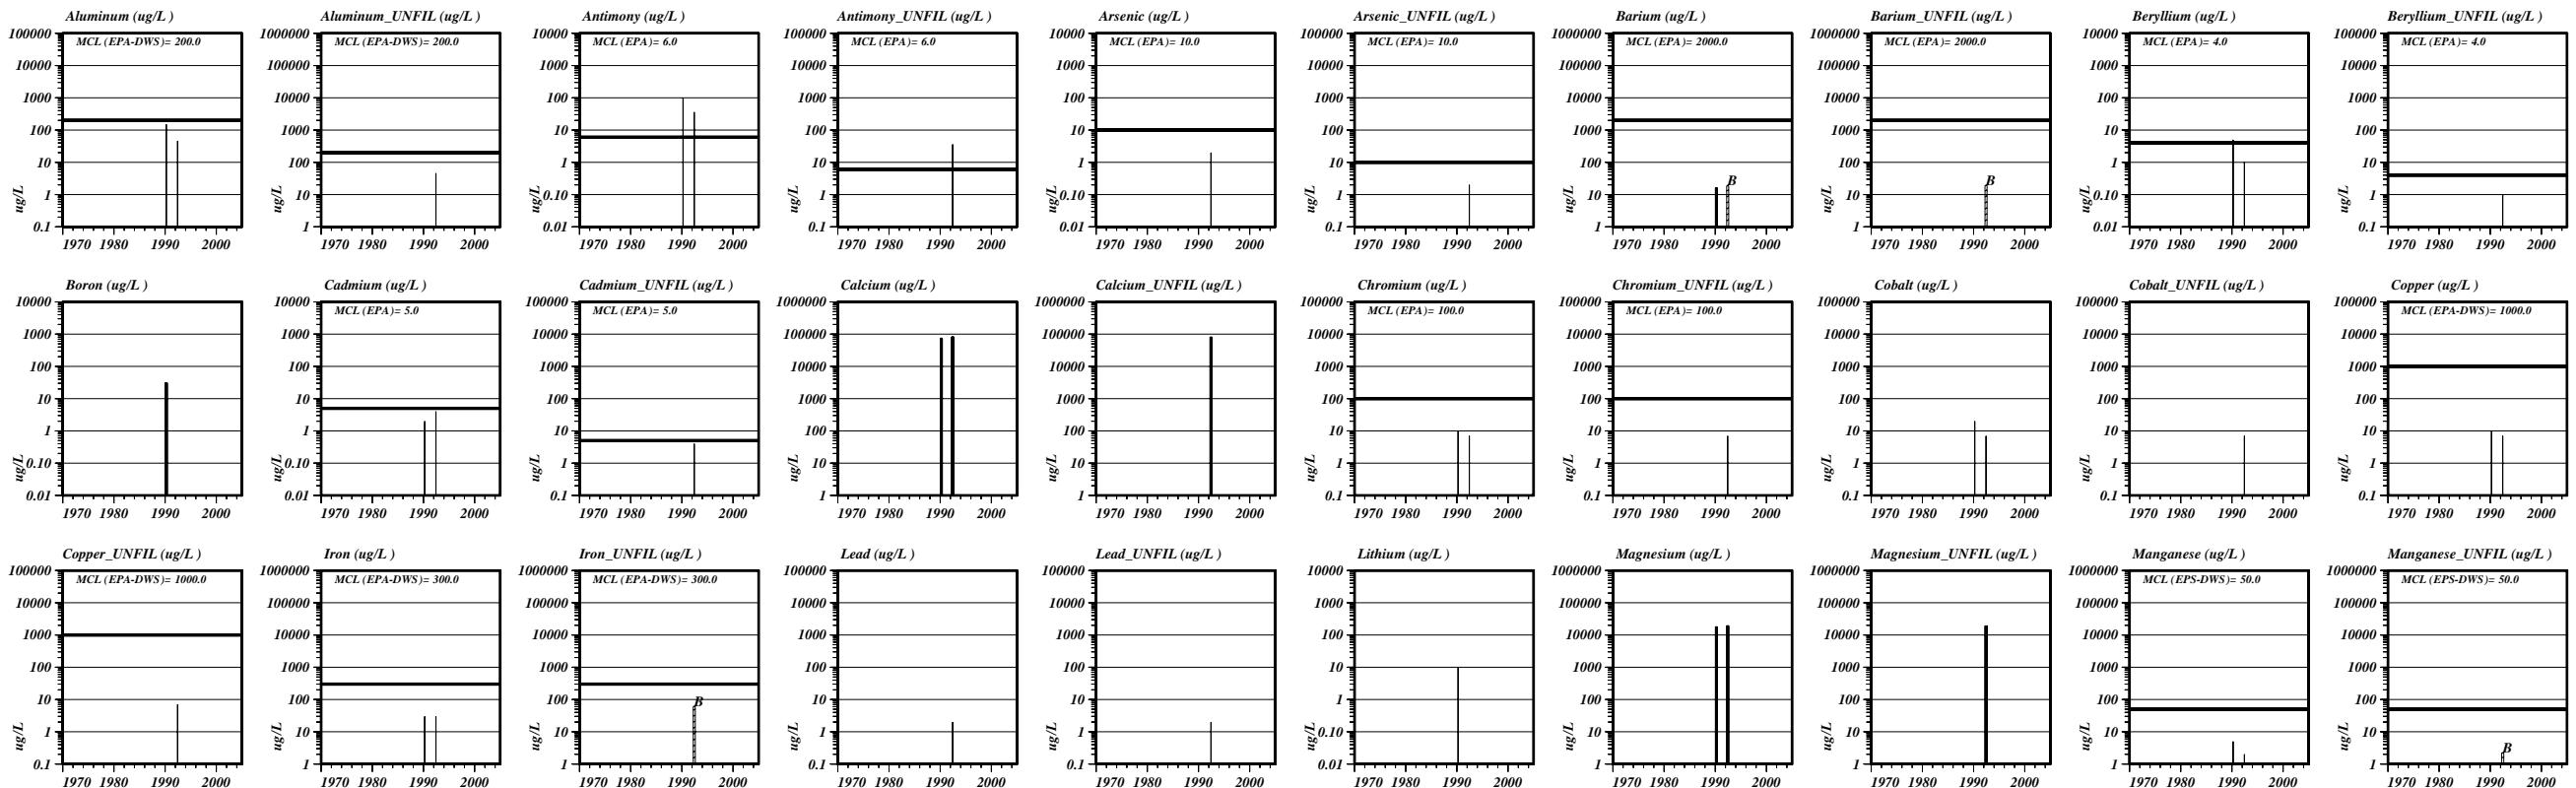


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS wellseries-600-699 WELL#=699-54-48

METALS & PHYSICAL PARAMETERS

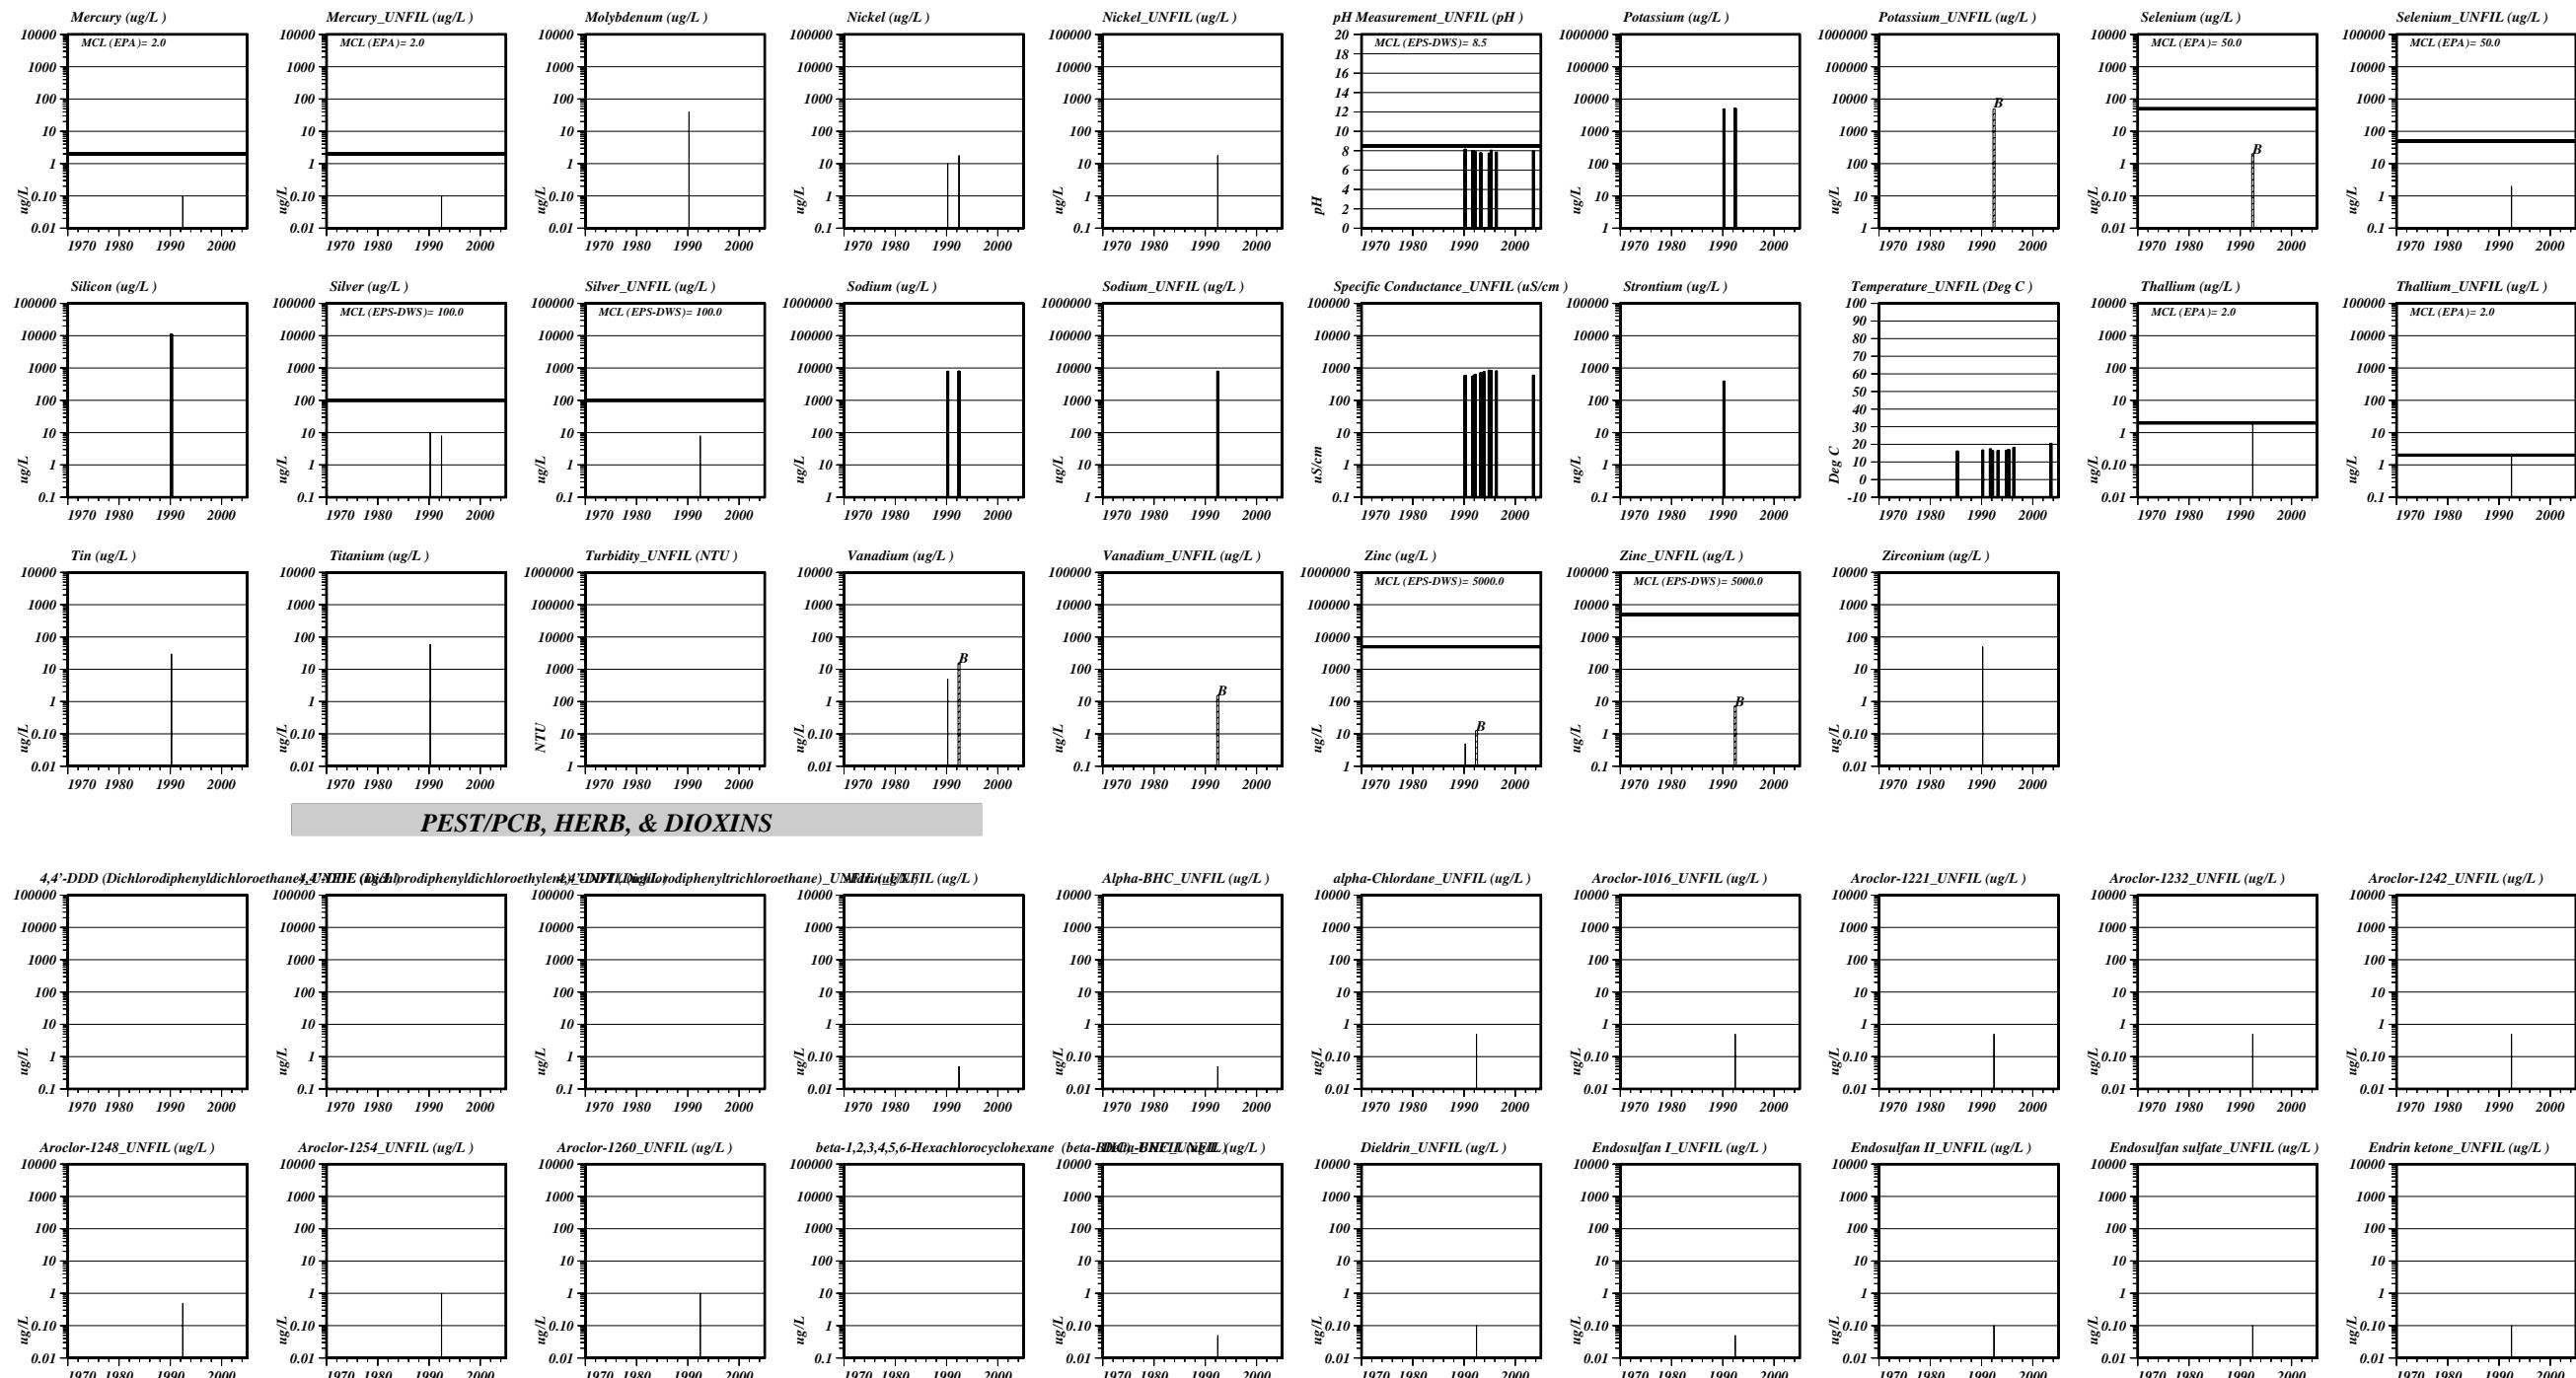

**LABORATORY QUALIFIER FLAGS in HEIS are \* , > , B , C , D , E , J , L , P , Q , R , W , X , Y , and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:**


**ETA-FGR-ETA Implementation Guidance for Radionuclides: WAC—Washington Administrative Code EXPLANATION: THICK-FILLED BARS** Value Above Protection Limit = **THIN BARS**

**EXPLANATION: THICK FILLED BARS=***Value Above Detection Limit***:THIN BARS=***Value Below Detection Limit***:HATCHED BARS=***Value With Data Qualifier Flag*


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-54-48

## PEST/PCB, HERB, & DIOXINS

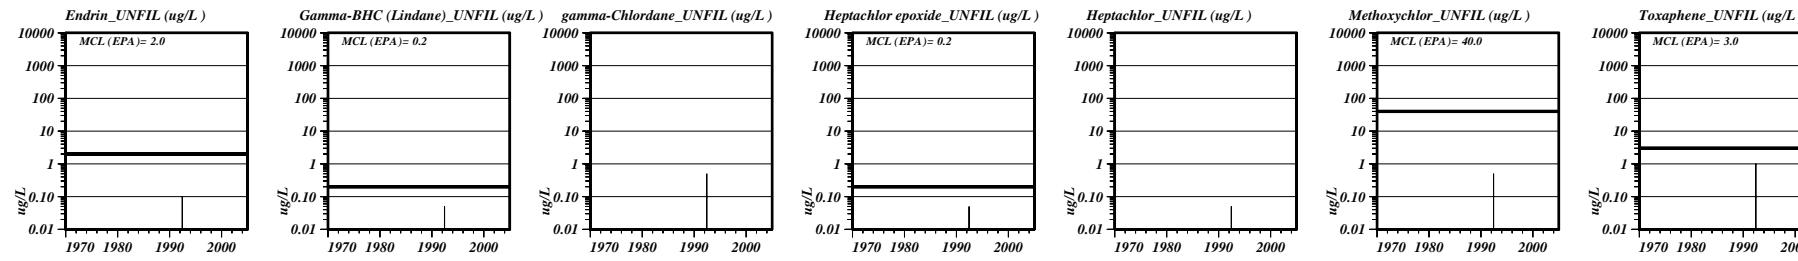

## GENCHEM & ORGANICS & GENORGANICS

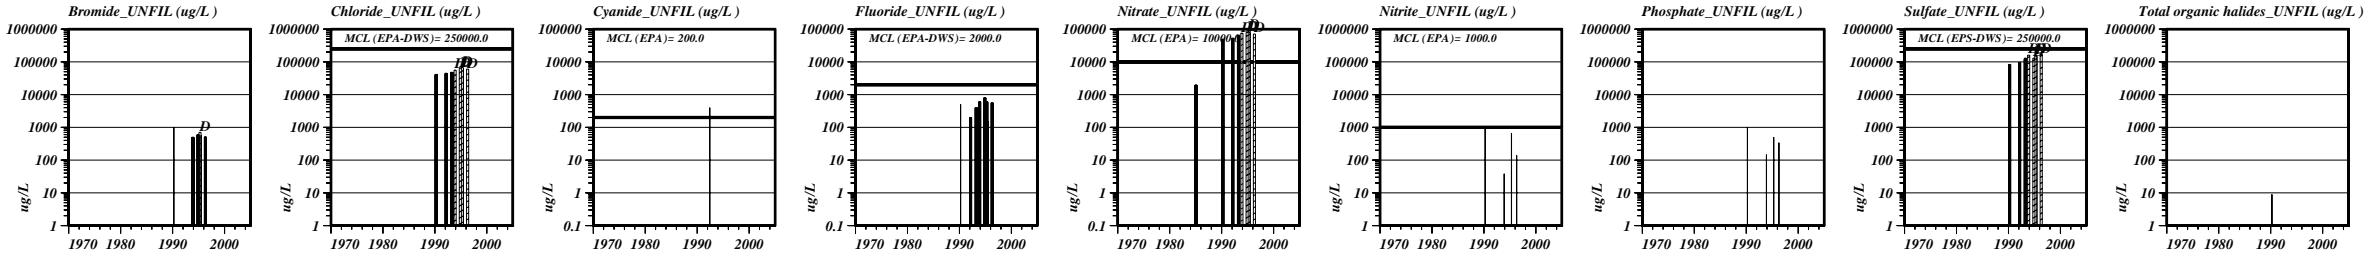

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag