
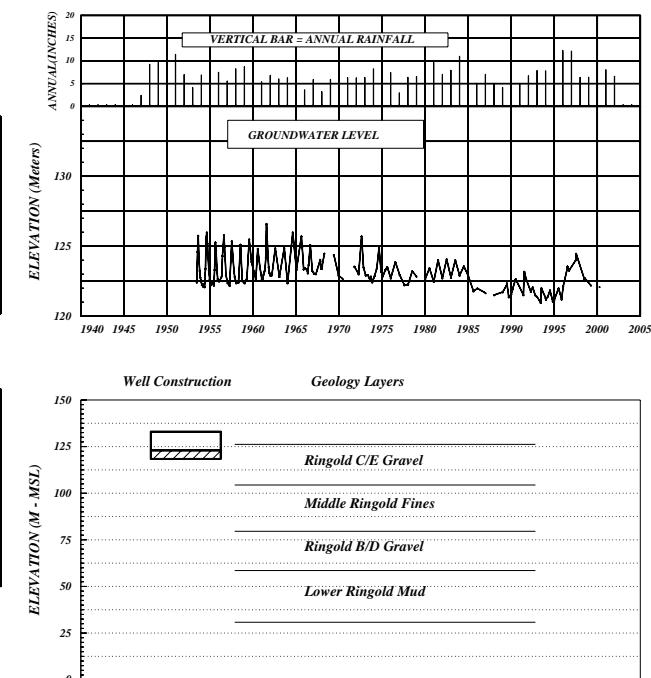


LABORATORY QUALIFIER FLAGS in HEIS are \*; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

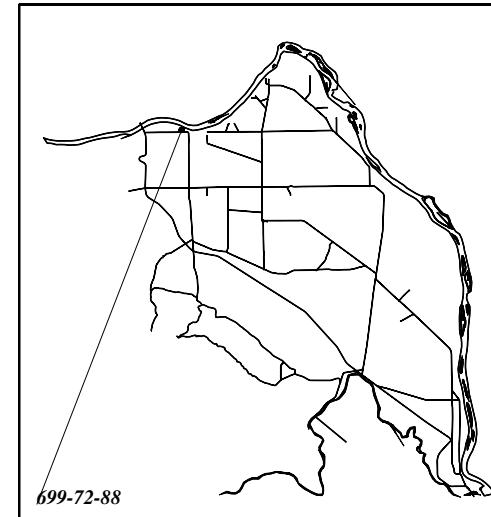


WELLNAME=699-72-88 WELLID=A5324

Well Type=STANDARD Well purpose=GROUNDWATER  
Owner=DOE ContactBHI Well Adm Compliance=COMPLIANT  
Well Construction Date=9/1/1994  
X\_coor= 563247.30 Y\_coor= 145359.90 Datum=NAD83(91) Date Survey= 1/15/1993  
Elevation= 133.009 Datum=NAVD88 Date Survey=01/02/93  
Ref Point Desc=TOP OF CASING Ref Point side=N Contractor=USACE(JECA)  
Total Number of perforation Intervals=1  
NPERF#=1 Perf\_top= 10.06 Bot= 14.63 mCas\_size= 8.00 in Perf\_cuts= 0.00 in  
Total Number of Seals=1  
Seal#=1 Depth\_top= 15.85 Bottom= 16.46 m Material=Cement Plug  
More Information is at <http://www.envirodataaccess.com/wellfiles/699-72-88.htm>


## SEMI-VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE

## METALS &amp; PHYSICAL PARAMETERS

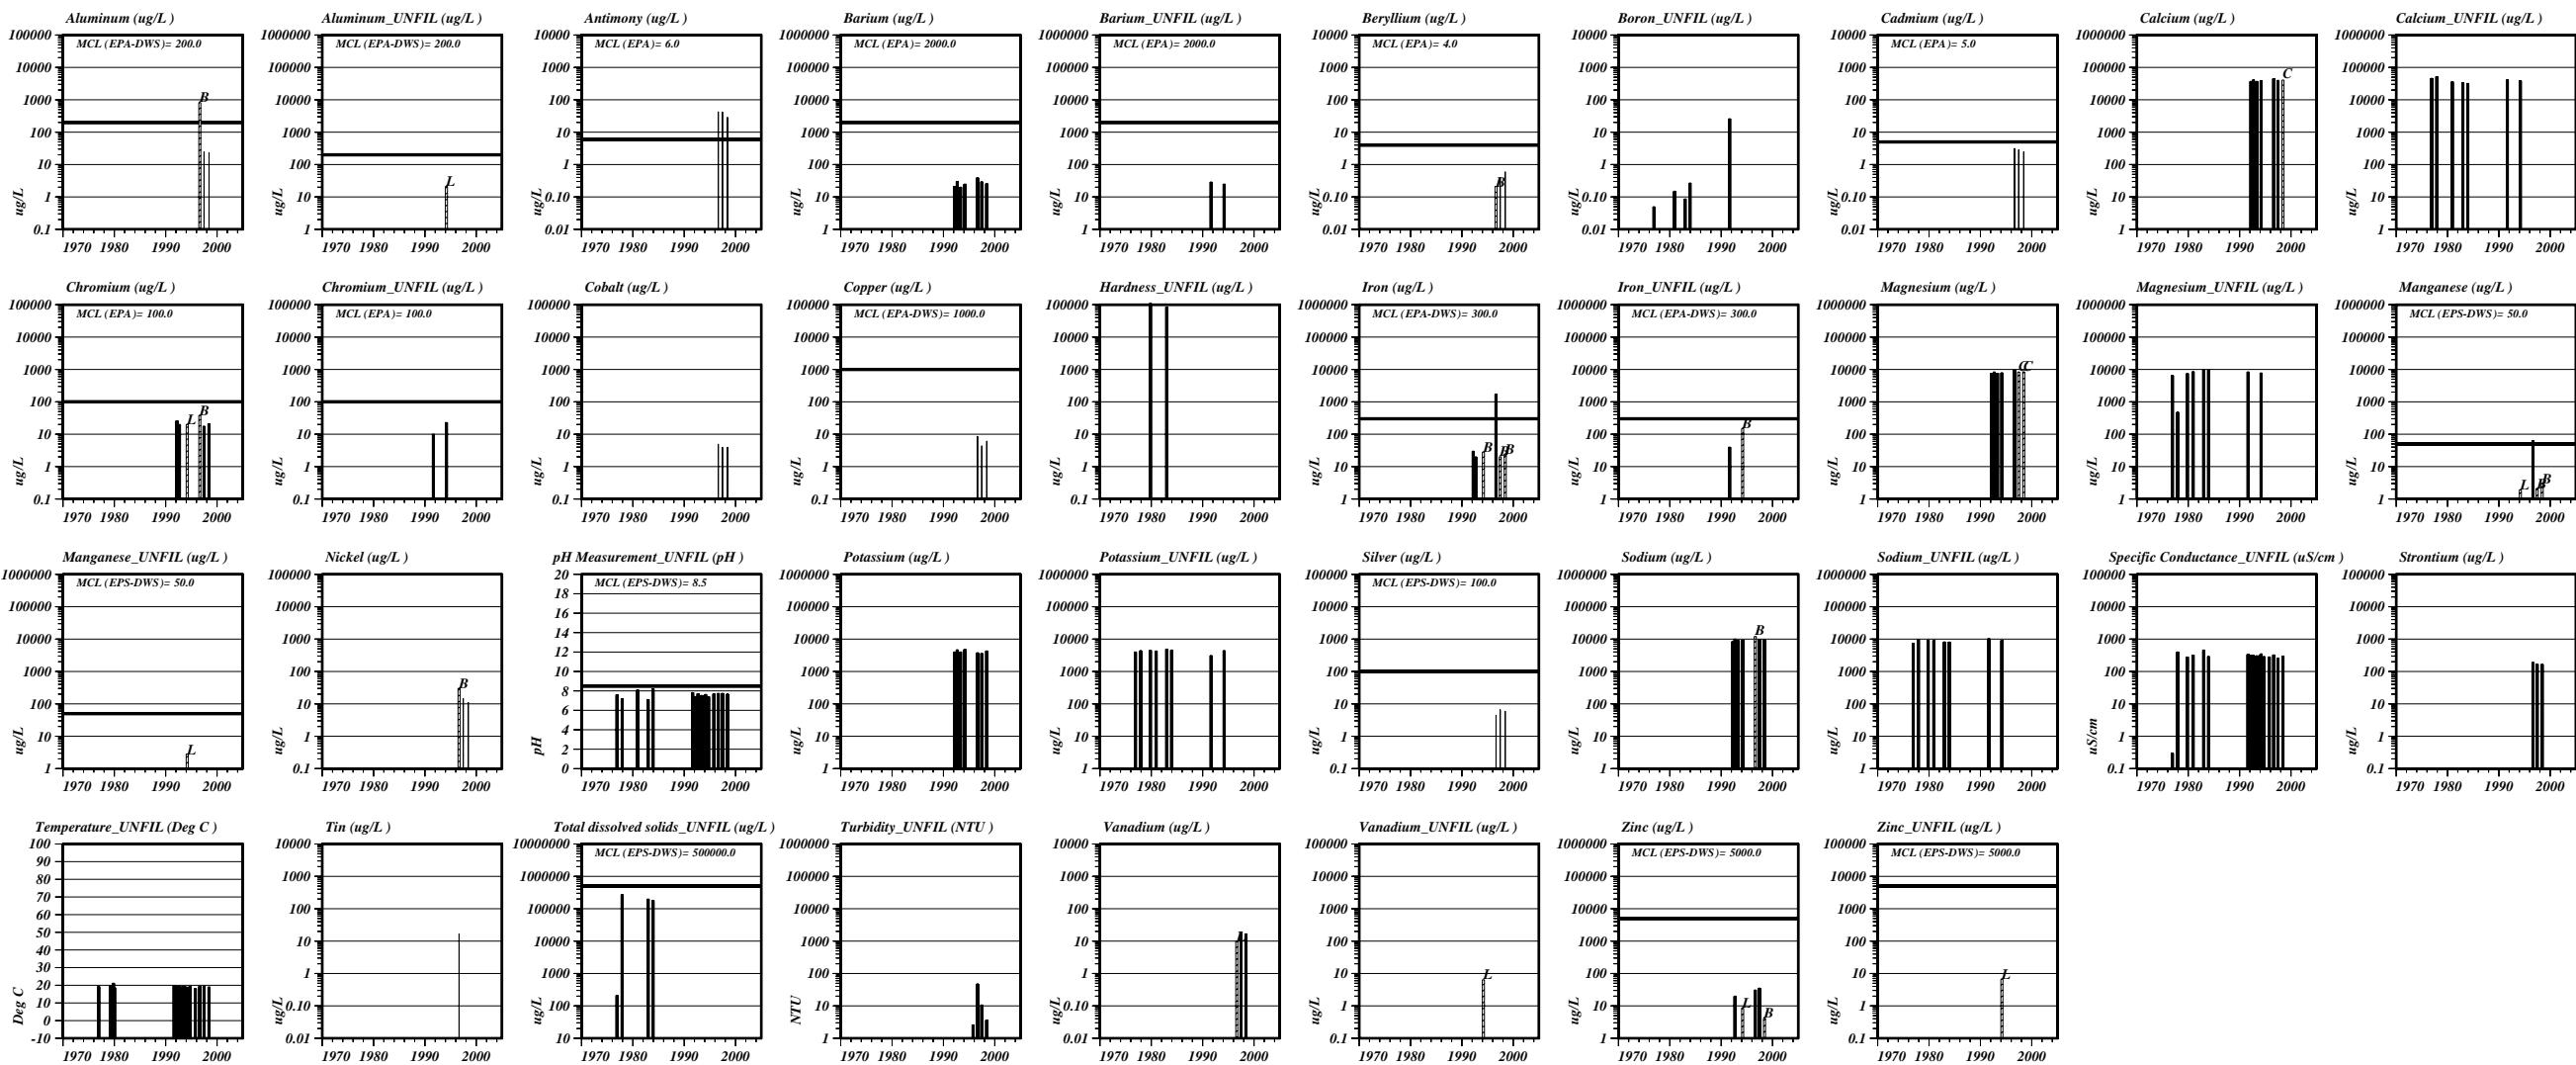

## PEST/PCB, HERB, &amp; DIOXINS NO DATA AVAILABLE

## GENCHEM &amp; ORGANICS &amp; GENORGANICS

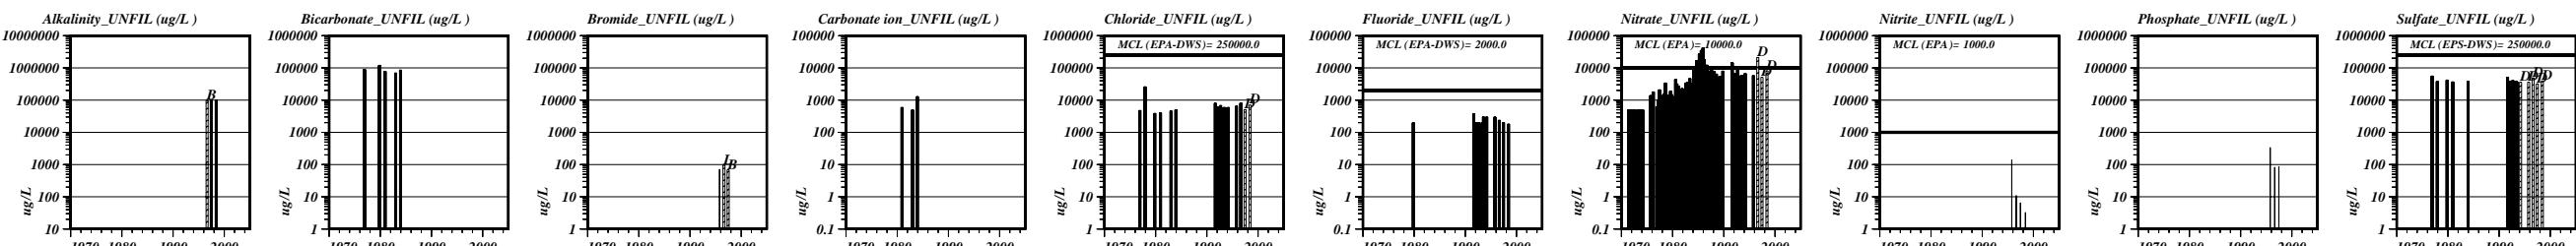

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag