

WELLNAME=699-8-17 WELLID=A5333


Well Type=STANDARD Well purpose=GROUNDWATER
 Owner=DOE Contact=BHI Well Adm Compliance=NON-COMPLIANT
 X_coor= 584675.00 Y_coor= 126017.99 Datum=NAD83(91) Date Survey=9/30/1994
 Elevation= 160.001 Datum=NAVD88 Date Survey=04/13/94
 Ref_Point_Desc=TOP OF CASING Ref_Point_side=N Contractor=USACE(JECA)
 Total Number of perforation Intervals=4
 NPERF#=1 Perf_top= 46.02 Bot= 50.60 mCas_size= 8.00in Perf_cuts= 0.00 in
 NPERF#=2 Perf_top= 44.20 Bot= 45.72 mCas_size= 8.00in Perf_cuts= 0.00 in
 NPERF#=3 Perf_top= 41.15 Bot= 44.20 mCas_size= 8.00in Perf_cuts= 0.00 in
 NPERF#=4 Perf_top= 33.22 Bot= 40.23 mCas_size= 8.00in Perf_cuts= 0.00 in
 Total Number of Screen Intervals=1
 Screen#=1 Screen_diam= 8.00 in Top= 31.39 Bottom= 48.69 m Slot_size= 0.00 in
 Screen_material=Stainless Steel Tele.
 Total Number of Seals=2
 Seal#=1 Depth_top= 48.16 Bottom= 48.77 m Material=Internal Cement Grout
 More Information is at <http://www.envirodataaccess.com/wellfiles/699-8-17.htm>

LABORATORY QUALIFIER FLAGS in HEIS are *; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
 EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

SEMI-VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE


METALS & PHYSICAL PARAMETERS

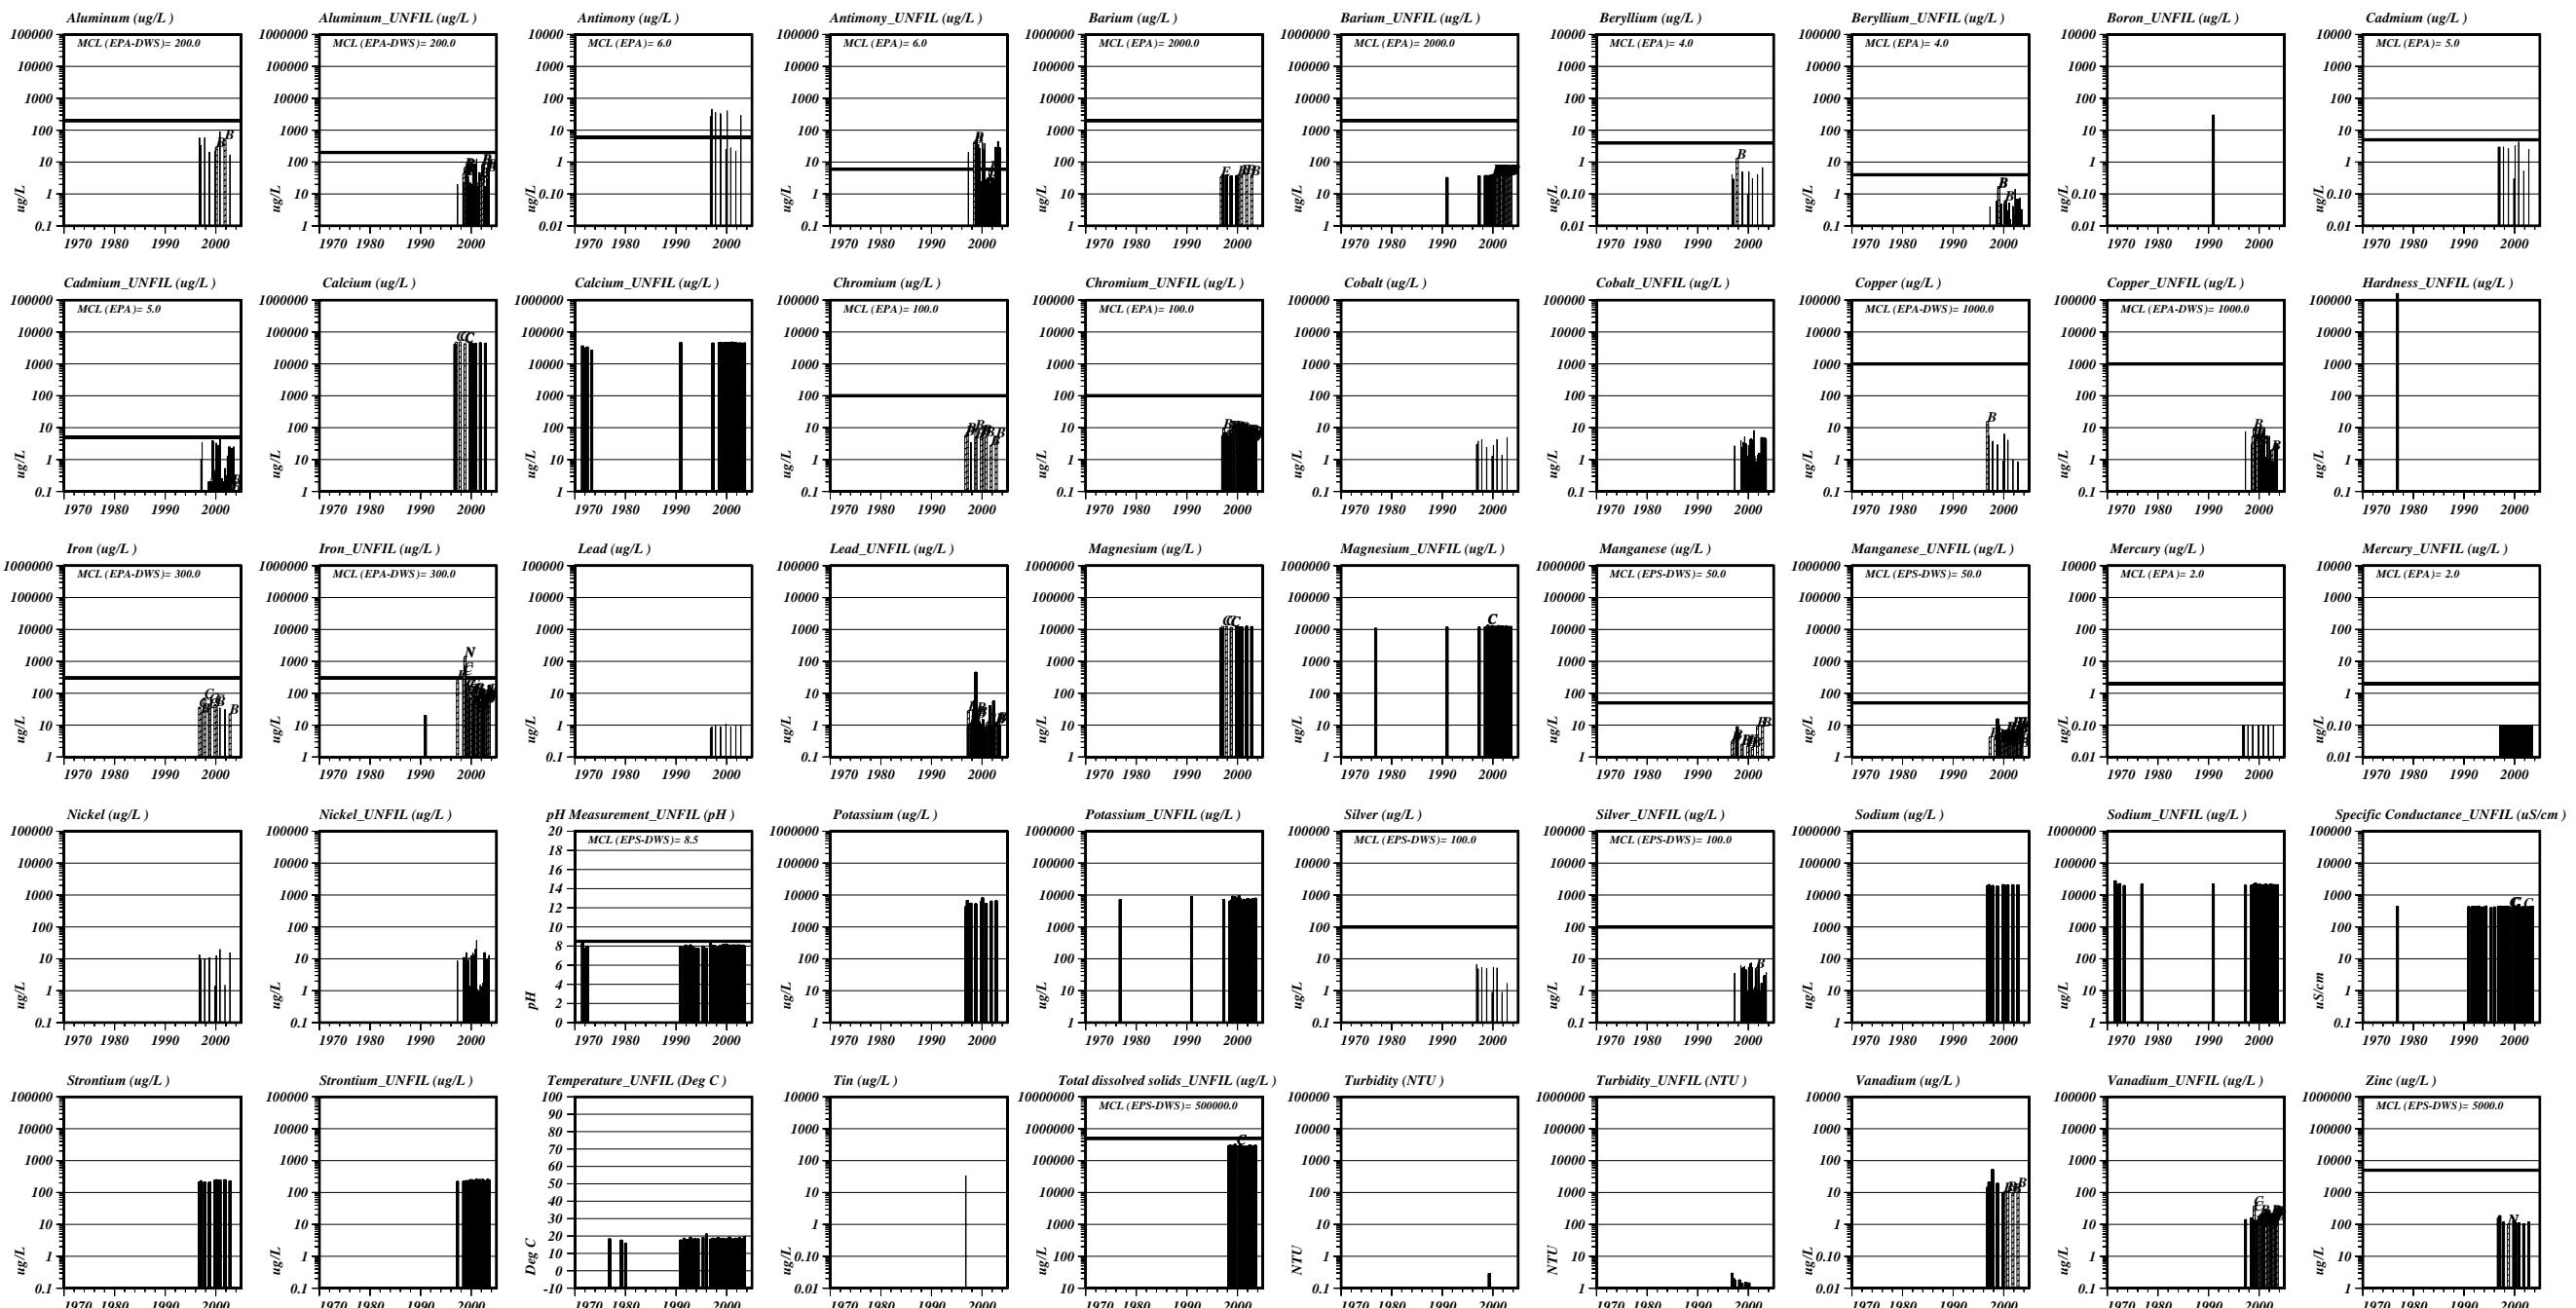

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:














EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

METALS & PHYSICAL PARAMETERS



PEST/PCB, HERB, & DIOXINS NO DATA AVAILABLE

GENCHEM & ORGANICS & GENORGANICS

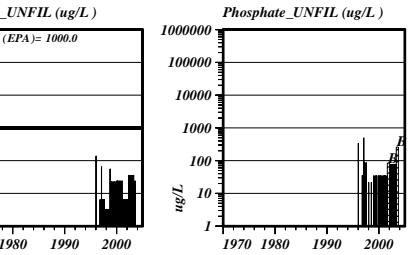

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag