
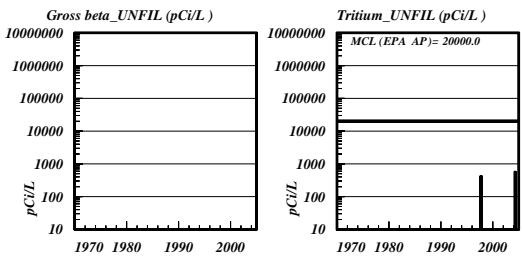
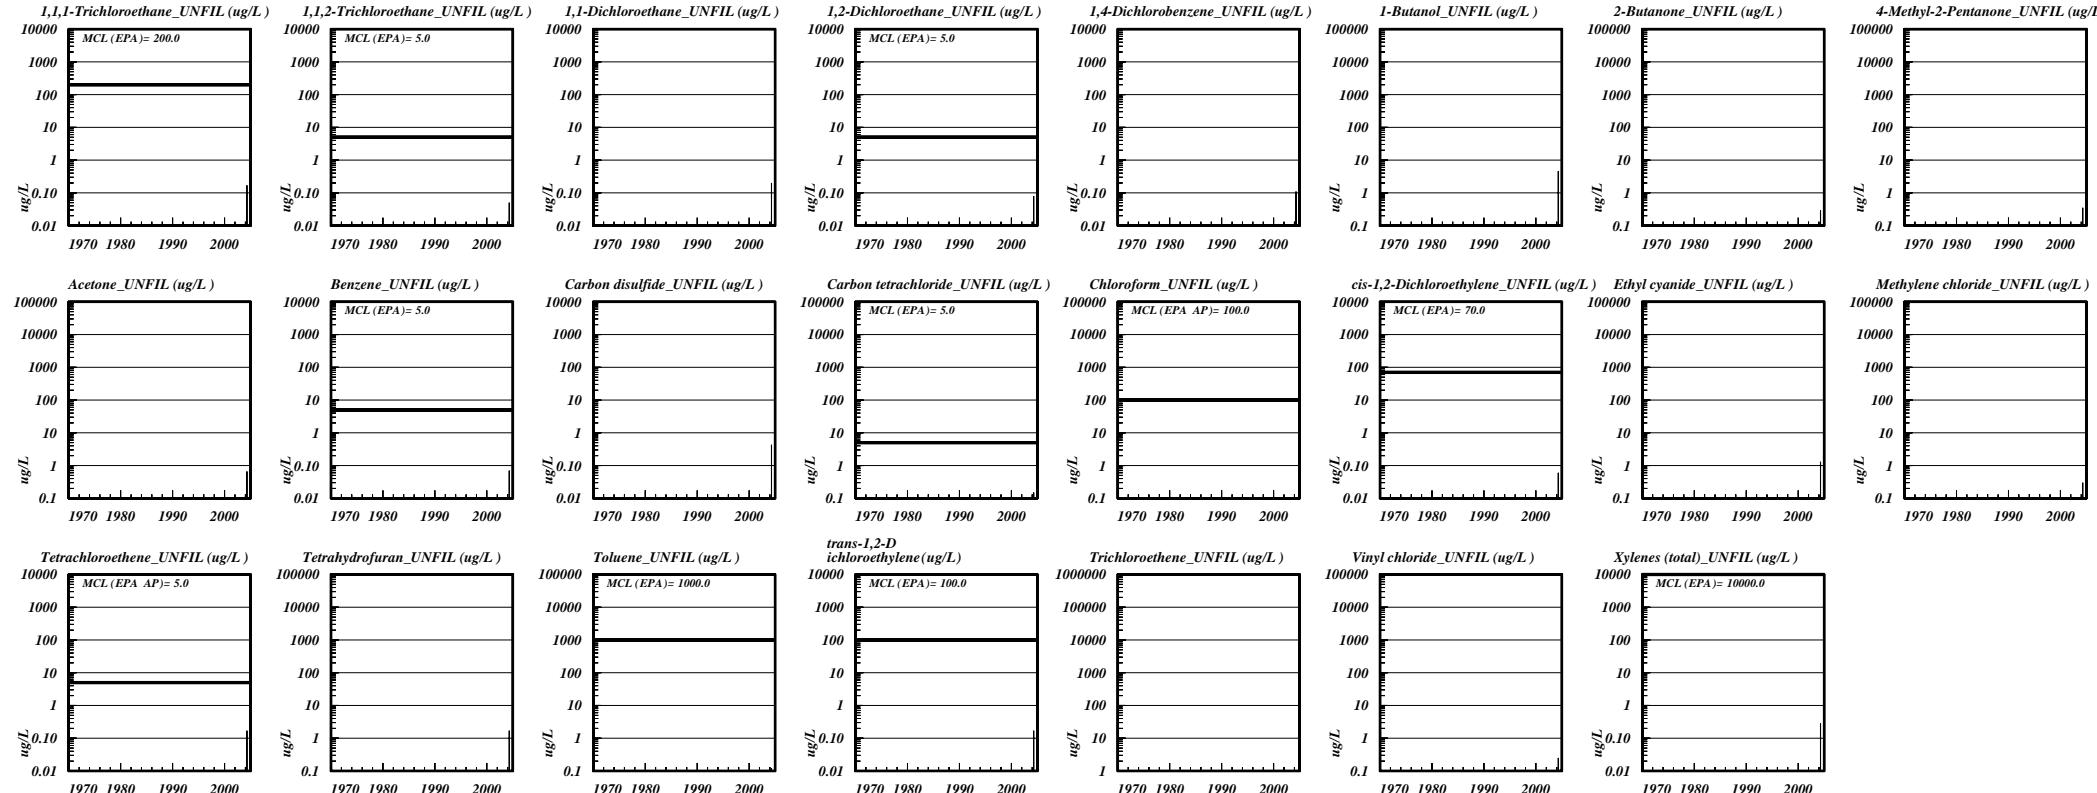
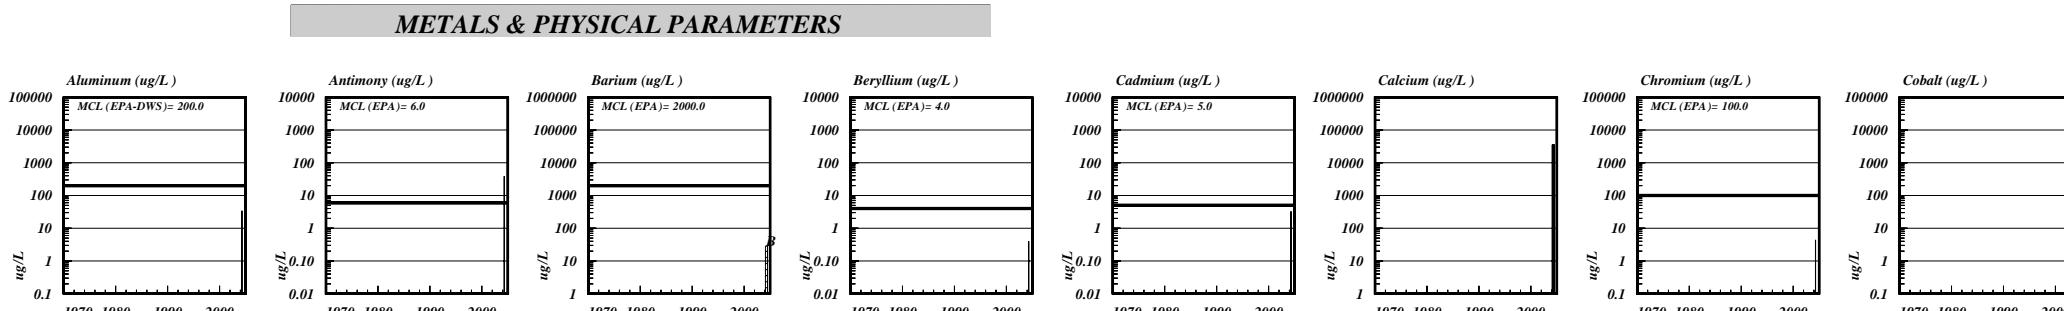
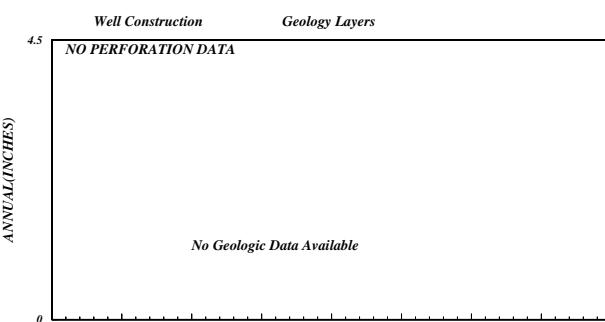
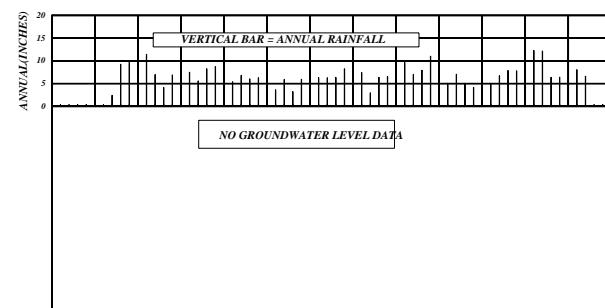


**RADIONUCLIDES****VOLATILE ORGANIC COMPOUNDS****SEMI-VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE**

LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

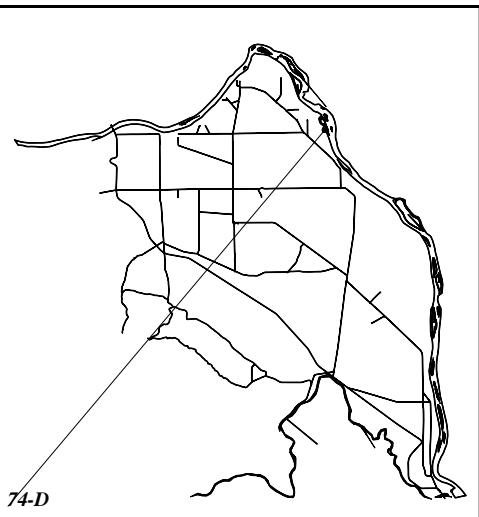


WELLNAME=74-D WELLID=B8370	
Well Type=STANDARD	Well purpose=AQUIFER TUBE
Owner=DOE	Rober Compliance=VARIANCE
X_coor= 582600.50	Y_coor= 145608.40
Datum=NAD83(91)	Date Survey= 12/8/1997
Well Comment= BHI-01153	

# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS


wellseries-0-99 WELL#=74-D

## METALS & PHYSICAL PARAMETERS

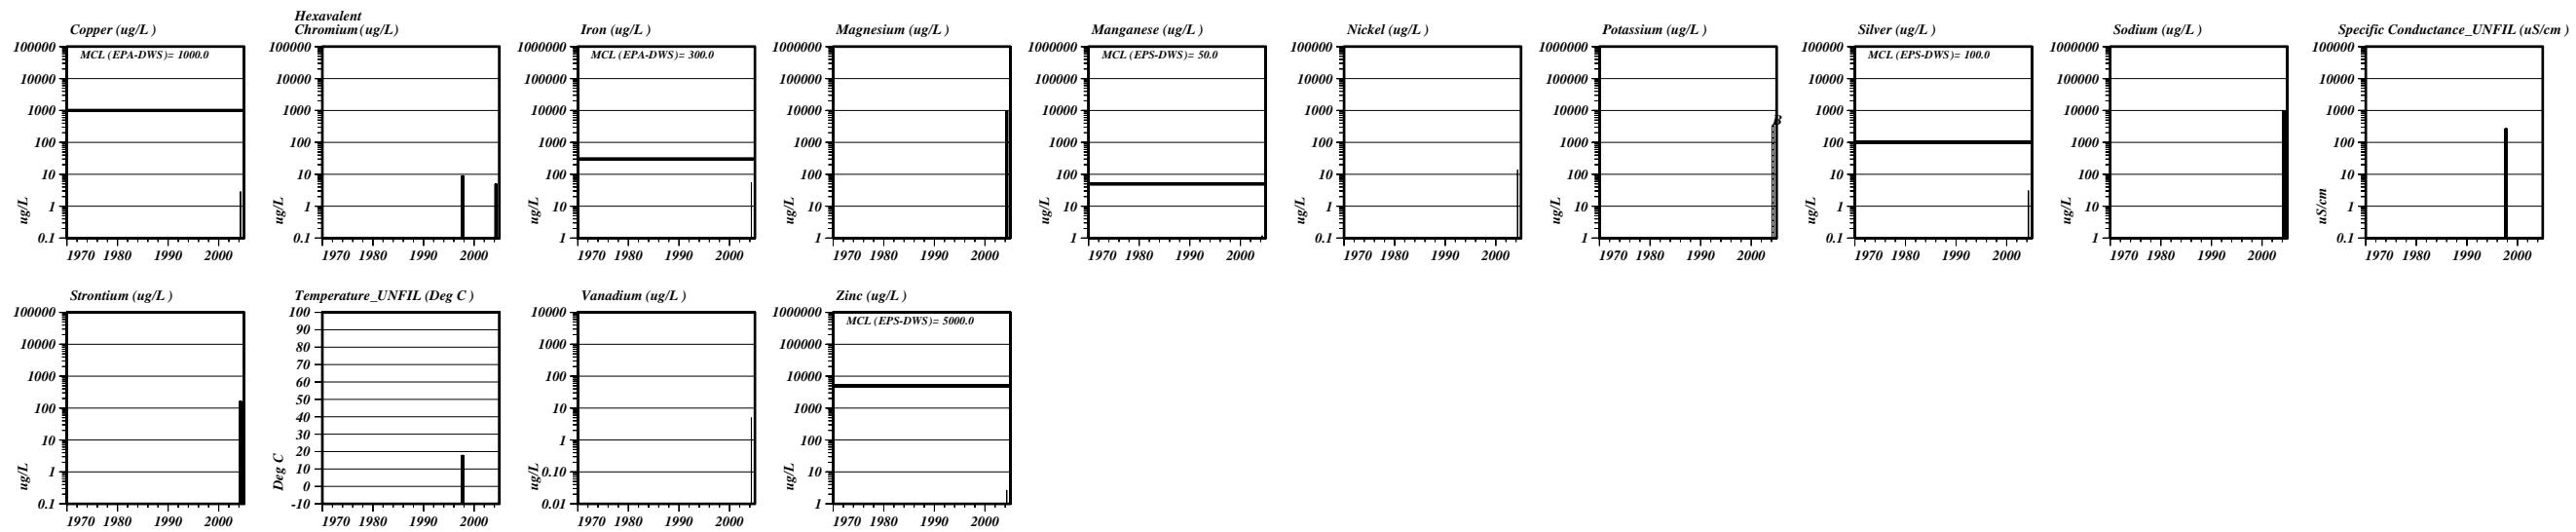

**PEST/PCB, HERB, & DIOXINS NO DATA AVAILABLE**

## GENCHEM & ORGANICS & GENORGANICS

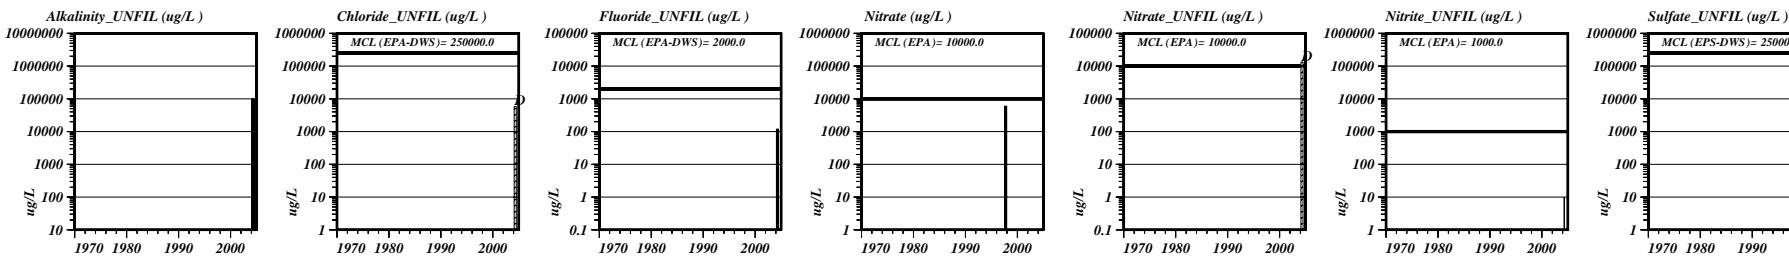

LABORATORY QUALIFIER FLAGS in HEIS are \*; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag