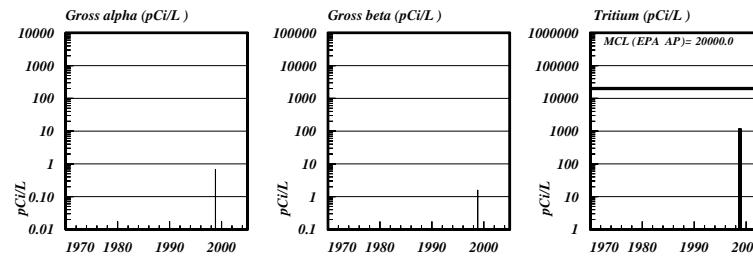
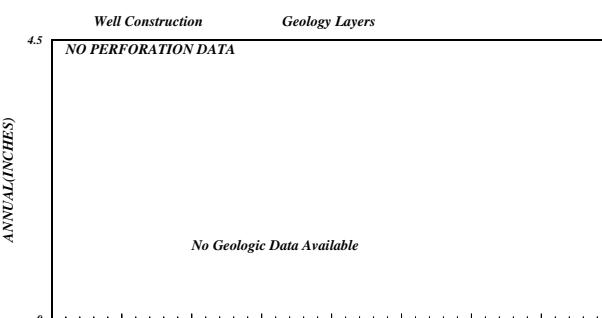
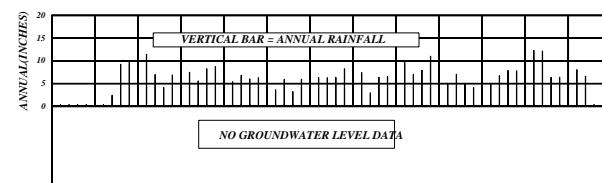
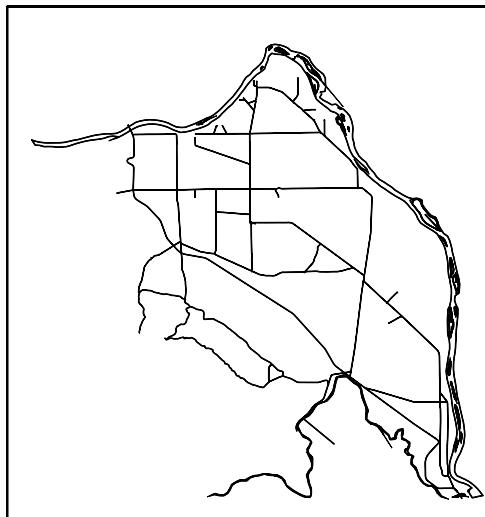
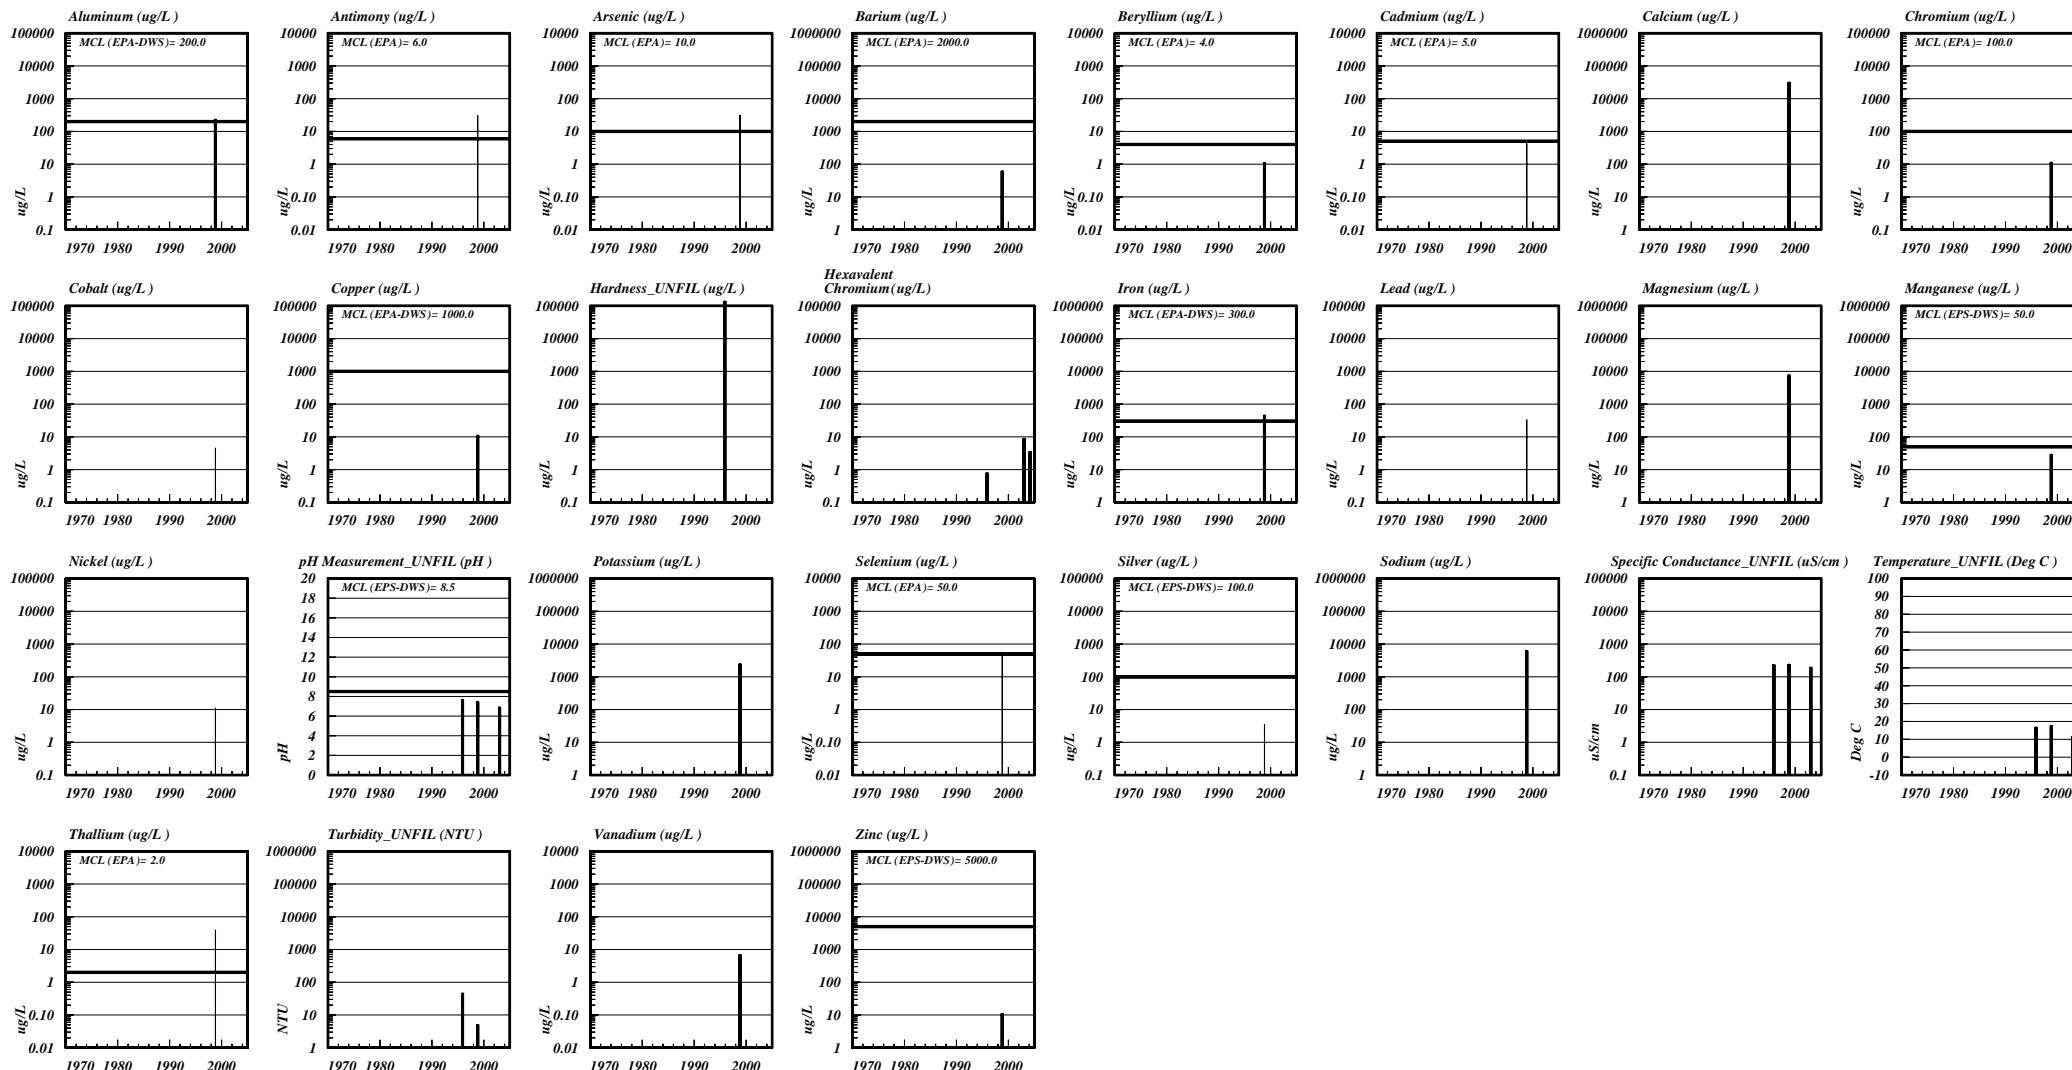


HEIS

RADIOMUCLIDES**VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE****SEMI-VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE****METALS & PHYSICAL PARAMETERS****WELLNAME=DD-06-3 WELLID=B8465**


Well Type=STANDARD Well purpose=AQUIFER TUBE
 Owner=DOE Contact Peterson, Roger Compliance=VARIANCE
 X_coor= 0.00 Y_coor= 0.00 Datum= Date Survey=
 Well Comment= BHI-00778; BHI-01153

LABORATORY QUALIFIER FLAGS in HEIS are *; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
 EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

PEST/PCB, HERB, & DIOXINS NO DATA AVAILABLE

GENCHEM & ORGANICS & GENORGANICS

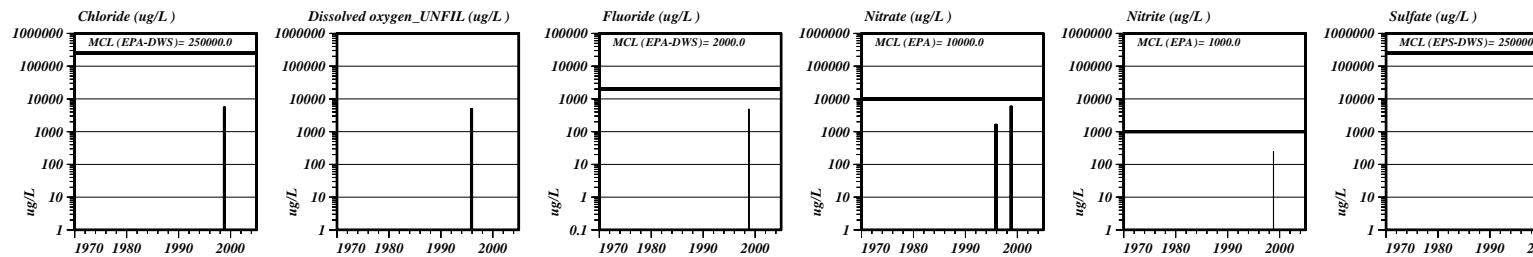

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag